

Installation/Maintenance Instructions

Low-Voltage Power Circuit Breakers

*Type K-3000, K-4000
K-3000S, K-4000S, K-3000M, K-4000M
3000 and 4000 Amperes
600 Volts*

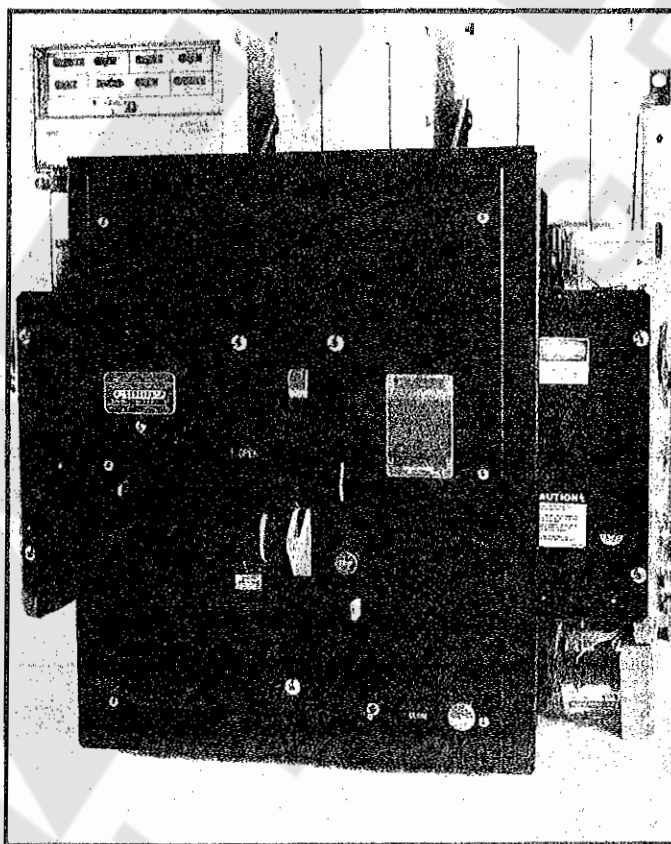


ABB Power Distribution, Inc.
Circuit Breaker Division

ABB
ASEA BROWN BOVERI

TABLE OF CONTENTS

	PAGE
INTRODUCTION	3
RECEIVING AND STORAGE	3
BASIC HANDLING AND INSTUCTIONS	3
CIRCUIT BREAKER OPERATION AND RATING	3
CLOSING SPRING OPERATION	3
ESCUTCHEON OPERATING FEATURES	3
Circuit Breaker Nameplate	5
Manual Trip Button	5
Circuit Breaker "OPEN" or "CLOSED" Indicator	5
Automatic Trip Indicator	5
Automatic Trip Alarm Contacts	5
Automatic Trip Lockout Device	5
Padlocking Device	5
Closing Spring Charge Indicator	5
Motor Disconnect Switch	5
Electrical Close Push Button	6
Manual Close Lever	6
Racking Mechanism	6
OPERATION OF DEVICES	6
Electro-Mechanical OVCT Device	6
Control Relay	7
Auxillary Switches	8
Undervoltage Trip Device	8
INSTALLATION	9
Checking Circuit Breaker Operation In Test Position	9
Manual Closing Operation	9
CIRCUIT BREAKER REMOVAL	9
PERIODIC MAINTENANCE INSPECTION	10
Arc Chutes	10
Insulation Structure	10
Contacts	10
Contact Pitting	10
Contact Pressure Check and Adjustment	10
Manual Slow Close to Check Contact Pressure	11
Operating Mechanism	11
Primary Trip Latch	13
Tripper Bar Adjustment	13
Electro-Mechanical OVCT Device Adjustments	14
Armature Trip Travel Adjustment	14
Solid State OVCT Device Settings	15
LUBRICATION	15
DIELECTRIC TESTS	15
ELECTRICAL CHARACTERISTICS	17
RENEWAL PARTS	17
MICRO Power Shield (MPS)	18
Protective Elements	18
Ampere Range Selector	18
Targets	19
Long-Time	19
Short-Time	19
Instantaneous	20
Ground	20
Self-Monitoring	20
Making Settings	20
Testing	20
PROCEDURES FOR FIELD TEST ON KLINE	
CIRCUIT BREAKERS	21
MPS SOLID STATE SYSTEM TEST	21
PRIMARY CURRENT TESTING	21
INSTANEOUS THRESHOLD TEST	21
LONG-TIME DELAY TEST	21
SHORT-TIME DELAY TEST	22
GROUND TRIP DELAY TEST	22
FIELD REPAIR INSTRUCTIONS	23
MAGLATCH PRETRAVEL ADJUSTMENT	24
LUBRICATION	24

INTRODUCTION

These instructions apply to the type K-3000 and K-4000, K-3000S and K-4000S circuit breakers; 3000 and 4000 ampere ac continuous current rating respectively. The type K-3000 and K-4000 are equipped with electromechanical overcurrent trip devices, whereas the type K-3000S and K-4000S incorporate the solid state overcurrent trip devices. A K-3000S circuit breaker is shown on the front cover of this bulletin.

The K-3000 and K-4000 circuit breakers can be furnished with two or three poles for dc or ac operation. K-3000S and K-4000S circuit breakers are only furnished for three pole ac operation.

All circuit breakers can be furnished as drawout or stationary mounted and are available as manually or electrically operated, and with electrical control devices available in various ac and dc voltage combinations. Many optional features are also available.

An electrically operated, drawout type circuit breaker is shown in Figure 1, with a typical schematic diagram shown in Figure 2.

These instructions should be read thoroughly before handling, installing and/or operating the circuit breaker.

RECEIVING AND STORAGE

Immediately upon receipt of the circuit breakers, examine the cartons to determine if any damage or loss was sustained during transit. If injury or rough handling is evident, file a damage claim at once with the carrier and promptly notify the nearest District Office. The Company is not responsible for damage of goods after delivery to the carrier. However, the Company will lend assistance if notified of claims.

Unpack the circuit breakers as soon as possible after receipt. If unpacking is delayed, difficulty may be experienced in making a claim for damages not evident upon receipt. Use care in unpacking in order to avoid damaging any of the circuit breaker parts. Check the contents of each carton against the packing list before discarding any packing material. If any shortage of material is discovered, promptly notify the nearest District Office. Information specifying the purchase order number, carton number and part numbers of the damaged or missing parts should accompany the claim.

Circuit breakers should be installed in their permanent location as soon as possible. (See Basic Handling below). If the breakers are not to be placed in service for some time, it is advisable to provide adequate means of protection.

This may be done by keeping the breaker in its original carton, covering with waterproof paper and sealing to prevent infiltration of dirt. Where conditions of high humidity prevail, the use of heaters is recommended.

BASIC HANDLING INSTRUCTIONS

Once the circuit breaker has been unbolted and removed from its shipping carton, it should be turned to the upright position and placed on a flat surface to avoid damage to breaker parts. For safety, all handling in this position should utilize the lifting yoke (20) shown in Figure 1.

CIRCUIT BREAKER OPERATION CIRCUIT BREAKER RATING

The K-3000/K-3000S and K-4000/K-4000S circuit breakers are designed to carry a maximum ac continuous current of 3000 amperes and 4000 amperes respectively. Exceeding these ratings may raise the temperature of the breakers beyond their design limit and thus affect the life of the breaker. Thus, any long-time pickup setting exceeding 100% of the frame size is to be used only for coordination, not for carrying increased continuous current.

CLOSING SPRING OPERATION


The two closing springs supply the power that closes the circuit breaker and also charge the two opening springs during the closing operation. The closing springs are charged by a motor in the electrically operated breaker and charged by hand in the manually operated breaker; however, in either type, the springs are charged the same amount and when charged, the spring energy is available to close the breaker, thus referred to as "stored energy". The closing springs are normally charged when the breaker is opened. If charged after closing, (optional) the breaker may be opened and then reclosed without recharging the springs. In drawout breakers, the closing springs are automatically discharged when the breaker is moved from the disconnected to the withdrawn position (shown in Figure 1). This prevents accidental discharge.

ESCUTCHEON OPERATING FEATURES

Manually and electrically operated circuit breakers are provided with an extendible escutcheon face plate. This escutcheon provides a central area for the controls which are mounted directly on the circuit breaker.

The controls for manually operated circuit breakers, Figure 1, included in the escutcheon face plate are: (25) a nameplate giving the various ratings assigned to the particular

These instructions do not purport to cover all details or variations in equipment nor to provide contingency to be met in connection with installation, operation, or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the nearest District Office.

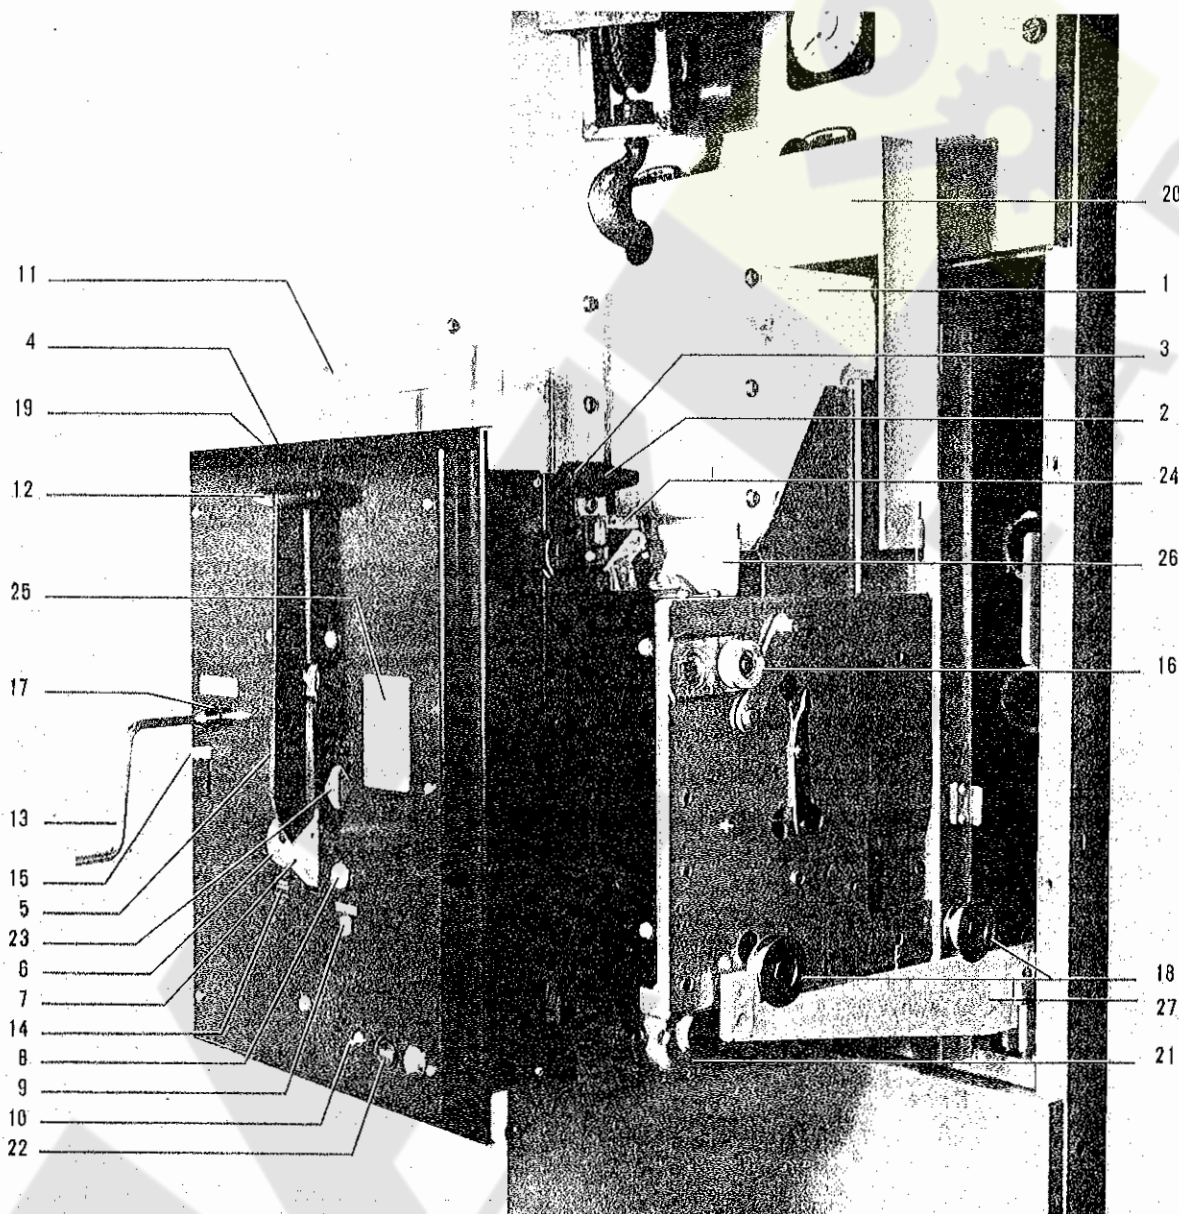

- | | | |
|---|---|-----------------------------------|
| 1. Arc Chute | 11. Spring Retainer Bracket | 21. Closing Spring Charging Motor |
| 2. Arc Chute Retainer Molding | 12. Manual Charge Handle | 22. Electrical Close Button |
| 3. Arc Chute Mounting Screw | 13. Racking Crank | 23. Locking Hasp |
| * 4. Shutter | 14. Closing Spring Charge Indicator | 24. Auxiliary Switch |
| * 5. Visual Indicator for
Breaker "Closed" or "Opened" | 15. Drawout Lever | 25. Nameplate |
| 6. Manual Close Lever | 16. Racking Cam Rollers | 26. Plate |
| 7. Manual Charging Lever | 17. Racking Crank Opening | 27. Hinged Track Extensions |
| 8. Manual Trip Button | 18. Wheels | |
| 9. Automatic Trip Indicator | * 19. Shutter Lock Screw
(Inserted in Shutter) | |
| 10. Motor Disconnect Switch | 20. Lifting Yoke | |

*Not Visible in This View

Fig. 1 — Typical Electrically Operated, Drawout Type
K-3000 Circuit Breaker

type of circuit breaker, (12) the manual charging handle, (8) the manual trip button, (5) the "OPEN" and "CLOSED" position indicator, (9) the automatic trip indicator with optional facilities for alarm indication and for lockout, (23) a means for padlocking the circuit breaker in the "CONNECTED," "TEST" or "DISCONNECTED" positions, and (14) closing spring charging indicator.

The controls for the electrically operated circuit breakers, Figure 1, are the same as the manually operated circuit breakers except the charging handle (12) is removed and stored for maintenance use, and the presence of (10) motor disconnect switch for the motor electrical circuit and (22) electrical close push button switch.

The manually and electrically operated drawout circuit breaker escutcheon also contains the racking crank opening (17) and interlocking drawout lever (15).

A self-aligning plate, immediately behind the escutcheon face plate, is used to exclude dust from the circuit breaker compartment. On drawout type circuit breakers, the escutcheon face will protrude through the front door of the compartment when the circuit breaker is in the "TEST" and "DISCONNECTED" positions. In these positions, the dust-plate still functions to exclude dust.

Circuit Breaker Nameplate (Figure 1, Item 25)

The circuit breaker nameplate contains information regarding (1) the manufacturer's name and address, (2) type of circuit breaker design, (3) serial number of circuit breaker, (4) continuous current rating of frame size, (5) short circuit current rating at rated voltages, (6) frequency, (7) short time current.

Manual Charging Handle (Figure 1, Item 12)

The manual charging handle is a T-shaped lever used to charge the closing springs by pumping approximately ten times.

Manual Trip Button (Figure 1, Item 8)

The manual trip button, when pushed, trips the circuit breaker to "OPEN."

Circuit Breaker "OPEN" or "CLOSED" Indicator (Figure 1, Item 5)

This indicator shows the physical position of the circuit breaker contacts.

Automatic Trip Indicator (Figure 1, Item 9) (Not including undervoltage, alarm switch or lockout)

The automatic trip indicator is provided as standard equipment on the K-line® circuit breakers and is used to indicate the operation of the overcurrent trip device.

This device is an indicator only and does not prevent the circuit breaker reclosing.

Upon an overcurrent trip operation, the indicator protrudes from the front plate approximately 1/2 inch.

The automatic trip indicator should be reset after each trip indication by pushing back into its normal latch position. The operator should investigate the cause of tripping before resetting the automatic trip indicator and subsequently reclosing the circuit breaker after an outage which results in an operation of the indicator.

Automatic Trip Alarm Contacts (Hand Reset)

(Figure 1, Item 9)

An alarm switch for remote electrical indication, which is optional, shows when automatic tripping has occurred. This is accomplished by adding a precision snap switch to the automatic trip indicator assembly. The automatic trip indicator actuates the roller on the alarm switch which in turn causes a normally open contact to close and a normally closed contact to open on overcurrent trip. The alarm contact is manually reset by pushing the trip indicator (9) back into its normal position.

Automatic Trip Lockout (Hand Reset) (Figure 1, Item 9)

An additional device (which is also optional) may be added to the automatic trip indicator assembly device which serves to mechanically prevent reclosing the circuit breaker after an automatic trip operation. When the trip indicator is pushed in, the circuit breaker mechanism can then be operated to close the circuit breaker contacts.

Padlocking Device (Figure 1, Item 23)

All K-line circuit breakers are equipped with means of padlocking the circuit breaker mechanism in a trip-free position. This is accomplished by the use of a locking plate to maintain the manual trip button in a tripping direction when the locking plate is held forward by one or more padlocks. To obtain the condition for padlocking the circuit breaker in the open position, the manual trip button is pushed inward. Then the padlock plate is pulled out and the padlock inserted into the vertical slot. In this position, the mechanism is maintained trip free and the contact arm cannot be moved to the closed position.

On circuit breakers equipped with drawout mechanism, the padlocking device is associated with the drawout interlocking mechanism so that the circuit breaker cannot be moved from any of its three basic drawout positions of "CONNECTED," "TEST" or "DISCONNECTED" with the padlocking in effect.

Closing Spring Charge Indicator (Figure 1, Item 14)

Under normal operating conditions, the closing springs are automatically charged after each tripping operation. However, there are occasions when the springs will be in a discharged state. Therefore, it is desirable that means be available to indicate the charged or uncharged condition of the closing springs. This is accomplished by a visual indicator seen through an aperture in the escutcheon plate. The indicator is marked "CHARGED" and "UNCHARGED."

Motor Disconnect Switch (Figure 1, Item 10)

The motor disconnect switch is a double pole, single-throw toggle type switch connected in series with the charging motor circuit and is used to disconnect the motor from the voltage source. This switch is used (1), when it is desirable to prevent automatic recharging of the closing springs just prior to taking the circuit breaker out of service for maintenance and (2), for control wiring dielectric test. The motor must be disconnected for the control wiring dielectric test and subsequently tested at 540 V ac or 760 V dc.

Electrical Close Push Button (Figure 1, Item 22)

The electrical close push button is used to electrically close the circuit breaker from the escutcheon. This contact is connected in series with the latch release coil. Energizing the latch release coil allows the charged springs to close the circuit breaker.

Manual Close Lever (Figure 1, Item 6)

The manual close lever is provided on all circuit breakers to provide a safe means of closing the breaker without control power. The lever is provided with a ring to which a lanyard should be attached for closing the breaker at a safe distance.

Racking Mechanism (Drawout Breaker)

The racking mechanism is used to move the circuit breaker to any one of its three positions—"CONNECTED," "TEST" or "DISCONNECTED." All of these positions are attainable with the cubicle door closed or opened. The breaker can be closed only when the drawout lever (15, Figure 1) is up. When up, the racking crank (13, Figure 1) cannot be turned. The circuit breaker must be in the "OPEN" position before lever (15, Figure 1) can be pushed down. In order to move the circuit breaker from one position to another, the lever must be pushed down and the crank turned; once turning begins, the lever will stay down until another position is reached and the lever will snap up, preventing additional turning, until the lever is again pushed down.

When the padlocking device is locked, the lever (15) is locked in the up position preventing movement of the racking mechanism.

Figure 1 shows the breaker in the fully withdrawn position. There are two sets of indicator lines on the left side of the breaker to show breaker position. One set is visible with the switchboard door closed, the other visible when the door is open.

OPERATION OF DEVICES

Electro-Mechanical Overcurrent Trip Devices Type K-3000 and K-4000 Circuit Breakers (Figures 10 and 11)

(A) Type OD-300 General Purpose Overcurrent Trip Device. The type OD-300 overcurrent trip device, for general

purpose applications, provides long-time delay tripping on moderate overcurrents which are above the long-time pickup setting; and instantaneous tripping on fault currents above the instantaneous trip setting. This device must be properly set to provide adequate protection for an electrical system. Three adjustment screws on the bottom of the device provide independent control of the long-time pickup, instantaneous pickup and amount of time delay. The nameplate of this device shows the setting of these adjustments and the range of settings which are available. For information on the time-current characteristics of this device, request a copy of TD-6693.

(B) Type OD-400 Selective Overcurrent Trip Device. The type OD-400 overcurrent trip device, for selective tripping applications, provides long-time delay and short-time delay tripping. Independent adjustment of both pickup and time delay is provided for both types of tripping. The nameplate of this device shows the settings which are available. For information on the time-current characteristics of this device, request a copy of TD-6694.

(C) See Table 1 for complete list of Electro-Mechanical overcurrent trip devices available.

Power Shield™ Solid State Overcurrent Trip Devices Type K-3000S and K-4000S Circuit Breakers

(See Figure 12)

This device includes the power supply sensors, overcurrent sensors, Power Shield solid state logic assembly, magnetic latch and the interconnecting wiring. Each phase of the circuit breaker has a power supply sensor and overcurrent sensor. The trip elements that are available are: long-time delay, instantaneous, short-time delay and ground fault. On a 3-phase 4-wire system, an additional remote sensor, mounted in the neutral bus, is required for complete ground fault protection.

The logic assembly is mounted near the front of the circuit breaker and with the cubicle door open the overcurrent control panel is readily accessible. This device must be properly set, as required by individual circuit conditions, to provide adequate protection for an electrical system. The movable plugs on the control panel provide independent control of the long-time, short-time, instantaneous and ground fault pickup and amount of time delay. The overcurrent device, with the exception of ground fault, will trip at the value of the AMPERE TAP setting times the plug setting of the various pickup elements. The ground fault trip value will be the plug setting value times 100, as indicated on the nameplate.

(A) Type SS-3. This trip device is for general purpose application. It provides long-time delay tripping on moderate overcurrents, which are above the long-time pickup settings, and instantaneous tripping on fault currents above the instantaneous trip setting. For information on the time-current characteristics of this device, request a copy of TD-

6966 (TD-9001*).

(B) Type SS-4 Selective Overcurrent Trip Device. This trip device, for selective tripping application provides long-time delay and short-time delay tripping. For information on the time-current characteristics of this device, request a copy of TD-6967 (TD-9002*).

(C) Type SS-5 Triple-Selective Overcurrent Trip Device. This device includes the trip elements found in both the SS-3 and SS-4; i.e., long-time delay, short-time delay, and instantaneous tripping. For information on the time-current characteristics of this device, request a copy of TD-6967 (TD-9002*).

(D) The above three solid state overcurrent trip devices are available with ground fault protection and are designated by the types SS-3G, SS-4G and SS-5G. For information on the time current characteristics of this feature, request a

copy of TD-6968 (TD-9005*).

(E) See Table 1A for a complete list of standard Solid State overcurrent trip devices.

Control Relay

This device is contained in the black insulated molding, 3" X 5" X 6" approximate, located at the lower front of the mechanism and is used on all electrically operated mechanisms. The 52Y coil, and contacts 52Y/1,52Y/2 are connected as shown in the schematic diagram, Figure 2. The purpose of this device is to require that, if the remote or local close contacts are closed, resulting in the charging springs discharging, the close contacts must first be released (opened) before the breaker can be reclosed. This prevents closing the breaker more than one time unless the close contacts are first released.

TABLE 1
 STANDARD ELECTRO-MECHANICAL OVERCURRENT TRIP DEVICES

Overcurrent Device Type	Trip Element			Time-Current Characteristic Curve
	Long-Time	Short-Time	Instantaneous	
OD-300	X		X	TD-6693
OD-400	X	X		TD-6694
OD-500	X	X	X	TD-6695
OD-600	X		X	TD-6695
OD-700			X	None
OD-800			X	None
OD-900		X	X	TD-6698
OD-1000		X		TD-6699

NOTE: OD-300 long-time delay element has one time delay band only. All other long-time & short-time delay elements have three time delay bands.

TABLE 1A
 STANDARD SOLID STATE OVERCURRENT TRIP DEVICES

Overcurrent Device Type	Trip Element				Time-Current Characteristic Curve	
	Long-Time	Short-Time	Instantaneous	Ground	Device in RED CASE	Device in GRAY CASE*
SS-3	X		X		TD-6968	TD-9001
SS-3G	X		X	X	TD-6968 TD-6968	TD-9001 TD-9005
SS-4	X	X			TD-6967	TD-9002
SS-4G	X	X		X	TD-6967 TD-6968	TD-9002 TD-9005
SS-5	X	X	X		TD-6967	TD-9002
SS-5G	X	X	X	X	TD-6967 TD-6968	TD-9002 TD-9005

NOTE: Time-current characteristic curves are not included in this book because separate coordination curves are normally provided with each order. When field calibration is performed, necessary instruction books (refer to page 15) will be provided and will include all pertinent timing information.

Auxiliary Switches

The auxiliary switches (24, Figure 1) contain the "a" and "b" contacts (Figure 2) and are furnished in 4 or 8 contact arrangements. They are mechanically interconnected with the main breaker contacts such that, with the breaker closed, the "a" contacts are closed. With the circuit breaker open, the "b" contacts are closed.

Undervoltage Trip Device

The electrically reset undervoltage trip device is a single-phase device which automatically trips the circuit breaker when its supply voltage decreases to 30 to 60 percent of the rated voltage. This device may be furnished either for instantaneous trip operation or with adjustable time delay tripping of 0-15 seconds. The undervoltage trip device is an integral unit which may be added to the circuit breaker either at the factory or in the field.

The undervoltage device may be connected so that the automatic trip indicator (Figure 1, Item 9) will protrude from the front plate when the breaker is tripped by the undervoltage device.

See Table 4, page 16, for electrical characteristics.

INSTALLATION, INITIAL TESTING AND REMOVAL (Drawout & Stationary)

CAUTION CAUTION CAUTION CAUTION

FOR SAFETY: WHEN INSTALLING OR REMOVING STATIONARY BREAKERS, THE SUPPLY FOR PRIMARY AND CONTROL CIRCUITS MUST BE DE-ENERGIZED

AT ALL TIMES. TESTING OF STATIONARY BREAKERS MUST BE DONE WITH THE PRIMARY SUPPLY CIRCUIT DE-ENERGIZED.

For initial installation of drawout breakers in the "CONNECTED" position, the supply for the primary circuit should be de-energized. Testing of the drawout breaker must be done in the test position.

NOTE: (K-3000 and K-4000 Circuit Breakers) Prior to inserting the circuit breaker into the switchboard and with the breaker in the upright position, exercise the three long time armatures (1" wide armatures) several times until resistance to motion has increased, indicating that the oil dashpot is functioning properly. Improper operation can result because the circuit breaker is shipped or stored on its back. This causes the oil in the dashpot to be displaced and an air bubble can be trapped under the piston. The exercise removes the air to permit proper operation.

INSTALLATION (Drawout Type)

(See Figure 1)

The circuit breaker must be in the "OPEN" position, the racking crank (13) when inserted in opening (17) is rotated counterclockwise until the racking cam roller (16) is rotated down into a 45° angle, and the motor disconnect switch (10) for electrically operated circuit breakers is in the "OFF" position, **NOTE:** Lever (15) must be pushed down to permit the rotation of crank (13).

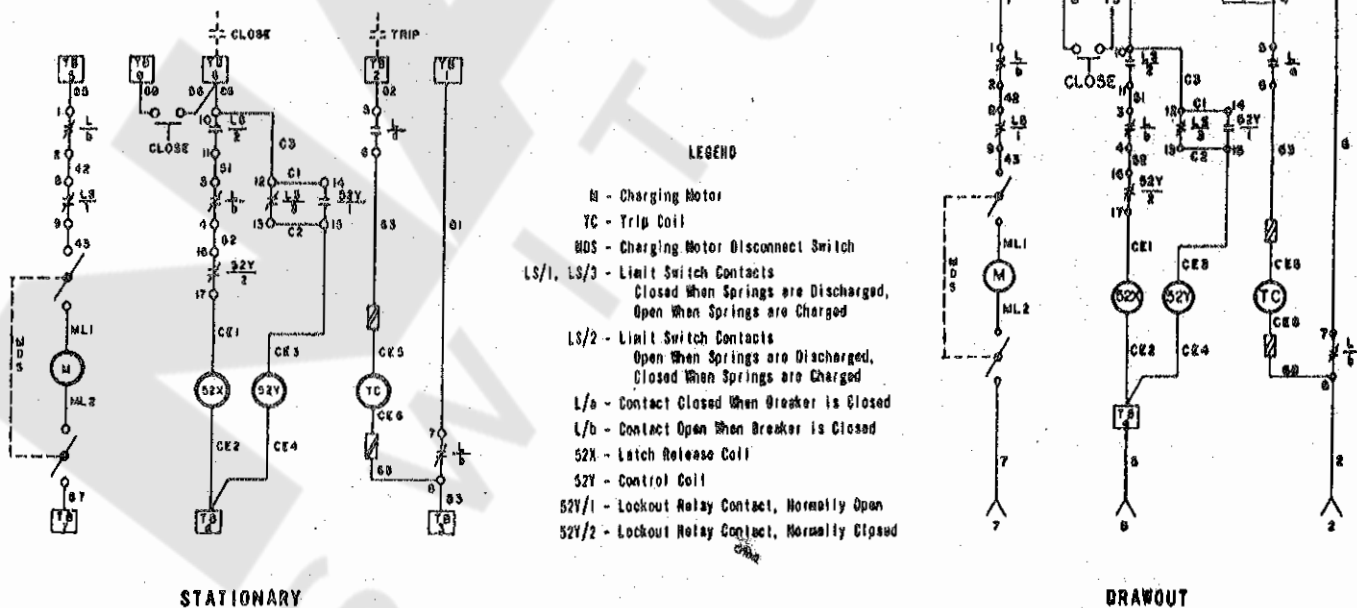


Fig. 2 — Typical Schematic Diagram of Control Circuit

Open compartment door and lower the right and left hand tracks to fully extended position.

Use lifting yoke (20, Figure 1), which is inserted in holes in the upper rear frame, and lower circuit breaker wheels (18) onto track extensions. Remove lifting yoke.

Push circuit breaker into compartment until racking cam rollers (16) stop against their guides.

CAUTION CAUTION CAUTION CAUTION

RAISE TRACK EXTENSION INTO COMPARTMENT BEFORE RACKING.

Insert racking crank (13) into opening (17) and depress drawout lever (15). Turn crank clockwise until automatically stopped. Breaker is now in "DISCONNECT" position. An arrow on the left side of plate (26) will also line up with "DISCONNECT" on the cradle.

Again depress drawout lever (15) and turn crank clockwise until automatically stopped. Breaker is now in "TEST" position.

INSTALLATION (Stationary Type)

Lifting yoke (20) should be used to move the breaker to the switchboard; however, other handling means will be required to move the breaker into position inside the switchboard.

CHECKING CIRCUIT BREAKER OPERATION IN "TEST" POSITION (Electrically Operated, Drawout Type)

(See Figure 1)

- Manually reset automatic trip indicator (9) if it protrudes approximately 1/2 ". Push in to reset.
- Turn motor disconnect switch (10) to "ON" position and closing springs will automatically charge.
- Close circuit breaker by local close button and trip by local trip button.

NOTE: All breakers have a manual trip button. The local close button for electrical breakers is standard. The local trip button for electrical breakers is optional.

- Close and trip circuit breaker by means of remote control switch.
- Check each auxiliary device for proper operation.

CHECKING CIRCUIT BREAKER OPERATION IN "TEST" POSITION (Manually Operated, Drawout Type)

(See Figure 1)

- Manually reset automatic trip indicator (9) if it protrudes approximately 1/2 ". Push in to reset.
- Charge and close circuit breaker; See "Manual Closing Operation" below.
- Trip by manual "TRIP" button (8).
- Check each auxiliary device for proper operation.

CHECKING CIRCUIT BREAKER OPERATION IN "CONNECTED" POSITION (Drawout Type)

After completing check procedures in "TEST" position, continue as follows:

With circuit breaker in "OPEN" position and motor disconnect switch (10) in "OFF" position, insert racking crank (13) in opening (17) and press down drawout lever (15). Rotate the racking crank clockwise until lever (15) moves up and cranking is automatically stopped. Breaker is now in "CONNECTED" position. Excessive cranking force indicates misalignment or interference of parts.

CHECKING CIRCUIT BREAKER OPERATION (Stationary Type)

Follow the same procedure as for drawout circuit breaker, except the circuit breaker will be in the "CONNECTED" position. Primary supply circuit must be de-energized.

MANUAL CLOSING OPERATION

The following manual closing procedures are recommended: (See Figure 1)

- Observe circuit breaker conditions on control escutcheon.
- If closing springs are discharged, manually charge closing springs by means of the manual charge lever (12) then pull the manual close lever (6) by a lanyard from a safe distance.
- If springs are charged, pull the manual close lever (6) by means of a lanyard from a safe distance.
- For partially charged closing springs, should closing not occur upon pulling the manual close lever, continue charging until closing springs are completely charged (heard to snap) and by visual indicator (14), then pull manual close lever (6) by means of a lanyard from a safe distance.

CIRCUIT BREAKER REMOVAL (Drawout Type)

(See Figure 1)

- Trip circuit breaker by any tripping means.
- Open front compartment door.
- Engage racking crank (13) in opening (17) and push drawout lever (15) down. Rotate racking crank counterclockwise until racking mechanism automatically stops at "TEST" position. Lower track extensions.
- Repeat step "C" to rack circuit breaker to "DISCONNECT" position.
- Depress drawout lever (15) and continue cranking counterclockwise as far as stops will allow. (Do not force beyond stops.)
- Pull circuit breaker forward to fully extended position. (Should the circuit breaker be charged, closing springs will automatically be discharged at this point.)
- Remove circuit breaker from tracks with lifting yoke, then raise tracks into compartment and close door.

MAINTENANCE AND ADJUSTMENTS SAFETY NOTES**WARNING WARNING WARNING WARNING**

DE-ENERGIZE BOTH PRIMARY AND CONTROL CIRCUITS BEFORE MAKING ANY INSPECTIONS, ADJUSTMENTS OR REPLACEMENTS OF PARTS. MAKE CER-

TAIN BREAKER IS OPEN BY OBSERVING INDICATOR (5, FIGURE 1), AND CLOSING SPRINGS ARE NOT CHARGED BY OBSERVING INDICATOR (14, FIGURE 1).

When it is necessary that the charging springs be charged, or the circuit breaker be closed, make sure to stay clear of operating parts.

Stationary breakers should be checked for operation with the control circuit energized and the primary power de-energized. Drawout breakers should be withdrawn to "TEST" position for checking the breaker operation. For further inspection, adjustments, cleaning or replacement of parts, the drawout circuit breaker should be withdrawn and moved to a suitable area.

Stationary breakers should likewise be removed, but, if removal is not possible, then the primary and control circuit sources MUST BE DE-ENERGIZED.

PERIODIC MAINTENANCE INSPECTION

The safety and successful functioning of the connected apparatus depends upon the proper operation of the circuit breaker. Therefore, it is recommended that a maintenance program be established that will provide for a periodic inspection of the circuit breaker after 250 no load or load current switching operations.

If 250 operations are not completed in the first year of service, the circuit breakers should be inspected regardless. The circuit breaker should also be inspected after a short circuit or severe overload interruption, regardless of time period or number of operations.

Where unusual service conditions, as covered by ANSI C37.13, exist, it must be assumed that these conditions were considered at the time of order; that the equipment supplied was designed for the special application; and that an appropriate supplemental maintenance program has been developed. These maintenance instructions only cover circuit breakers used under the Standard's normal service conditions.

The inspection should include opening and closing the circuit breaker electrically and manually. The unit should be visually inspected for loose or damaged parts. Arc chutes, contacts and insulation structure should be inspected as described below.

ARC CHUTES

If the circuit breaker has a solid state overcurrent trip device, it is necessary to remove two 1/4" diameter screws fastening the solid state control assembly, so that the control assembly can be moved to permit removal of the arc chute.

a. Remove two arc chute mounting screws (3, Figure 1) and retainer molding (2). Lift arc chute (1) up and draw out.

b. Inspect for breakage to side moldings, center moldings, arc plates and liner plates. Check for presence of foreign particles such as chips of moldings and metal.

INSULATION STRUCTURE

Insulated parts should be checked for damage. Dust and dirt should be removed by air or wiped with a clean lintless cloth. Do not use any oil base solvents. Spray solvents vary as to type and must not be used. The moldings at the rear of the breaker must be kept clean to avoid dielectric problems. Wipe dust away and blow out with clean, dry, compressed air. Additional steps must be taken if dust accumulation continues to be a problem.

CONTACTS

a. Remove dirt or grease on contacts with a clean, lintless cloth.

b. Discoloration of the main contacts does not necessarily indicate damage. However, this condition may be removed by opening and closing the circuit breaker under no-load conditions.

CONTACT PITTING

a. A moderate amount of pitting will not interfere with the operation of the arcing contacts.

Should it be necessary to dress the arcing contacts to remove small burrs, cover the mechanism with a cloth. Follow the contour of the contacts with light wipes of a fine file and do not attempt to eliminate pitting entirely. When finished, remove cloth and wipe off any remaining dirt or filings. Do not use emery cloth or the like for sanding contacts. The material deposits affect continuous current ability adversely.

b. Should the main contacts show more than moderate pitting, check the contact pressure.

CONTACT PRESSURE CHECK AND ADJUSTMENT

Jaw Type Arcing Contacts (See Figure 3A)

FOR SAFETY: Keep clear of breaker parts during this operation.

a. Close the breaker. Lever (15, Figure 1) must be in the up position.

b. For each set of eight contacts on one pole, the smallest gap "A" should be .100-.105 inch. If adjustment is required, loosen lock screw (2). Turn adjustment screw (1) until .100-.105 is obtained on the smallest gap of the eight contacts. Repeat this for the other two poles.

Tighten lock screw (2).

Note that if an adjustment is necessary for "simultaneous" make, the contact pressure will increase on those adjusted poles. Thus, a dimension of more than the ranges listed above indicates more contact pressure, which is acceptable.

For Earlier Model Circuit Breakers Furnished with Butt Type Arcing Contacts (See Figure 3)

FOR SAFETY: Keep clear of breaker parts during this operation.

- a. Close the breaker. Lever (15, Figure 1) must be in the up position.
- b. For each set of eight contacts on one pole, the smallest gap "A" should be .090-.095 inch. If adjustment is required, loosen lock screw (2). Turn adjustment screw (1) until .090-.095 is obtained on the smallest gap of the eight contacts. Repeat this for the other two poles.

c. Slow close the breaker (see "Manual Slow Close to Check Contact Pressure" below) until the first arcing contact of the three poles just touches and hold in this position. Adjust the other two poles, screw (1), until the leading arcing contacts of each pole make simultaneously within 1/32 inch.

Tighten lock screw (2).

Note that if an adjustment is necessary for "simultaneous" make, the contact pressure will increase on those adjusted poles. Thus, a dimension of more than the ranges listed above indicates more contact pressure, which is acceptable.

MANUAL SLOW CLOSE TO CHECK CONTACT PRESSURE (See Figures 1, 3 and 4)

- a. Remove arc chutes (1).
- b. If the circuit breaker closing springs are discharged as seen by the spring charged indicator (14), engage the manual charge handle (12) with the charging lever (7). Pump charging lever until the circuit breaker closing springs are heard to snap into the charged position.
- c. Remove screw (19), shift the shutter (4) to the left and insert the spring retainer bracket (11) so that its tips fit into the closing springs and its flanges fit into the holes in the closing spring guides.

NOTE: On drawout breakers, shutter (4) cannot be opened unless breaker drawout mechanism is in the "DISCONNECT", "TEST" or "CONNECTED" position. The drawout lever (15) cannot be operated when shutter (4) is open.

- d. Use a stick to hold the spring retainer bracket (11) toward the front of the breaker and in place while pulling the manual close lever (6) to discharge the closing springs. (This will partially close contacts.)
- e. Insert the manual charge handle (12) into the charging lever socket and pump to slow close the circuit breaker to the required amount.

f. To remove the spring retainer bracket (11), push the manual trip button (8) to trip the circuit breaker. Continue pumping until closing springs are again heard to snap. Then remove spring retainer bracket.

9. The circuit breaker is now charged and ready to be closed.

h. To discharge closing springs, pull the manual close lever

- (6) and push manual trip button (8).
- i. Put arc chutes (1) back on.

OPERATING MECHANISM

The circuit breaker mechanism is adjusted at the factory for correct operation and should not be disturbed unless necessary.

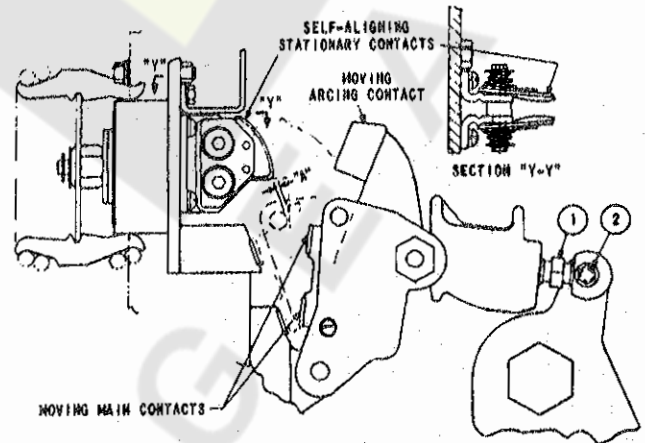


Fig. 3A — Contact Pressure Check and Adjustment

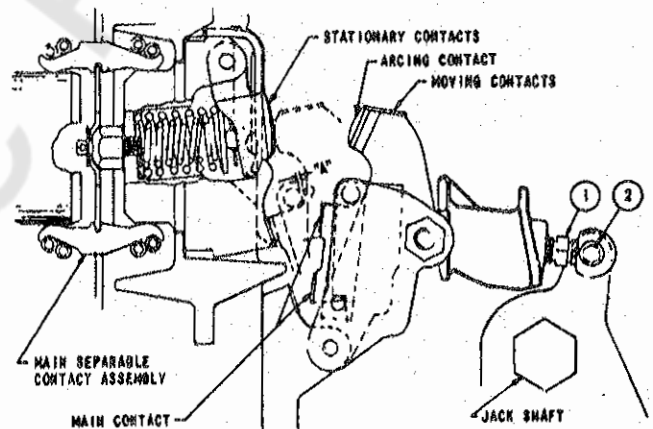


Fig. 3 — Contact Pressure Check and Adjustment

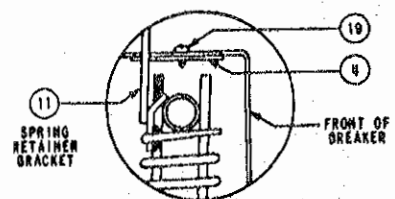


Fig. 4 — Shutter Detail

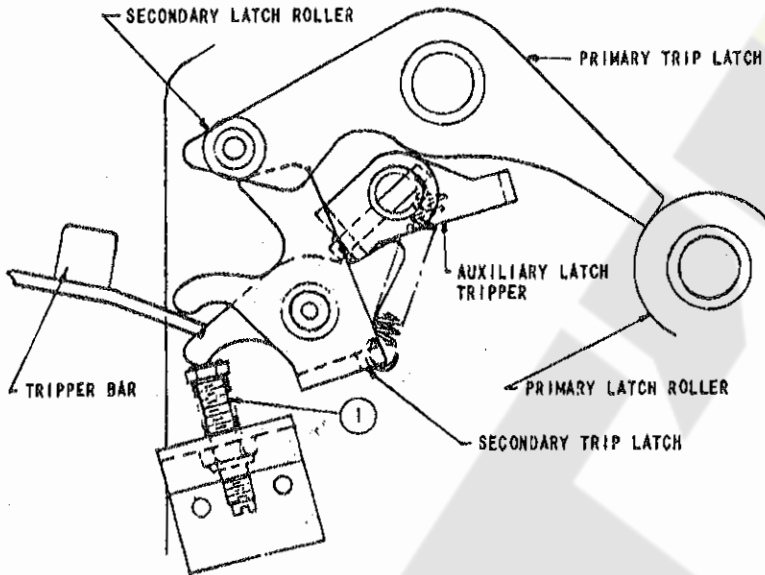


Fig. 5 — Primary Trip Latch Adjustment

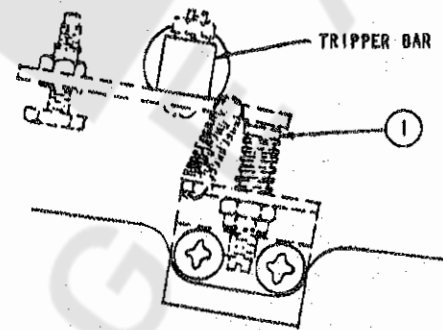


Fig. 6 — Tripper Bar Tripper Adjustment

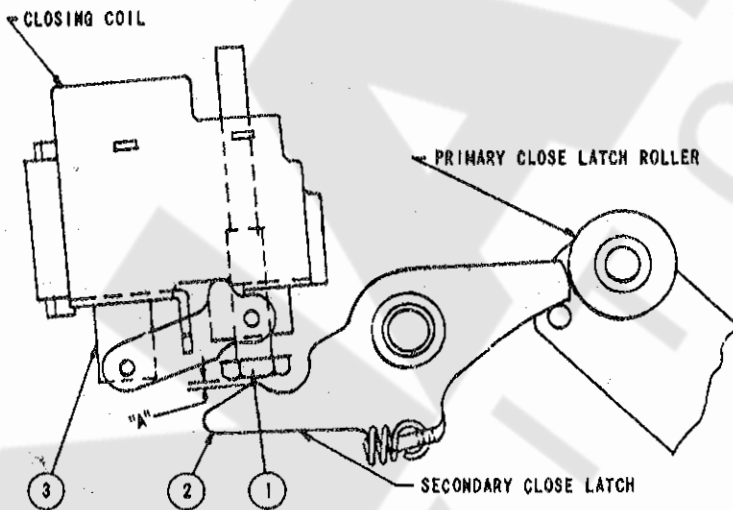


Fig. 7 — Primary Close Latch Adjustment

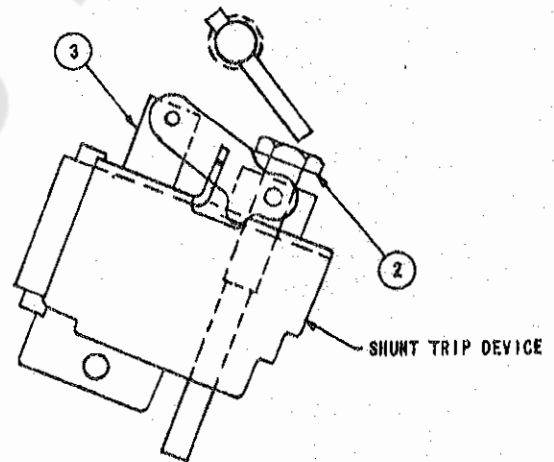



Fig. 8 — Shunt Trip Device Adjustment

FOR SAFETY: Keep hands clear of all moving parts. Serious injuries can result if a person comes in contact with breaker parts when the breaker is being opened or closed, or closing springs are being charged or discharged. Use extension tools for manipulating breaker parts. If field testing indicates breaker malfunction, the following items may be checked.

Primary Trip Latch

Figure 5 shows the arrangement necessary for the breaker to be in the closed position. The spring holds the secondary trip latch down against screw (1). The secondary trip latch holds the secondary latch roller up, which in turn holds the opposite end of the primary trip latch down. This prevents the primary latch roller from moving to the left and opening the breaker. If none of the various trip devices are acting on the tripper bar or the auxiliary latch tripper to open the breaker or to prevent the breaker from closing and the breaker still will not close, then the following adjustment should be made.

- a. Turn screw (1) down to insure that secondary trip latch will hold the secondary latch roller up.
- b. With the breaker closed, turn up on screw (1) until the breaker trips.
- c. Turn screw (1) down two turns.

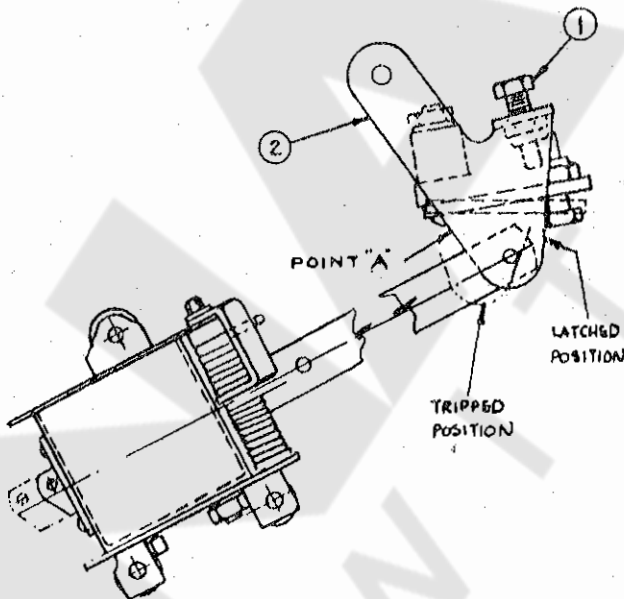

**Fig. 9 — Magnetic Latch Trip Adjustment
 Type K-3000S and K-4000S Circuit Breakers**

Tripper Bar Adjustment (Figure 6)

To insure that tripper bar and tripper is in the correct position with the secondary trip latch, check and adjust as follows:

- a. Turn screw (1) down to make certain the tripper will not trip out the breaker.
- b. With breaker closed, turn screw (1) up until the breaker trips,
- c. Turn screw (1) down 2 3/4 turns.

Primary Close Latch (See Figure 7)

a. With the circuit breaker closing springs charged and breaker contacts opened, the closing plunger (3) in de-energized position, there should be a 1/16" air gap between the rod (1) and the secondary latch (2) at point "A". Turn rod (1) for 1/16" dimension.

Shunt Trip Device (See Figure 8)

- a. Turn trip rod (2) down until circuit breaker does not trip with plunger (3) held down.
- b. Close circuit breaker.
- c. Push plunger (3) down as far as possible and hold in this position while turning up trip rod (2) until circuit breaker just trips.
- d. Turn rod (2) up 2 1/2 to 3 turns.

Magnetic Latch Device (Type K-3000S, K-4000S) Trip Adjustment (Refer to Figure 9)

1. Turn adjusting screw (1) out as far as possible so that the circuit breaker will not trip when the magnetic latch trips.
2. Remove the terminal block cover on the solid state assembly by removing two lower screws (Fig. 12). Disconnect two wires at terminals 15 and 16.
3. Close the circuit breaker.
4. While lightly pushing at point "A" so that the lever (2) does not move through its full stroke and trip the circuit breaker, momentarily apply the voltage (3 V) from two dry cell batteries, size "D", to the two wires (+ to wire 16, — to wire 15) that were disconnected in operation 2. The magnetic latch should trip.
5. Gradually release the hold on lever (2).
6. While holding the lever (2) in the tripped position, turn in on screw (1) until the circuit breaker just trips, then turn in one additional turn.
7. Replace wires 15 and 16 and the terminal block cover.

ELECTRO-MECHANICAL OVERCURRENT TRIP DEVICE ADJUSTMENTS

Short Time Delay Adjustment (See Figure 11)
(OD Types 400, 500, 900, 1000).

Push the short time lever to rear of breaker and slide the lever to the desired band. Make sure the lever pin drops into the pin hole.

Long Time Delay Band Adjustment (Figure 10)
(OD Types 400, 500, 600).

To reset long time delay to a different band, first loosen the locking screw for long-time delay adjustment approximately one turn. Turn the adjusting knob until the pointer lines up with the desired line marked "Minimum Time", "Instantaneous Time" or "Maximum Time". Retighten the locking screw.

NOTE: OD-300 has only one long-time delay setting; therefore resetting is not required.

Pick-Up Setting Adjustments (Figure 10)

Pick-up settings may be changed by turning the appropriate adjusting screw until the moving indicator lines up with the desired pick-up point line.

NOTE: The top line corresponds to the top pick-up point, the second line from the top corresponds to the second pick-up point from the top, etc.

Armature Trip Travel Adjustment.

CAUTION CAUTION CAUTION CAUTION

KEEP HANDS CLEAR OF ALL MOVING PARTS. THE CIRCUIT BREAKER WILL TRIP TO THE "OPEN" POSITION WHILE CHECKING OR ADJUSTING THE ARMATURE TRIP TRAVEL.

The overload device trip travel is set at the factory; however, if trip travel readjustment is required due to replacement of overloads or other parts, then readjust as follows:

- a. (See Figure 10.) Back out on the two trip adjusting screws until the screws are engaging the nut by approximately two turns.
- b. Charge springs and close circuit breaker.
- c. Using a one foot long (approximate) stick, push up on long time armature (thick armature) at point "A", and hold it tight against the magnet. Turn in screw marked "Right" until the breaker just trips. Continue to turn the screw in an additional 1 1/2 turns.
- d. Charge springs and close circuit breaker. Push up on the thin armature and adjust the screw marked "Left" using the same procedure as "c" above.
- e. Readjust the trip travel at the other two poles using the same procedure (steps a through d).

Field Testing of Electro-Mechanical Overcurrent Trip Devices

Refer to IB-9.1.7-5 for complete testing of devices.

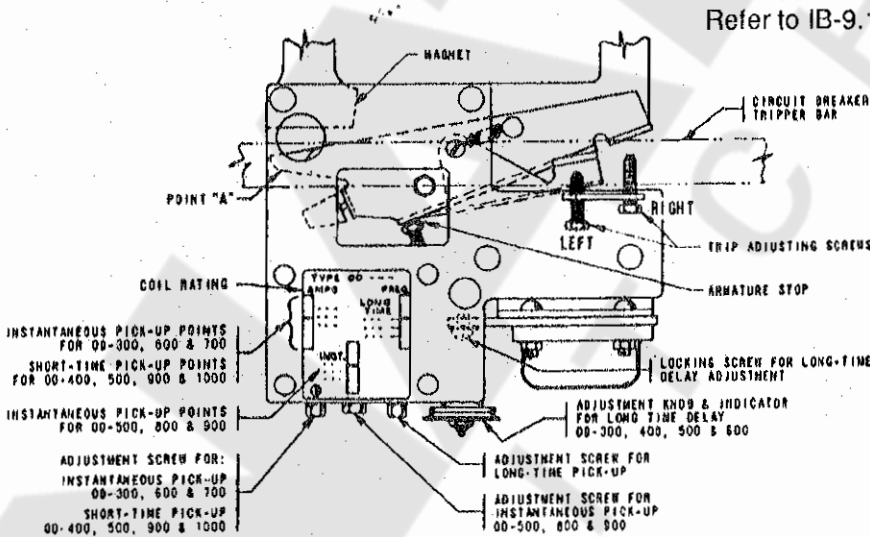


Fig. 10 — Overload Device Adjustments

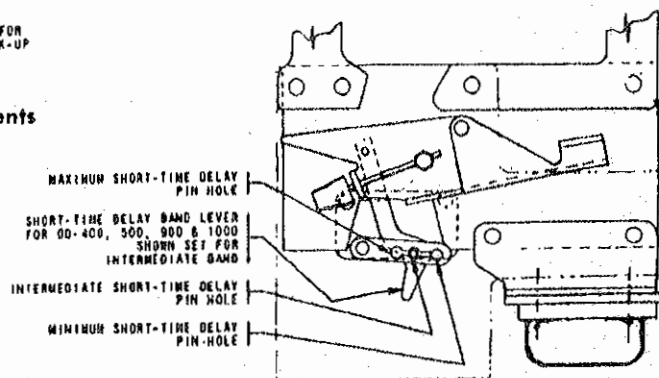


Fig. 11 — Short-Time Delay Band Adjustments

SOLID STATE OVERCURRENT TRIP DEVICE SETTINGS

(See Figure 12)

No adjustments are necessary in selecting trip settings on this trip device. The selector plugs (solid circle) allow flexibility in settings and may be moved from one plug tap to another, consistent, however, with the pickup and time band settings necessary for proper circuit protection. Make certain that the selector plugs are pushed in completely for proper operation. If a plug is left out or not secure, the affected element will trip at the minimum setting shown, for safety, but coordination will be affected.

Field Testing of Solid State Overcurrent Trip Devices


For complete testing of these devices, refer to the following Instruction Bulletins:

IB-9.1.7-21 (Device in RED CASE) IB-9.1.7-22 (Device in GRAY CASE)

LUBRICATION

Only two lubricants are approved for use on the K-Line circuit breaker. Lubricated during final assembly, the K-Line circuit breaker should not require additional lubrication during its service life when applied in accordance with ANSI C37.13. If, however, the breaker is applied in unusual situations defined by ANSI C37.13, has lubrication contaminated with dirt and debris, or has parts replaced, relubrication should be performed as follows:

When mechanism cleaning and relubrication is required, do not spray solvents down through the mechanism to remove old lubricants, dust, and debris.

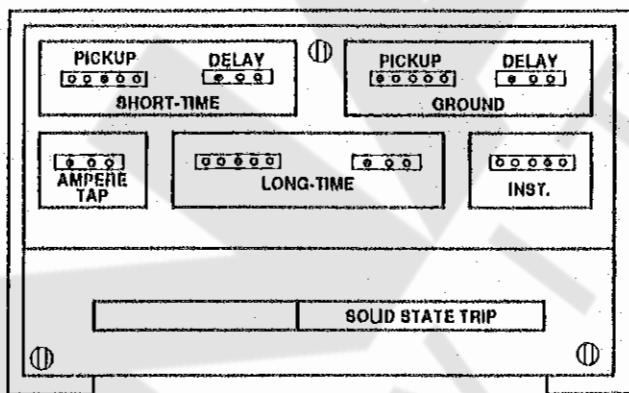

Do not use dichlorodifluoromethane on any part of the circuit breaker. These solvent tend to wash debris into the bearing areas of the breaker, while at the same time removing any existing lubricant. Breaker performance will be compromised when these cleaning techniques are employed.

Proper relubrication requires disassembly, thorough cleaning by wiping, then reassembly using a brush or other means for reapplying the lubricants listed.

1. Apply NO-OX-ID special grade A" grease from Dearborn Chemical Company to all mating surfaces of moving current carrying joints. Do not apply NO-OX-ID grease on any main or arcing contact surfaces. Primary disconnects should be maintained by reapplying NO-OX-ID during maintenance periods. NO-OX-ID is available from Asea Brown Boveri in one pint cans, Number 713222-A00.

2. Apply Anderol 757 synthetic grease manufactured by HULS AMERICA, INC. to mechanism parts, bearings and pins. DO NOT APPLY GREASE TO LATCH OR ROLLER SURFACES. Anderol 757 is available from Asea Brown Boveri in four ounce tubes, part Number 712994-A00.

3. Anderol synthetic lubricant is also available as a spray, Anderol 732. Anderol 732 is useful as a solvent for removing old lubricant, dirt, and debris in the mechanism. It can NOT be used as a substitute for Anderol 757. Please observe the following warnings:

- a. DO NOT apply light machine oil, or thin spray lubricants to lubricate any mechanism part.
- b. DO NOT attempt to relubricate the spring charging motor gearbox. It is sealed and should not require repacking.
- c. DO NOT lubricate magnetic latch device or otherwise clean or spray with any substance.

4. Use only the recommended lubricants. Use of other than approved lubricants can cause breaker misoperation at temperature extremes.

DIELECTRIC WITHSTAND TESTS ON POWER AND CONTROL CIRCUITS

1. Dielectric withstand tests on circuit breakers shall be made to determine the ability of the insulation to withstand overvoltages.

2. A 60-cps alternating sinusoidal voltage (rms) value equal to the specific voltage shall be used. All voltages used in the dielectric withstand test shall be measured in accordance with ANSI Measurement of Voltage in Dielectric Tests, C68.1.

3. Duration Of Test - The dielectric test voltage shall be applied for a period of 60 seconds. The duration of the test may be one second if a voltage 30% greater than that specified is applied.

4. Condition Of Circuit Breaker To Be Tested - Dielectric tests shall be made on a new, completely assembled circuit breaker and not on individual parts. When a circuit breaker is tested in the field or after storage, the test voltage shall be 75% of the value listed in C37.50-3.5.2. (Value shown below.)

5. Temperature At Which Tests Are To Be Made - Dielectric tests shall be made at any temperature between 10 and 55 C

6. Magnitudes And Point Of Application Of Test Voltage - The dielectric test shall be applied as follows:

a. With circuit breaker in open position, apply 2200 volts (1000 volts plus twice 600 volts on new breakers; $0.75 \times 2200 = 1650V$ on breakers that have been in service):

i. Between live parts, including both line and load terminals, and metal parts that are normally grounded.

ii. Between live terminals and load terminals.

b. With circuit breaker in closed position, apply 2200 volts on new breaker and 1650 volts on breakers that have been in service.

i. Between live parts and metal parts that are normally grounded.

ii. Between terminals of different phases.

c. With circuit breaker in either open or closed positions, apply 1500 volts (1125 volt on breakers taken out of service):

Note: Disconnect solid state trip unit, as a precaution.

i. Between control circuit and metal parts that are normally grounded. If the circuit breaker control circuit includes a motor, the motor MUST be disconnected during the dielectric test on the control circuit.

TABLE 2

TEST VOLTAGE TO BE APPLIED FOR ONE MINUTE TO TEST THE ABILITY OF THE INSULATION TO WITHSTAND OVERVOLTAGES

	Breaker Open	Breaker Closed	Breaker Open or Closed
Breaker in Service or After Storage	1650 V ac -- 2300 V dc a. Between terminals and metal parts normally grounded. b. Between line and load terminals.	1650 V ac -- 2300 V dc a. Between terminals and metal parts normally grounded. b. Between phases.	1125 V ac -- 1600 V dc a. Between control circuit and metal parts normally grounded. NOTE: Motor must be disconnected from control circuit for this test.
After Short Circuit	1320 V ac -- 1860 V dc a and b as above	1320 V ac -- 1860 V dc a and b as above	900 V ac -- 1260 V dc a as above

- d. Apply 1000 volts:
 - i. Between leads of new motors.
- e. SPECIAL NOTES:
 - i. Apply 60% of the values given in (a) through (d) above on breakers that interrupted a short circuit.
 - ii. Motors that have been in service may fail dielectric due to a normal accumulation of debris from the commutator. Cleaning the motor will restore dielectric integrity.
 - iii. Do not perform dielectric testing on the solid state trip system.

Current values are average steady-state values. Momentary inrush currents for all charging motors and AC coils are approximately 6 - 8 times these values.

RENEWAL PARTS

Asea Brown Boveri recommends only those renewal parts be stocked that will be required to insure proper and timely maintenance of the breaker.

Refer to Renewal Parts Bulletin RP 6.1.2.8-2 for complete ordering information and parts list.

The minimum quantities of assemblies recommended in the Renewal Parts Bulletin are based on ABB's own tests and statistical information on customer operating experience. The replacement of total assemblies is recommended in the field so that the circuit breaker can be returned to service as quickly as possible. The faulty assemblies can be returned to ABB for reconditioning when that is possible.

ELECTRICAL CHARACTERISTICS OF CONTROL DEVICES

For closing and tripping currents, voltages and ranges, refer to Table 3 below.

For undervoltage trip devices, standard voltages and operating data, refer to Table 4 below.

The ABB service organization and factory personnel can be reached by calling:

Service (215) 669-8887
Factory (803) 665-4144

TABLE 3
ELECTRICAL CHARACTERISTICS OF CONTROL DEVICES
CLOSING AND TRIPPING CURRENTS, VOLTAGES AND RANGES

Type Breaker	Nominal Control Voltage	Average Closing Motor Current Amperes	Shunt Trip Current Amperes	Closing Relay Current Amperes		Closing Circuit Voltage Range	Shunt Trip Circuit Voltage Range	Recommended Control Fuse Size
				Anti-Pump	Release			
K-3000 K-4000 K-3000S K-4000S	120 V ac 60 cycles	10.	10.0	.18	10.0	104 - 127	50 - 127	10 A
	240 V ac 60 cycle	5.	1.84	.075	1.84	208 - 254	208 - 254	10 A
	48 V dc	25.	5.0	.11	5.0	38 - 58	28 - 56	15 A
	125 V dc	10.	2.0	.06	2.0	100 - 140	70 - 140	10 A
	250 V dc	5.	1.0	.03	1.0	200 - 280	140-280	10 A

TABLE 4
UNDervOLTAGE TRIP DEVICE
STANDARD VOLTAGES AND OPERATING DATA

Service Voltage	Current at Rated Volts	Maximum Pickup Voltage	Dropout Voltage Range
120 V ac 60 cycles	0.5	102	36 - 72
240 V ac 60 cycles	0.2	204	72 - 144
480 V ac 60 cycles	0.1	408	144 - 288
48 V dc	0.3	41	15 - 29
125 V dc	0.2	106	38 - 75
250 V dc	0.1	212	75 - 150

INTRODUCTION

The standard solid state trip device on K-3000 and K-4000 is now the MICRO Power-Shield (MPS) microprocessor based trip device. Similar to MPS trip devices available on other low voltage ABB circuit breakers, the MPS trip device uses a single current sensor per pole and a magnetic latch to trip the circuit breaker. This trip device is equipped with long time and various combinations of short time, instantaneous and ground. The MICRO Power-Shield trip system has a tolerance band on long time of minus zero, plus ten percent (-0, +10%) which will allow the circuit breaker to carry its continuous current rating, but provide tripping above that value. Additionally, root mean square (RMS) current calculation on the long time trip element provides tripping based on the true heating value of the current passing through the circuit breaker. Below, the MPS trip device is described more fully. Following that field testing procedures, adjustments and field repair instructions are provided.

SOLID STATE TRIP SYSTEM

The solid state trip system includes the sensors, the MICRO Power Shield solid state trip device, the magnetic latch and the interconnecting wiring. A current sensor is integrally mounted on each phase of the circuit breaker to supply a value of current flowing in the trip unit that is directly proportional to the current flowing in the primary. When the value of the current flowing in the primary exceeds the trip unit settings for a given time, a signal is sent to the magnetic latch causing the circuit breaker to trip. On a three phase, four wire, wye systems, provisions are made for input from a separately mounted sensor to obtain a residual connection of all four (4) sensors for sensitivity to ground currents.

MICRO Power Shield (MPS) Trip Unit (Figure 13)

The MPS trip unit is visible on the front of the circuit breaker on the right hand side. It is completely selfpowered, taking the tripping energy from the primary current flowing through the circuit breaker without the need for any additional power supply. To cope with modern power systems where harmonics in the system can cause cable and busway overheating, the MPS unit calculates the root mean square value of the system current and provides tripping accordingly. Because the true heating value of the current is calculated, cable and busway overheating is avoided with the MPS trip system. This feature is standard on the long time element of all Model V6C and higher MPS trip units.

Protective Elements (Figure 14)

Four basic trip elements within the MPS trip unit perform the protective functions: (1) long-time, (2) short-time, (3) instantaneous, and (4) ground. MPS types with various combinations of these protective elements are shown. Selection of type is dependent upon the protection and coordination requirements for the specific power circuit. The MPS trip unit is completely tested prior to shipment. Since there are no mechanical devices which may have lost adjustment during shipment, no readjustments, other than making required settings, need be made prior to placement in service. The following trip characteristics are available: long-time setting and delay bands; short-time settings and delay bands, with and without an $I^2 t$ characteristic; instantaneous setting; and ground setting and delay bands.

The MPS trip unit must be properly set, as required by the individual circuit, in order to provide the necessary protection. With the transparent cover removed, the rotary switches on the unit faceplate enable independent selection of the long-time, short-time, instantaneous, and ground characteristics as applicable. In addition, as part of the short-time, an $I^2 t$ characteristics response has been included. A two-position switch gives the user the choice of selecting this option.

The MPS trip unit protective elements, with the exception of ground, will cause the circuit breaker to trip at a value equal to the ampere range selector position times the pick-up (threshold) setting of the various protective elements. The ground trip settings are marked on the faceplate in primary amperes.

Ampere Range Selector

The ampere range selector switch provides two settings: fifty percent and one hundred percent of phase sensor rating. This exclusive feature effectively expands all trip element settings, except ground, by a factor of two.

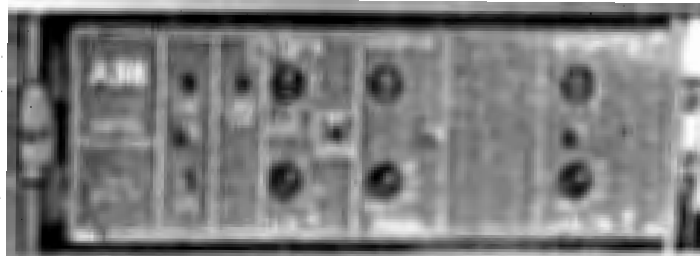


Figure 14 - Available MICRO Power-Shield TRIP UNIT

TYPE	LONG-TIME		SHORT-TIME		INSTANT. SETTING	GROUND		TIME-CURRENT CHARACTERISTIC CURVES		
	SETTING	DELAY	SETTING	DELAY		SETTING	DELAY	OVCT.	I	GROUND
	MPS-3	X	X	---		---	X	---	---	TD9801
MPS-3G	X	X	---	---	X	X	X	TD9601	---	TD9803
MPS-4	X	X	X	X	---	---	---	TD9602	TD9604	---
MPS-4G	X	X	X	X	---	X	X	TD9602	TD9604	TD9603
MPS-5	X	X	X	X	X	---	---	TD9602	TD9604	---
MPS-5G	X	X	X	X	X	X	X	TD9602	TD9604	TD9603

Targets

Operation indicators (targets) are provided as standard on all types of MPS trip units. One indicator is provided for each of the protective trip elements included (long-time, short-time, instantaneous, and ground). Therefore, a maximum of four targets will be supplied based on the total number of trip elements in the particular trip unit. When a trip occurs, the target for the trip element which was responsible for tripping the circuit breaker will display the color orange. The target will retain its position despite shock or vibration as long as the breaker remains open. The target will reset automatically within two seconds after the circuit breaker is closed and the sensors detect current flow through the circuit breaker. Upon closing, if there is a trip condition, the target will reset instantly and a new target will display corresponding to the trip element which caused the trip condition.

AVAILABLE SETTINGS

Ampere Range Selector Switch (Figure 15)

The ampere range selector switch has two positions. The maximum setting corresponds to the rating of the phase sensor. The minimum setting corresponds to fifty percent of the phase sensor rating.

WARNING WARNING WARNING WARNING

WHEN MAKING LONG-TIME, SHORT-TIME, INSTANTANEOUS, AND/OR GROUND SETTINGS, THE ROTARY SWITCH MUST BE IN THE DETENT ADJACENT TO THE SETTING ON THE TRIP SYSTEM FACEPLATE. IF THE ROTARY SWITCH IS NOT IN THE DETENT, THE MISDETENTED TRIP ELEMENT IS AUTOMATICALLY SET AT ITS LOWEST SET POINT. THIS APPLIES TO THRESHOLD SETTINGS AND TIME DELAY SETTINGS.

Figure 15 - Current Sensors and Circuit Breaker Settings

SENSOR RATING	AMPERE RANGE SELECTOR SETTINGS	GROUND PRIMARY AMPERES, SETTING	AVAILABLE ON CIRCUIT BREAKER TYPES
3000	1500, 3000	500, 600, 800, 900, 1000, 1200	K-3000M, K-4000M
3200	1600, 3200	500, 600, 800, 900, 1000, 1200	K-3200M, K-4000M
4000	2000, 4000	500, 600, 800, 900, 1000, 1200	K-4000M

Long-Time

The long-time setting may be 0.5, 0.6, 0.7, 0.8, 0.9, or 1.0 times the ampere range selector setting. Three long-time delay bands are provided. The three bands are labeled MAX (maximum), INT (intermediate), and MIN (minimum).

Short-Time

The short-time setting may be 2, 3, 4, 6, 8, or 10 times the ampere range selector setting. Three short-time delay bands are provided: MAX (maximum), INT (intermediate), and MIN (minimum). A two-position switch is provided to select an 1st type response. The switch when placed in the OUT position selects the normal current characteristic curve. By placing the 1st switch in the IN position, the 1st current characteristic curve is selected.

Instantaneous

The instantaneous setting may be 3, 4, 5, 7, 10, or 12 times the ampere range selector setting.

Ground (Figure 15)

The available ground settings vary with the phase sensor rating. These settings are marked on the faceplate in primary amperes. Three ground fault display bands are provided: MAX (maximum), INT (intermediate), and MIN (minimum). The time current delay bands of the ground elements include an I^2t characteristic that is a permanently programmed feature. Unique circuitry of the MPS trip unit responds to low level arcing faults by summing the erratic currents associated with arcing, then providing a trip when that sum is above the trip threshold for a preprogrammed period of time.

Self Monitoring

A continuous monitoring of the microprocessor function is provided consisting of a red Light Emitting Diode (LED) mounted in the faceplate. When primary current is approximately six percent of the sensor rating, the LED will blink approximately one time per second. The LED does not blink at current level below 6%. Servicing is required if the LED remains lit, but does not blink, or does not illuminate at all current levels above 6%.

Making Settings

The settings of current threshold and delay bands must be determined by an analysis of the protection and coordination requirements of the power system. The ampere range selector and the short-time 12t switch are two-position switches on the MPS trip unit. All other settings are made by means of six position rotary switches. The long-time, short-time, and instantaneous trip element thresholds are multiple of the ampere range selector setting. The ground trip value in primary amperes is selected directly by its rotary switch setting. An example of settings:

4000 Amp circuit breaker with 4000 Amp sensor

Long-time setting required: 3200 amperes.

Instantaneous setting required: 20,000 amperes.

Ground setting required: 1000 amperes.

1. Set AMPERE RANGE SELECTOR at 4000 amperes.
2. Set LONG-TIME SWITCH at 0.8 setting - $(0.8 \times 4000 = 3200)$.
3. Set INSTANTANEOUS SWITCH at 5 setting - $(5 \times 4000 = 20,000)$.
4. Set GROUND SWITCH at 1000 setting.
5. Set DELAY BANDS required for coordination.

WARNING WARNING WARNING WARNING

Rotary switches must be positioned in the detent when making pickup and time delay settings. There are NO intermediate settings between detents. Failure to position the rotary switch in the detent will automatically reset the misdetented trip element to its lowest pickup value or time delay for the misdetented relay rotary switches.

Testing

A test set designated type 606 and designed specifically for use with the MPS trip system is available. Refer to IB 6.1.1.7-4. Primary current injection is covered below.

A test function switch in the faceplate is provided for testing only with the type 606 test set.

WARNING WARNING WARNING WARNING

WHEN USING PRIMARY CURRENT TO TEST THE MICRO Power-Shield TRIP SYSTEMS EQUIPPED WITH THE GROUND TRIP FUNCTION, THIS FUNCTION MUST BE DEFEATED IN ORDER TO TEST THE OTHER TRIP ELEMENTS. A SPECIAL GROUND DEFEAT TEST CABLE (PART 712918-T09) MUST BE USED. THE CABLE IS INSERTED TEMPORARILY IN THE CIRCUIT CONNECTING THE TRIP UNIT AND THE CIRCUIT BREAKER. FAILURE TO USE THE GROUND DEFEAT TEST CABLE CAN RESULT IN DAMAGE TO THE MICRO Power-Shield TRIPPING SYSTEM. CALL THE NEAREST ASEA BROWN BOVERI DISTRICT OFFICE TO ORDER EITHER THE GROUND DEFEAT TEST CABLE (PART 713918-T09) OR THE D.E.S.P. TEST CABLE (PART 713918-T10).

PROCEDURE FOR FIELD TESTS ON K-LINE CIRCUIT BREAKERS

MPS Solid State Trip System testing

There are two ways to evaluate the MICRO Power-Shield solid state trip system. A secondary current injection test set, the type 606 MPS tester, has been designated specifically for use with the MPS box. This tester simulates the current from the current sensor and allows evaluation of the MPS solid state box and magnetic latch. Used in conjunction with the TEST FUNCTION selector switch on the MPS box, the type 606 tester can be used to evaluate long-time, short-time, instantaneous, and ground with or without maglatch. The full range of the circuit breaker frame sizes can be evaluated with the 606 tester. To obtain a tester, call the nearest Asea Brown Boveri sales office and ask for part 714516-T01. Refer to Bulletin 6.1.1.7-4, which was written for the 606 test set.

The other method of evaluating the MPS solid state trip system is by primary current injection using the primary current injection test set. This method allows evaluation of the sensors, MPS solid state box, magnetic latch and interconnecting harnesses. Below is a procedure for performing this field test.

Primary Current Testing - MICRO Power-Shield Type MPS

Notes:

1. Refer to time current curves TD-9601, TD-9602, TD-9603, TD-9604.
2. When checking calibration, set functions not being tested at their highest threshold value.
3. On MPS trip units equipped with ground, the ground trip must be defeated by using a special cable assembly, part number 713918-T09. This assembly is installed between the solid state box and the breaker wiring harness. Failure to use this harness will prevent primary current testing of the long-time delay function.
4. The TESTING FUNCTION selector switch on front of the MPS solid state box operates only with the optional Type 606 secondary current injection test set. The position of this switch has no influence during primary current injection tests.
5. The closing springs must be charged and the circuit breaker closed before each test below.

Instantaneous Threshold Test

1. Position the other trip elements selectors at their highest threshold value.
2. Position trip system Range Selector in the desired position, either full or one-half breaker sensor rating.
3. Put instantaneous selector switch in the four times (4X) setting.
4. Test for the actual threshold by increasing test set current until the breaker trips.
5. The threshold tolerance is +/-10% on all selector switch settings.
6. Instantaneous times cannot be accurately measured with primary current test sets. Such times can only be measured with oscillographic equipment. Percent error in the timer and meter of primary current test sets can make it appear that the instantaneous does not fall inside its band.

Long-Time Delay Test

1. Position the other trip element selectors at their highest threshold value.
2. Position Range Selector in desired position.
3. Put long-time selector in the one times (1 X) setting.
4. Set test set current so that current through the breaker is three times (3X) trip system Range Selector setting. Times should be as follows:

MPS 3	NRL	8 - 12 SEC
MPS 4	TR	10 - 15 SEC
MPS 5	WAT	87 - 100 SEC

Short-Time Delay Test

1. Position the other trip element selectors at their highest threshold value.
2. Position Range Selector in desired position. To prevent stress on the solid state components, however, the lower position is recommended.
3. Put 1st switch in the OUT position.
4. Put short-time selector in the two times (2X) setting.
5. Set test set current so that current through the breaker is four times (4X) trip system Range Selector Setting. Times should be as follows:

MPS 4 & MPS 5 WITHOUT ITC	MIN	0.700 - 0.700 SEC.
	INT.	0.300 - 0.300 SEC.
	MAX.	0.150 - 0.150 SEC.

6. Put 1st switch in the IN position.
7. Set test set current so that current through the breaker is 1.5 times the two times (2X) trip system Range Selector setting. Times should be as follows:

MPS 4 & MPS 5 WITH ITC	MIN	0.750 - 0.750 SEC.
	INT.	0.500 - 0.500 SEC.
	MAX.	0.250 - 0.250 SEC.

4. Put the ground trip selector in the minimum available ground setting (100A on 200A and 800A sensors, 300A on 1600A through 2500A sensors, and 500A on 3000A through 4200A sensors). Device nameplate has actual current values on ground trip available.

5. Set test set current so that current through breaker is three times (3X) the minimum setting selected in (4) above. Time should be as follows:

6. On breakers with 4-wire ground and 4-wire ground on double-ended substations, the remove neutral sensor can be simulated with the breaker-mounted left pole sensor. On the back of the breaker temporarily reverse wires marked W and N. These wires appear on secondary disconnect points 17 and 18. Connect the circuit breaker so that current flows through the left pole only, and check the ground system as in (5) above. Following the test, return wire W and N to their proper locations.

Note that wire N is on terminal 18 of the secondary disconnect and W is on terminal 17 for 4W ground boxes. On double-ended sub, 4W ground boxes W is on 18 and N is on 17.

7. As an alternative to (6) above, a separate neutral sensor can be used to operate the MPS trip system. Optional test cable assembly 71391 8-T10 provides leads-out which may be connected to a neutral sensor. The type used is at the discretion of the tester. It is recommended that it be of the type planned for final installation. Connect the primary current injection machine to pass current through the neutral sensor.

Ground Trip Delay Test

1. Position the other trip element selectors at their highest threshold value.
2. Remove the ground defeat cable assembly. Connect the breaker harness directly to the MPS box.
3. The Range Selector has no influence on the ground settings.

ALL MPS TYPES	DELAY SETTING	SENSORS		
		200 - 800A	1600 - 2500A	3000 - 4200A
	MIN.	0.48 - 1.3 SEC.	0.07 - 0.18 SEC.	0.05 - 0.17 SEC.
	INT.	2.1 - 4.2 SEC.	0.34 - 0.47 SEC.	0.20 - 0.33 SEC.
	MAX.	12 - 95 SEC.	0.59 - 1.2 SEC.	0.35 - 0.50 SEC.

NOTE THAT I²t FUNCTION IS A PERMANENT FEATURE OF MPS GROUND TRIP CHARACTERISTIC CURVES.

FIELD REPAIR INSTRUCTIONS

MICRO Power-Shield Trip Device Removal and Installation

WARNING WARNING WARNING WARNING

NEVER REMOVE AN MPS BOX HARNESS WHEN THE CIRCUIT BREAKER IS CLOSED AND CONDUCTING CURRENT. THE MPS BOX PLUG AND HARNESS PLUG WILL BE DAMAGED BY A HIGH VOLTAGE FLASHOVER. PERSONAL INJURY MAY ALSO RESULT

1. Remove the two nylon screws which retain the trip system harness plug to the MPS device. Retain for re-use.
2. Remove the four self-tapping screws holding the MPS device shield and remove the shield.
3. Remove the three screws, lockwashers, and nuts that retain the MPS device, then remove the device from the breaker.
4. To reinstall, reverse the above procedure.

CAUTION CAUTION CAUTION

Metallic screws must not be used to retain the MPS trip system harness. Should a metallic screw fall into the trip system, serious damage can result. DO NOT OPERATE THE CIRCUIT BREAKER WITHOUT THE HARNESS SCREWS IN PLACE.

WARNING WARNING WARNING WARNING

The MPS trip device red polyester shield must be in place during breaker operation.

Magnetic Latch Removal

WARNING WARNING WARNING WARNING

THE CIRCUIT BREAKER MUST BE DE-ENERGIZED, RACKED OUT AND REMOVED FROM THE SWITCHGEAR PRIOR TO PERFORMING THIS PROCEDURE. (ON STATIONARY BREAKERS IT IS NOT NECESSARY TO REMOVE THE BREAKER R; HOWEVER, THE MAIN BUS AND CONTROL POWER MUST BE DE-ENERGIZED. THE CLOSING SPRING MUST BE DIS-CHARGED WITH THE MAIN CONTACTS OPEN.

1. Remove the reset spring from its circuit breaker jackshaft mounting.
2. Disconnect the "B" and "F" leads from the breaker harness to the magnetic latch.
3. Remove the two large countersunk screws from the magnetic latch assembly mounting bracket and remove the magnetic latch assembly from the circuit breaker.
4. To reinstall, reverse the removal procedure.

Maglatch Pretravel Adjustment

CAUTION CAUTION CAUTION

This adjustment must be performed with the circuit breaker closed. Extreme care must be exercised in avoiding moving parts. Drawout circuit breakers must be racked to the disconnect position. It is mandatory on stationary breakers that the main bus be de-energized. Control voltage on stationary breaker must also be de-energized.

1. Perform this adjustment only after maglatch replacement or when automatic trip problems with the maglatch have been observed.

2. Ideal maglatch operation is attained when maglatch armature pretravel of 0.062 to 0.125 inches is achieved. Accepted breaker tripping is the guiding criteria.

3. Pretravel may be evaluated measuring the gap between the magnetic latch plunger and the adjusting screw on the bracket attached to the trip bar of the closed circuit breaker. Care must be taken not to move this bracket as breaker tripping can result.

4. Loosen the $\frac{1}{8}$ inch nut on the adjusting screw, then adjust the screw in the required direction to attain acceptable pretravel using an open-ended $\frac{5}{16}$ inch wrench. It will be necessary to hold the tripper bar secure to keep it from rotating as the adjustment is made.

5. Retighten the $\frac{1}{8}$ inch nut to lock down the adjusting screw.

Lubrication

CAUTION CAUTION CAUTION

ABB DOES NOT RECOMMEND LUBRICATION OF ANY KIND ON ANY PART OF THE MAGNETIC LATCH ASSEMBLY.

NATIONAL SWITCHGEAR

ABB

ASEA BROWN BOVERI

ASEA BROWN BOVERI, INC.
ABB Power Distribution Inc.
Circuit Breaker Division
P.O. Box 100524
Florence, South Carolina 29501

Phone: (803) 665-4144
Telecopier: (803) 664-0520

Printed in U.S.A. 1M 0392