

DeltaSpan Industrial Pressure Level Transmitter Manual LD30 Series 22 AUG 08 Rev A



Flowline, Inc. 10500 Humbolt Street Los Alamitos, CA 90720 Tel: (562) 598-3015 Fax: (562) 431-8507

www.flowline.com



Preface

This manual explains how to use the DeltaSpan LD30 series Industrial pressure level transmitter.

Warranty, Service & Repair

To register your product with the manufacturer, go to the Flowline website for on-line registration. The website address is as follows:

www.flowline.com

On-line Warranty Registration can be found under Contact Us in the Navigation Bar along the side of the home page.

If for some reason your product must be returned for factory service, go to the Flowline website to receive a Material Return Authorization number (MRA), providing the following information:

- 1. Full Part Number, Full Serial Number
- 2. Name and telephone number of someone who can answer technical questions related to the product and its application.
- 3. Return Shipping Address
- 4. Brief Description of the Symptom
- 5. Brief Description of the Application

On-line Material Return Authorization can be found under Contact Us in the Navigation Bar along the side of the home page. Click on *Return Authorization* to begin the MRA request. Once you have received a MRA number, ship the product prepaid in its original packing to:

Flowline Factory Service MRA______
10500 Humbolt Street
Los Alamitos, CA 90720

To avoid delays in processing your repair, write the MRA on the shipping label. Please include the information about the malfunction with your product. This information enables our service technicians to process your repair order as quickly as possible.

Warrantv

Flowline warrants to the original purchaser of its products that such products will be free from defects in material and workmanship under normal use and service for a period which is equal to the shorter of one year from the date of purchase of such products or two years from the date of manufacture of such products.

This warranty covers only those components of the products which have non-moving and not subject to normal wear. Moreover, products which are modified or altered, and electrical cables which are cut to length during installation are not covered by this warranty.

Flowline's obligation under this warranty is solely and exclusively limited to the repair or replacement, at Flowline's option, of the products (or components thereof) which Flowline's examination proves to its satisfaction to be defective. FLOWLINE SHALL HAVE NO OBLIGATION FOR CONSEQUENTIAL DAMAGES TO PERSONAL OR REAL PROPERTY, OR FOR INJURY TO ANY PERSON.

This warranty does not apply to products which have been subject to electrical or chemical damage due to improper use, accident, negligence, abuse or misuse. Abuse shall be assumed when indicated by electrical damage to relays, reed switches or other components. The warranty does not apply to products which are damaged during shipment back to Flowline's factory or designated service center or are returned without the original casing on the products. Moreover, this warranty becomes immediately null and void if anyone other than service personnel authorized by Flowline attempts to repair the defective products.

Products which are thought to be defective must be shipped prepaid and insured to Flowline's factory or a designated service center (the identity and address of which will be provided upon request) within 30 days of the discovery of the defect. Such defective products must be accompanied by proof of the date of purchase.

Flowline further reserves the right to unilaterally waive this warranty and to dispose of any product returned to Flowline where:

- a. There is evidence of a potentially hazardous material present with product.
- b. The product has remained unclaimed at Flowline for longer than 30 days after dutifully requesting disposition of the product.

THERE ARE NO WARRANTIES WHICH EXTEND BEYONDTHE DESCRIPTION ON THE FACE OF THIS WARRANTY. This warranty and the obligations and liabilities of Flowline under it are exclusive and instead of, and the original purchaser hereby waives, all other remedies, warranties, guarantees or liabilities, express or implied. EXCLUDED FROM THIS WARRANTY IS THE IMPLIED WARRANTY OF FITNESS OF THE PRODUCTS FOR A PARTICULAR PURPOSE OR USE AND THE IMPLIED WARRANTY MERCHANTABILITY OF THE PRODUCTS.

This warranty may not be extended, altered or varied except by a written instrument signed by a duly-authorized officer of Flowline, Inc.



Introduction

The LD30 Series Industrial Pressure Transmitters converts a single positive pressure into a standard 4-20 mA output signal. The transmitter can be used to accurately measure compatible gases and liquids with full scale accuracy of 0.25%. Designed for industrial environments with a NEMA 4X (IP66) housing, this transmitter resists most effects of shock and vibration.

CAUTION: Do not exceed specified supply voltage ratings. Permanent damage not covered by warranty will result. This device is not designed for 120 or 240 volt AC operation. Use only on 13 to 30 VDC.

Table of Contents

5
6
7
7
8
9
9
.11
.11
.12
.13
.14
.15
.15
.16

About this Manual:

PLEASE READ THE ENTIRE MANUAL PRIOR TO INSTALLING OR USING THIS PRODUCT. This manual includes information on all versions of the DeltaSpan Series Industrial Pressure Level Transmitter from Flowline; models LD30-____. Please refer to the part number located on the transmitter label to verify the exact model which you have purchased.

User's Responsibility for Safety:

Flowline manufactures a wide range of liquid level sensors and technologies. While each of these technologies are designed to operate in a wide variety of applications, it is the user's responsibility to select a technology that is appropriate for the application, install it properly, perform tests of the installed system, and maintain all components. The failure to do so could result in property damage or serious injury.

Proper Installation and Handling:

Only properly-trained staff should install and/or repair this product. Use a proper sealant with all installations. Always check for leaks prior to system start-up.

Wiring and Electrical:

A supply voltage of 13 to 30 VDC is used to power the LD30 series transmitter. Electrical wiring of the sensor should be performed in accordance with all applicable national, state, and local codes.

Temperature and Pressure:

The LD30 series is designed for use in application temperatures from -18 $^{\circ}$ to 93 $^{\circ}$ C (0 $^{\circ}$ to 200 $^{\circ}$ F), and for use at pressures up to 2 x the full span of the LD30 series.

Material Compatibility:

The Industrial pressure level transmitter, LD30 series, is made of 316 Stainless Steel (316 SS) and 316L Stainless Steel (316L SS). Make sure that the model which you have selected is chemically compatible with the application liquids.

Flammable, Explosive and Hazardous Applications:

DO NOT USE THE DELTASPAN, LD30 SERIES LEVEL TRANSMITTER IN HAZARDOUS LOCATIONS.

Make a Fail-Safe System:

Design a fail-safe system that accommodates the possibility of transmitter failure or battery power loss. In critical applications, Flowline recommends the use of redundant backup systems and alarms in addition to the primary system.

Rev A



Components:

DeltaSpan is offered in six different models, based upon pressure rating and material. Depending on the model purchased, you may or may not have been shipped all the components shown below.

DeltaSpan

- LD30-S001 05 psi (11.54 ft wc / 3.52 m wc),
 LD30-S201 15 psi (34.63 ft wc / 10.56 m wc),
 LD30-S401 30 psi (69.30 ft wc / 21.12 m wc),
 LD30-S011 05 psi (11.54 ft wc / 3.52 m wc),
 LD30-S211 15 psi (34.63 ft wc / 10.56 m wc),
 LD30-S411 30 psi (69.30 ft wc / 21.12 m wc),
 Terminal Block in Housing
 Terminal Block in Housing
 Terminal Block in Housing
- Quick Start Guide

Technology

A pressure transmitter is installed near or on the bottom of the tank by way of a ¼" NPT thread. A stainless steel pressure diaphragm within the pressure transmitter is exposed on one side to the application fluid. The amount of pressure applied to the sensing surface will slightly deflect the diaphragm. The deflection of the diaphragm is measured by a built-in microprocessor that provides greater linearity correction over common thermal compensation methods. A 4-20 mA current signal proportional the height of the liquid or the pressure of the gas is generated from the microprocessor.

Specifications

Service: Compatible gases or liquids. Wetted Materials: Body: 316 SS, 316L SS

Accuracy: ±0.25% of full scale.

Temperature Limit: 0 to 200°F (-18 to 93°C).

Compensated Temperature Range: 0 to 175°F (-18 to 79°C).

Thermal Effect: Less than ±0.02%/°F.

Pressure Limit: -S0_1: 10 psig (maximum) / 50 psig (over pressure)

-S2_1: 30 psig (maximum) / 150 psig (over pressure) -S4_1: 60 psig (maximum) / 300 psig (over pressure)

Power Requirement: 13 to 30 VDC. Output Signal: 4 to 20 mA, 2-wire.

Response Time: 50 ms.

Max. Loop Resistance: 1300 Ohms @ 30 VDC Current consumption: 38 mA (maximum) Electrical Connections: -S_01: Cable (9' length)

-S_11: Conduit Housing with Terminal Block


Process connection: 1/4" male NPT
Enclosure rating: NEMA 4X (IP 66)
Mounting Orientation: Mount in any position.

Weight: 10 oz. (283 g). Agency approval (CE): EN 55022


EN 55024 EN 61000-4-2 EN 61000-4-3 EN 61000-4-4 EN 61000-4-5 EN 61000-4-6



Dimensions Cable Version

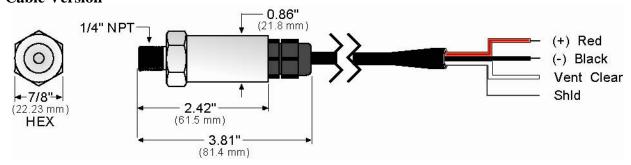

Conduit Version

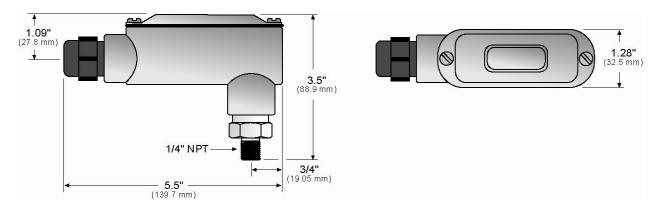

Material Compatibility:


- o The LD30 series is made of 316 Stainless Steel (316 SS), 316L Stainless Steel (316L SS).
- o The Cable Version (LD30-S_01) is provided with 3' (0.91 m) of cable.
- The Conduit Version (LD30-S_11) is provided with a junction box (including a terminal strip) and a ½ NPT conduit.
- o The total length the signal can transmitter is based upon the following formula: RLmax = (Vsup 13V) / 0.02A, where RLmax is the total resistance including the load and the cable length.
- o Make sure that the switch is compatible with the application liquids. To determine the chemical compatibility between the sensor and its application liquids, refer to the Compass Corrosion Guide, available from Compass Publications (858-589-9636).



Getting Started

The LD30 series will be installed near the bottom of the vessel. The switch can be installed through the side wall or through the bottom. Please note that the physical location of the level transmitter will indicate the lowest level of measurement within the tank. For example: mounting the transmitter 1 foot from the bottom of the tank, then the lowest reading of liquid will be 1 foot from the bottom.

Note: When installing the LD30 series, design an installation method where the unit can be removed without having to remove the fluid from the vessel. The use of valves between the transmitter and the vessel can allow transmitter removal without draining the fluid.

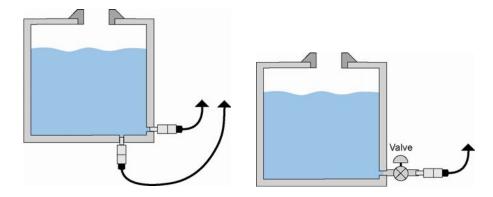

Choosing the Correct Pressure Range

The DeltaSpan series are fixed range transmitters with no adjustability with respect to the 4-20 mA output. For example: at 0 psi (no liquid), the current output will be 4 mA and at maximum pressure, the current output will be 20 mA. Readings between 0 and the maximum pressure will be proportional to the 4-20 mA output. Since the density of liquid will have an influence on the range of the LD30 series, follow these simple instructions to insure the correct pressure range has been selected.

- 1. Determine the Specific Gravity (SG) of the liquid to be measured.
- 2. Determine the maximum height of liquid (H) to be measured in feet.
- 3. Use to following equation to determine the maximum required pressure (P):

$$P = H \text{ (feet) * (SG) / 2.31 (feet/psi)}$$

or
 $P = H \text{ (m) * (SG) / 0.704 (m/psi)}$

4. Compare the maximum required pressure (P) to the pressure ranges listed above.

For example, a 16' tall tank contains a liquid with a SG of 0.9:


$$P = 16.0 \text{ feet} * (0.9) / 2.31 \text{ (feet/psi)} = 6.23 \text{ psi}$$

The maximum required pressure is 6.23 psi, which is above the 5 psi range for the LD30-S001. To read the full range of liquid in the tank, choose the LD30-S101.

Effects of Specific Gravity:

The LD30 series has a fixed span with 4 mA equal to 0 psi and 20 mA equal to the maximum psi setting. Each unit is calibrated for use in liquids with a specific gravity (SG) of 1.000. Pressure transducers maybe used in liquids with a SG other than 1.000. Please note the following relationship between the pressure range and specific gravity:

For example, the LD30-S001 has a range of 0 to 5 psi. The maximum depth the transmitter can read in water (SG = 1.000) is 5 psi x (2.31 feet / 1 psi) = 11.5 feet. For metric, the maximum depth in water is 5 psi x 0.704 m / psi) = 3.52 m.



For liquids with a different SG, simply divide 2.31 by the new SG to determine the new ratio. For example, the LD30-S001 is installed in a liquid with a SG = 0.85. The new ratio is as follows:

1 psi =
$$2.31$$
 feet / (0.85) = 2.717 feet (0.828 m)

Multiply 5 psi by the new ratio to determine the maximum depth:

$$5 \text{ psi} * (2.717 \text{ feet } / 1 \text{ psi}) = 13.6 \text{ feet } (4.15 \text{ m})$$

A lower SG will increase the maximum depth for the transmitter. Another example, the LD30-S101 is installed in a liquid with a SG = 1.2. The new ratio is as follows:

1 psi =
$$2.31$$
 feet / (1.2) = 1.925 feet $(0.587$ m)

Multiply 10 psi by the new ratio to determine the maximum depth:


$$10 \text{ psi} * (1.925 \text{ feet} / 1 \text{ psi}) = 19.3 \text{ feet} (5.87 \text{ m})$$

A high SG will decrease the maximum depth for the transmitter.



Electrical Installation

An external power supply delivering 13-30 VDC with minimum current capability of 40 mA DC (per transmitter) is required to power the control loop. See figure below for connection of the power supply, transmitter and receiver.

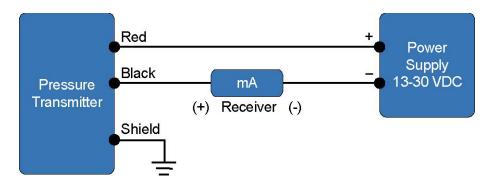


The maximum receiver load resistance (RLmax) for the DC power supply voltage (Vsup) is expressed by the formula:


$$RLmax = (Vsup - 13V) / 0.02A$$

Shielded cable is recommended for control loop wiring. Use the Red wire as the (+) and the Black wire as the (-).

Wiring to a Loop Powered Display




Wiring to a Typical PLC

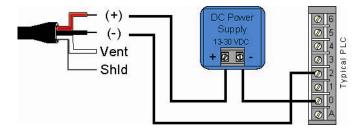

Installation

The LD30 series is designed to operate with only the installation thread being exposed to the fluid. Avoid installing the level transmitter along the bottom of the tank as materials such as sludge will build up and coat/cover the port.



- 1. **Location:** Select a location where the temperature of the transmitter will be between 0 and 175°F (-18 to 79°C). Distance from the receiver is limited only by total loop resistance. The tubing or piping supplying pressure to the unit can be practically any length required but long lengths will increase response time slightly.
- 2. **Position:** The transmitter is not position sensitive. However all standard models are originally calibrated with the unit in a position with the pressure connection downward. Although they can be used at other angles, for best accuracy it is recommended that units be installed in the position calibrated at the factory.
- 3. **Pressure Connection:** Use a small amount of plumber's tape or other suitable sealants to prevent leaks. Be sure the pressure passage inside the port is not blocked.
- 4. **Electrical Connections:** Wire Length The maximum length of wire connecting the transmitter and receiver is a function of wire size and receiver resistance. Wiring should not contribute more than 10% of the receiver resistance to total loop resistance. For extremely long runs (over 1000 feet), choose receivers with higher resistance to minimize the size and cost of connecting leads. Where wiring length is under 100 feet, wire as small as 22 AWG can be used.



Maintenance

Maintenance should consist of inspection to see that the transmitter is free from debris and not coated with any substance, which would prevent liquid from freely entering and leaving the transmitter. If this occurs, the transmitter should be cleaned.

Cleaning procedure:

- 1. *Power:* Make sure that all power to the transmitter, controller and/or power supply is completely disconnected.
- 2. *Transmitter removal:* If necessary, make sure that the tank is drained well below the switch prior to removal. Carefully, remove the transmitter from the installation.
- 3. Cleaning the switch: Using a soft bristle brush and mild detergent, carefully wash the switch. Do not use harsh abrasives such as steel wool or sandpaper, which might damage the surface of the sensor. Do not use incompatible solvents, which may damage the sensor's stainless steel body. Take particular care to remove any scaling from the body and that there is no debris inside the inlet.
- 4. *Transmitter installation:* Follow the appropriate steps of installation as outlined in the Installation section of this manual.

Testing the installation:

Verify proper wiring, power supply and loop resistance. If transmitter is not functioning properly, isolate the transmitter from the system and wire as shown below. Multimeter should read 4 mA with the transmitter out of liquid.

