

**Autonics**

**COUNTER/TIMER  
CTS SERIES**

**M A N U A L**



Thank you very much for selecting Autonics products.  
**For your safety, please read the following before using.**

**■ Caution for your safety**

\*Please keep these instructions and review them before using this unit.

\*Please observe the cautions that follow:

**⚠ Warning** Serious injury may result if instructions are not followed.

**⚠ Caution** Product may be damaged, or injury may result if instructions are not followed.

\*The following is an explanation of the symbols used in the operation manual.

**⚠caution:** Injury or danger may occur under special conditions.


**⚠ Warning**

1. **In case of using this unit with machineries(Nuclear power control, medical equipment, vehicle, train, airplane, combustion apparatus, entertainment or safety device etc), it requires installing fail-safe device, or contact us for information required.**  
It may result in fatal damage, fire or human injury
2. **This unit must be mounted on Panel.**  
It may give an electric shock.
3. **Do not connect terminals when it is power on.**  
It may give an electric shock.
4. **Do not disassemble and modify this unit, when it requires. If needs, please contact us.**  
It may give an electric shock and cause a fire.

**⚠ Caution**

1. **This unit shall not be used outdoors.**  
It might shorten the life cycle of the product or give an electric shock.
2. **When wire connection, No.20AWG(0.50mm<sup>2</sup>) should be used and screw bolt on terminal block with 0.74N·m to 0.90N·m strength.**  
It may result in malfunction or fire due to contact failure.
3. **Please observe specification rating.**  
It might shorten the life cycle of the product and cause a fire.
4. **Do not use the load beyond rated switching capacity of Relay contact.**  
It may cause insulation failure, contact melt, contact failure, relay broken, fire etc.
5. **In cleaning the unit, do not use water or an organic solvents.**  
It might cause an electric shock or fire that will result in damage to the product.
6. **Do not use this unit at place where there are flammable or explosive gas, humidity, direct ray of the sun, radiant heat, vibration, impact etc.**  
It may cause explosion.
7. **Do not inflow dust or wire dregs into inside of this unit.**  
It may cause a fire or mechanical trouble.

### Ordering information

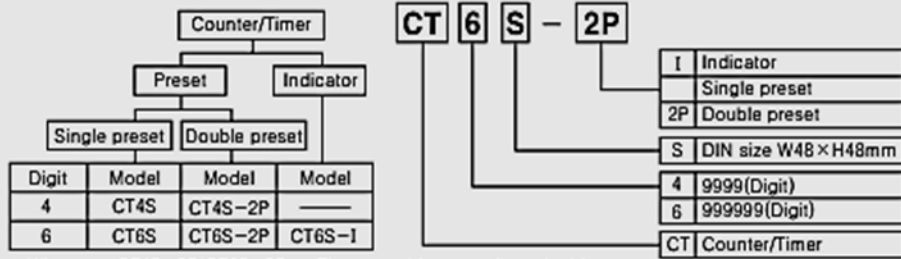

※ When use CT4S-2P/CT6S-2P as Timer, unable to use it as double preset.

※ The above specification are changeable without notice anytime.

### Specifications

Series		CTS				
Digit		4		6		
Model	Single preset	CT4S		CT6S		
	Double preset	CT4S-2P		CT6S-2P		
	Indicator	—		CT6S-I		
Power supply	AC power	100-240VAC 50/60Hz				
	DC power	24-60VDC				
Allowable voltage range		90 to 110% of rated voltage(AC power type)				
Power consumption	AC power	Indicator:Approx. 9VA, Single preset & Double preset:Approx. 10VA				
	DC power	Indicator & Single preset:Approx. 5W, Double preset:Approx. 6W				
CPS of INA, INB		Selectable 1cps, 30cps, 1kcps, 5kcps, 10kcps				
Min. input signal width	Counter	Reset input:Selectable 1ms or 20ms				
	Timer	INA, INH, Reset signal:Selectable 1ms or 20ms				
Input		Selectable voltage input or No-voltage input [Voltage input] Input impedance is 5.4kΩ, "H" level : 5-30VDC, "L" level : 0-2VDC [No-voltage input] Short-circuit impedance : Max. 1kΩ, Residual volatge : Max. 2VDC, Open-circuit impedance : Min. 100kΩ				
One-shot output		10 / 50 / 100 / 200 / 500 / 1000 / 2000 / 5000ms				
Control output	Con-tact	Type	Single preset type : SPDT(1c) Double preset type : SPST(1a) for first & second output			
		Capacity	NO:250VAC 3A resistive load, NC:250VAC 2A resistive load			
	Solid-state	Type	NPN open collector			
		Capacity	Max. 30VDC, Max. 100mA			
Memory retention		10 years				
External sensor power		12VDC ±10%, 100mA Max.				
Ambient temperature		-10 to 55°C(at non-freezing status)				
Storage temperature		-25 to 65°C(at non-freezing status)0				
Ambient humidity		35 to 85%RH				
Timer	Repeat error	Power ON start : ±0.01% ±0.05sec Signal start : ±0.01% ±0.03sec				
	Set error					
	Voltage error					
	Temperature error					
Insulation resistance		Min. 100MΩ (at 500VDC)				
Dielectric strength		2000VAC 50/60Hz for 1 minute				
Noise strength(AC power)		±2kV the square wave noise(pulse width:1μs) by the noise simulator				
Vibration	Mechanical	0.75mm amplitude at frequency of 10 to 55Hz in each of X, Y, Z directions for 1 hour				
	Malfunction	0.5mm amplitude at frequency of 10 to 55Hz in each of X, Y, Z directions for 10 minutes				
Shock	Mechanical	300m/s <sup>2</sup> (Approx. 30G) 3 times at X, Y, Z direction				
	Malfunction	100m/s <sup>2</sup> (Approx. 10G) 3 times at X, Y, Z direction				
Relay life cycle	Mechanical	Min.10,000,000 times				
	Electrical	Min.100,000 times(NO:250VAC 3A resistive load, NC:250VAC 2A resistive load)				
Protection		IP65(Front panel only)				
Weight	AC power	CT4S: Approx. 155g	CT4S-2P: Approx. 162g	CT6S: Approx. 155g	CT6S-2P: Approx. 162g	CT6S-I: Approx. 136g
	DC power	CT4S: Approx. 152g	CT4S-2P: Approx. 159g	CT6S: Approx. 152g	CT6S-2P: Approx. 159g	CT6S-I: Approx. 133g

### Front panel identification

**•4 Digit**

**•6 Digit**

- ① Display for processing value (Red LED)  
Counting value (Counter) / Processing time (Timer) / Setting symbols  
LED height: 11mm for 4digit, 10mm for 6digit
- ② Preset value display (Yellow-Green LED)  
Preset value (Counter) / Preset time (Timer) and setting symbols  
LED height: 8mm for 4digit, 7mm for 6digit
- ③ LOCK : Key lock Indication
- ④ CNT : Indication the operation of counter
- ⑤ TMR : Indication the operation of timer  
-LED flickers when the timer is processing  
-LED turns on when the processing time stops
- ⑥ PS1, PS2 : Check preset value and display change of it
- ⑦ OUT1, OUT2 : Indicating operation of output
- ⑧ : Reset key
- ⑨ : Mode key
- ⑩ : Set key

※ There is no ⑥, ⑦ LED in CT6S-I.  
PS2 will be changed to PS and OUT2 is OUT.  
There is no PS1, OUT1 LED in CT4S, CT6S.

---

### Dimensions

•Panel cut-out

(Unit:mm)

---

### Connections

#### OCT4S, CT6S

CONTACT OUT:  
NO: 250VAC 3A  
NC: 250VAC 2A  
RESISTIVE LOAD

#### OCT4S-2P, CT6S-2P

CONTACT OUT1, OUT2:  
250VAC 3A  
RESISTIVE LOAD

#### OCT6S-I

※ INB/INH signal in CTS series

- (1) Operation of Counter: Operating as INB signal
- (2) Operation of Timer: Operating as INH signal

If the INH signal applied during it is used as Timer, the processing time stops. (Hold)


• Connection of contact input in state of select voltage input (PNP): CT6S

• Connection of relay contact input in state of No-voltage input (NPN): CT6S


### Input connection

#### Input logic : No-voltage input(NPN)

- Solid state input  
Standard sensor:NPN output type sensor

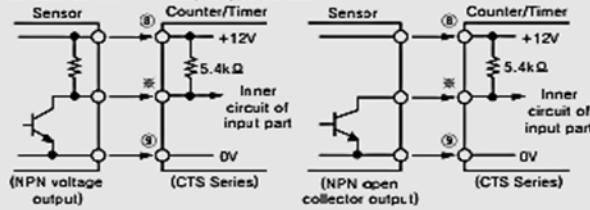


#### ●Contact Input




#### Input logic : Voltage input(PNP)

- Solid state input  
Standard sensor:PNP output type sensor

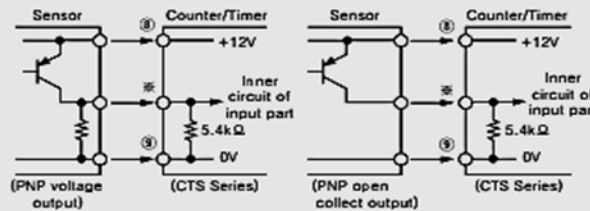


#### ●Contact Input




■ INA (Ⓢ), INB/INH (Ⓣ), RESET (Ⓢ) input part

### Output connection

#### ○Contact output



#### ○Solid state output




#### ○Solid state output connection

- Use proper load and power for load not to exceed ON/OFF capacity (30VDC Max. 100mA max.) of solid state output.
- Be sure not apply reverse polarity of power.
- When use Inductive load(Relay etc), surge absorber(Diode, Varistor etc) must be connected between both side of the load.

### Input logic selection

1. The power must be cut off.
2. Detach the case from body.

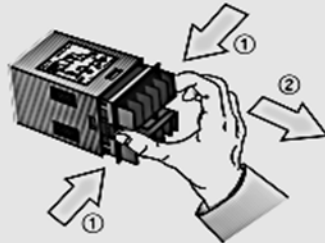


- Case detachment  
After push toward ① and pull toward ② as like picture.



●● Please check if the power cut off!! ●●

3. Select input logic by using input logic S/W inside of Counter/Timer.

#### ●Select No-voltage input(NPN)



#### ●Select voltage input(PNP)



4. Please assemble opposite way of the case detachment.
5. Then apply the power to Counter/Timer.

### Error code display


Error display	Errors	Output status	How to return
Err1	CPU error	Double preset type:OUT1, OUT2 are OFF Single preset type:OUT is OFF	[RST] key, RESET input

### ■ Error code display


Error display	Errors	Output status	How to return
Err1	CPU error	Double preset type:OUT1, OUT2 are OFF Single preset type:OUT is OFF	[RST] key, RESET input

### ■ Change of preset value in Counter operation

○Change the preset value in the single preset type(CT6S, CT4S)



○Change the preset value in the double preset type(CT6S-2P, CT4S-2P)



※ If the input signal in while changing preset value, it controls the output and the counting function. In state of changing preset value if no key is touched for 60 sec., the timer will return to the RUN mode. After change the preset value as "0", there is [RST] key input or RESET input, the output will be maintained as OFF.  
(But in state of the output mode is "T", if change single preset value as "0", the single output will be maintained as ON.)


○How to change in the single preset type:To change the set value from 175 to 180



1 Press [ ] key to enter in state of changing preset value the prior preset value is indicated and the first digit "5" flashes.



2 Change "5" to "0" by pressing [ ] key 5 times, and shift the flickering("7" flickering) digit to the second digit by pressing [ ] key once.



•Whenever [ ] key is pressed in the state changing preset value, the flickering digit shifts from the right to the left.




3 Change "7" to "8" by pressing [ ] key once.




4 It will be completed to preset value and return to RUN mode by pressing [ ] key.

### ■ Change of preset value in Timer operation

○Change preset time in case of the output mode is not FLK




○Change preset time in case of the output mode is FLK




※ In state of changing preset value, if no key is touched for 60 sec., the timer will return to the RUN mode.


○In the change the t.off time from 30sec. to 50sec. and the t.on time from 40sec. to 20sec. (Output mode : FLK, Time range : tr-2)



1 Pressing [ ] key to enter the state of changing preset time. The right first digit flickers. Shift the flickering digit to "3" position by pressing [ ] key twice.



2 Change "3" to "5" by pressing [ ] key twice. Set "t.off" time as pressing [ ] key which enters "t.on" mode automatically. The first digit flickering.



•Whenever [ ] key is pressed in the changing mode of the preset time, the flickers digit shifts from the right to the left.



3 Shift the flashing digit to "4" position by pressing [ ] key twice.



4 Change "4" to "2" by pressing [ ] key twice. It will be completed preset value and return to RUN mode by pressing [ ] key.




※ When use CT4S-2P/CT6S-2P as Timer, unable to use it as double preset.





### How to set Lock key

Be sure to set the lock mode in order to protect malfunction by unauthorized keypad.

L.oFF (LOCK OFF) : Cancellation of the lock mode

L.o.L.1 (LOCK LEVEL 1) : Lock  key

L.o.L.2 (LOCK LEVEL 2) : Lock  &  &  key


L.o.L.3 (LOCK LEVEL 3) : Lock  &  &  &  key

### Prescale function

This function is to set and indicate calculated unit for actual length, liquid measure, position etc. it is called "Prescale value" for measured length, measured liquid, measured position, etc per 1 pulse.

For example) Pulse number P is number of pulses per 1 revolution of rotary encoder. L is the desired length to be measured. Prescale value is desired length L/pulse number P generated by the rotary encoder. It is the length measured per 1 pulse.

Control length by the counter and the rotary encoder

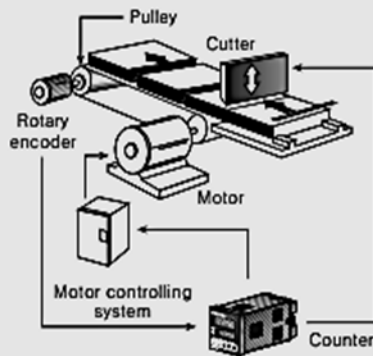


[Diameter of the Pulley connected with the encoder is 22mm, pulse number of encoder per 1revolution:1000]

$$\begin{aligned} \text{Prescale value} &= \frac{\pi \times \text{Diameter of the Pulley}(D)}{\text{Pulse numbers per 1 revolution of the encoder}} \\ &= \frac{3.1416 \times 22}{1000} \\ &= 0.069\text{mm/pulse} \end{aligned}$$

It is possible to control conveyor as 0.1mm unit to set 0.069 for Prescale value by pressing setting key in state of prescale value setting in function setting mode. Decimal point should be set the first decimal place in function setting mode.

### Factory specification

Set item	Model	Double preset model (CT6S-2P, CT4S-2P)	Single preset model (CT6S, CT4S)	Indicator model (CT6S-I)
COUNTER	Input mode	Up/Down-C(U/D-C)		
	Output mode	F		
	OUT1	100ms	---	
	OUT2(OUT)	Hold		
	CPS	30cps		
	Min. reset time	20ms		
	Decimal point	Non decimal point		
	Prescale value	6digit indication model(CT6S-2P, CT6S, CT6S-I) : 1.000 4digit indication model(CT4S-2P, CT4S) : 1.00		
	Counting memory	CLer(Power reset)		
TIMER	Time range	6digit indication model(CT6S-2P, CT6S, CT6S-I) : 0.01s-9999.99s 4digit indication model(CT4S-2P, CT4S) : 0.01s-99.99s		
	Up/Down mode	U(UP)		
	Output mode	OND(ON Delay)		
	Output time	Hold		
	Input signal mode	20ms		
Input method	No-voltage input(NPN)			
Lock key	L.oFF(Lock OFF)			
Counter/Timer	Counter			

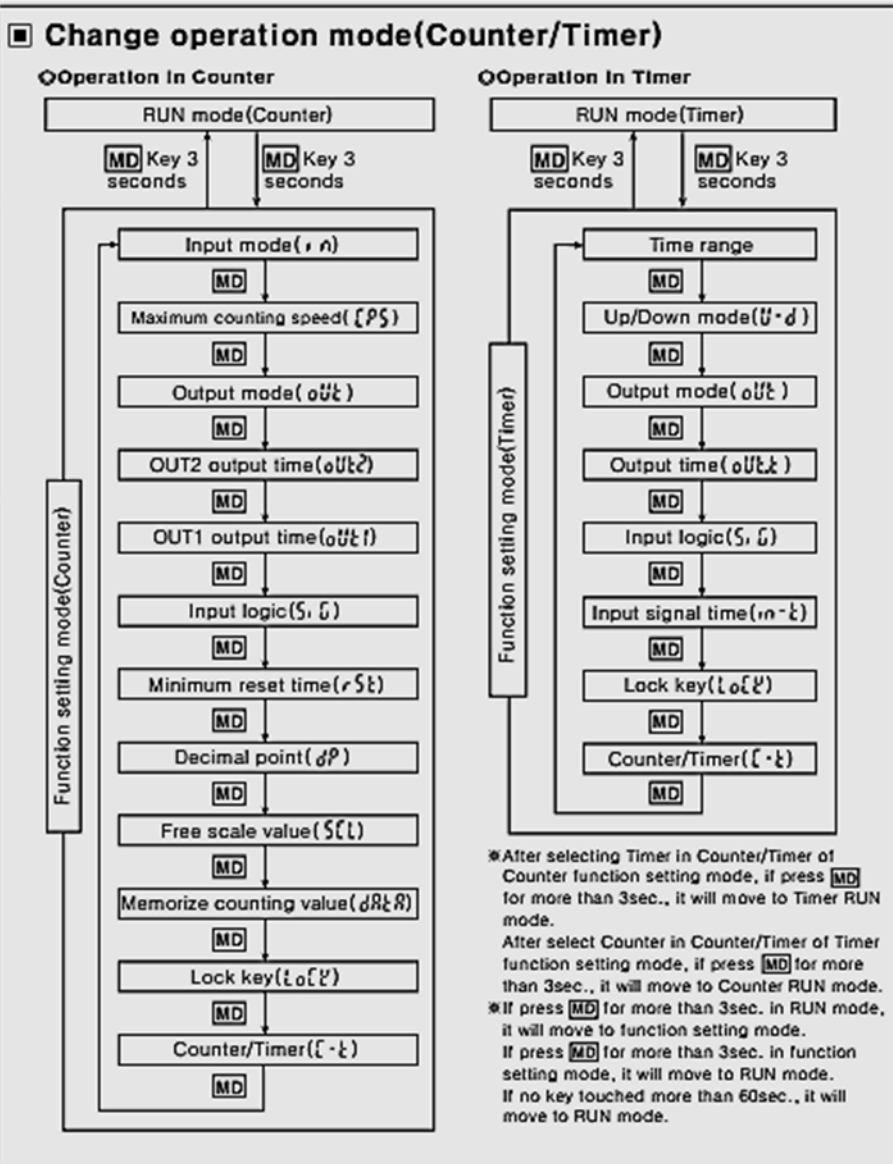

■ Setting of counter function modes	
Setting mode	How to set (▲, ▼)
Input mode (i n)	<p>U → d → Ud-A → Ud-b → Ud-C</p> <p>Ud-A, B, C will be fixed in the input mode, if output mode is S, T, D.</p>
Maximum counting speed (FPS)	<p>1 → 30 → 1K → 5K → 10K</p> <p>Counting speed is that of one by one(1:1) duty ratio of INA or INB input signal, and it is applied in INA or INB at the same time. In case of setting D in output mode, 5Kcps and 10Kcps are not indicated in the display.</p>
Output mode (oUt)	<p>•Up or Down input mode F → n → C → r → U → P → Q → R</p> <p>•Up / Down-A, B, C input mode F → n → C → r → U → P → Q → R → S → t → d</p>
OUT2 output time(oUt2)	<p>10 → 50 → 100 → 200 → 500 → 1000 → 2000 → 5000</p> <p>Unit:ms</p>
OUT2 output time(oUt1)	<p>10 → 50 → 100 → 200 → 500 → 1000 → 2000 → 5000 → Hold</p> <p>Unit:ms</p>
Input logic (Si U)	<p>It indicates according to position, and it can't set by ▲&amp; ▼key. Voltage input : PnP No-voltage input : nPn</p>
Min. reset time (rSt)	<p>1 → 20</p> <p>Min. external RESET signal width(Unit:ms)</p>
Decimal point (dP)	<p>•In case of CT6S-2P, CT6S, CT6S-I</p> <p>.....*.....*.....*</p> <p>•In case of CT4S-2P, CT4S</p> <p>.....*.....*</p>
Prescale value (ScL)	<p>▲ Key : Shift the flickering digit ▲, ▼ Key : Change the prescale value Set range of prescale value : 0.001 to 99.999(CT6S-2P, CT6S, CT6S-I), 0.01to 9.99(CT4S-2P, CT4S) Prescale value : It is actual value of length and position, liquid measure from counting input of 1pulse</p>
Memorize counting value (dRtR)	<p>CLEr ⇌ rEE</p> <p>CLEr : Power reset for counting value. (Reset counting value when power off) rEE : Memory for counting value (Memory of counting value when power off)</p>
Lock key (LoLk)	<p>LoFF → LoC.1 → LoC.2 → LoC.3</p>
Counter/Timer (C-t)	<p>CoUn ⇌ t, nE</p> <p>CoUn : Counter t, nE : Timer</p>

※ There is no "OUT1 output time" in single preset model(CT6S, CT4S), "OUT2 output time" will be replaced as "OUT output time(oUt.t)".  
 ※ In case of setting output mode as "F, N", if counting value reach at preset value. Output will be held. So there is no "OUT2 output time" in function setting mode.  
 ※ If set "S, T, D" as the output mode, input will fixed one from Ud-A, Ud-B, Ud-C. If change input mode to Up/Down, it needs to change an other mode, not S.T.D.  
 ※ When it is in function setting mode, no external input signal will be accepted and the output will stay in the OFF state.  
 ※ When selecting the "D" output mode and if 1kcps is used, the output may not operate normally because of respond time of the contact. Therefore, in this case be sure to use the solid state output.  
 ※ In state of maximum counting speed is 5kcps or 10kcps, if change output mode to "D", the maximum counting speed will be changed to 1cps.  
 ※ There are no output mode and output time setting mode of function setting mode in CT6S-I series.

### Input operation mode for counter

Ⓐ:Over Min. signal width, Ⓑ:Over 1/2 of Min. signal width


Input mode	Counting chart	Notice
<b>U</b> (Up)		INA : Counting input INB : No counting input (Limit counting input of INA) *When INA is L, please set no counting (INA:H → L) or turn off no counting (INB:L → H)
		INA : No counting input (Limit counting input of INB) INB : Counting input
<b>d</b> (Down)		When INB is H, please set no counting (INA:H → L) or turn off no counting (INB:L → H)
		INA : Counting value input INB : No counting input (Limit counting input of INA) n=Preset value When INA is L, please set no counting (INA:L → H) or turn off no counting (INB:H → L)
<b>Ud-A</b> (Up/Down-A) Command input		INA : No counting input (Limit counting input of INB) INB : Counting input N=preset value When INA is L, please set no counting (INA:H → L) or turn off no counting (INB:L → H)
<b>Ud-b</b> (Up/Down-B) Individual input		INA : Counting value input INB : Up/Down counting command input When INB is L, counting Up When INB is H, counting Down
<b>Ud-C</b> (Up/Down-C) Phase difference input		INA : Counting Up input INB : Counting Down input When INA and INB applied L → H, it will remain previous counting value.

\*When use A,B phase of encoder with connecting to INA, INB, please set counter input mode as phase different input(Ud-C).


Symbol	Input type	Voltage input(PNP)	Contact input(NPN)
H		5-30VDC	Short circuit
L		0-2VDC	Open

### Counter operation of CT6S-I(Indication only)


●In case of input mode is Up

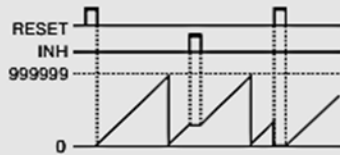

●In case of input mode is Down

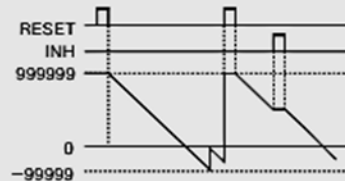

●In case of the input mode is command input(Ud-A), Individual input(Ud-b), Phase difference input(Ud-C)

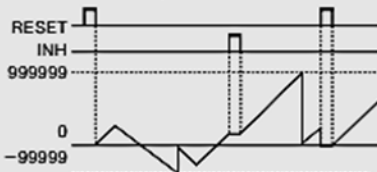

**Output operation mode for counter**

		One-shot output (OUT1 output)	One-shot output (OUT2 output)	Hold output	Coincidence output
Output mode	Input mode			Operation	
	Up	Down	Up/Down A, B, C		
<b>F</b> (F)				After counting up, the display value increases or decreases until the reset signal is applied, and OUT1 and OUT2 holds "on" state. One-shot output of OUT1 operates regardless to OUT2.	
<b>N</b> (N)				After counting up, the display value and OUT1, OUT2 holds "on" state until the reset signal is applied. One-shot output of OUT1 operates regardless to OUT2.	
<b>C</b> (C)				The display value resets at the same time counting up. Hold output of OUT1 turns off after One-shot time of OUT2. One-shot output of OUT1 operates regardless to OUT2.	
<b>R</b> (R)				After counting up, display value resets after one shot time of OUT2. Hold output of OUT1 turns off after One-shot time of OUT2. One-shot output of OUT1 operates regardless to OUT2.	
<b>K</b> (K)				After counting up, the display value increases or decreases until the reset signal is applied. Hold output of OUT1 turns off after One-shot time of OUT2. One-shot output of OUT1 operates regardless to OUT2.	
<b>P</b> (P)				After counting up, display value is held for One-shot time of OUT2 counting operation starts again when OUT2 turns on, when OUT2 turns off, display value indicates counted value for ON time of OUT2 and increases or decreases. Hold output of OUT1 turns off after One-shot time of OUT2. One-shot output of OUT1 operates regardless to OUT2.	
<b>Q</b> (Q)				After counting up, display value increases or decreases for One-shot time of OUT2. Hold output of OUT1 turns off after One-shot time of OUT2. One-shot output of OUT1 operates regardless to OUT2.	
<b>A</b> (A)				After counting up, display value and Hold output of OUT1 is held until applying the reset signal. One-shot output of OUT1 operates regardless to OUT2. OUT2 returns automatically after One-shot time.	
Up/Down - A, B, C					
<b>S</b> (S)				OUT1 and OUT2 keeps ON state in following condition: Display value $\geq$ Preset 1 Display value $\geq$ Preset 2	
<b>T</b> (T)				OUT1 keeps OFF state when display value is smaller than Preset 1 value, but if Preset 2 is "0", OUT1 keeps ON state. OUT2 keeps ON state when display value is equal or larger than Preset 2.	
<b>D</b> (D)				When display value is equal to set value (Preset 1 or Preset 2) only, OUT1 or OUT2 output keeps ON state.	

\* Output of single preset type is operating the same as OUT2 of double preset type.

### Setting of timer function modes

Set menu	How to set(▲, ▼)
	●CT6S-2P, CT6S, CT6S-1 
	●CT4S-2P, CT4S 
	<b>Time range</b> Up: Time proceeds from 0(zero) to the set value Down: Time proceeds from the set value to 0(zero)
	<b>UP/DOWN mode (U-d)</b> U (Up) ↔ d (Down)
	<b>Output mode (out)</b> ond → ond.1 → ond.2 → FLY → FLY.1 OFD ← INT.1 ← INT.2 ← FLY.2
	<b>Output time (outt)</b> 10 → 50 → 100 → 200 → 500 → 1000 Hold ← 5000 ← 2000 (Unit:ms)
	<b>Input logic (S, G)</b> It indicates according to position, and It can't set by ▲ & ▼ key. Voltage input: pnp No-voltage input: npn
<b>Input signal time (int)</b> 1 ↔ 20 (Unit:ms) Selection of Min. signal width of INA, INHIBIT, RESET signal	
<b>Lock key(Lock) (LoK)</b> LoFF → LoL.1 → LoL.2 → LoL.3	
<b>COUNTER/TIMER (C-t)</b> CoUn ↔ t, nE CoUn: COUNTER t, nE: TIMER	

When setting the function mode, no external input signal will be accepted and the output will stay in the OFF state.  
 \* In case of output mode is FKL, INT, INT1, OFD, there is no output time setting in the function setting mode.  
 \* In the indicator type (CT6S-1), there are no the output mode and the output time setting mode(OUT1, OUT2) in the function setting mode.  
 \* Control output operates as OUT2 in the double preset type (CT6S-2P, CT4S-2P), and out1 always keeps "OFF" status.  
 \* When in the function setting mode, if no key is touched for 60 sec. the timer will return to RUN mode.

### Timer range

●CT6S-2P, CT6S, CT6S-1


Time range	Function setting mode	
	Counting display	Preset display
0.01s - 9999.99s	5.00	999999
0.1s - 99999.9s	5.00	999999
1s - 999999s	5.00	999999
0.01s - 99m59.99s	n.5	995999
0.1s - 999m59.9s	n.5	999599
0.1m - 99999.9m	n	999999
1m - 999999m	n	999999
1s - 99h59m59s	H.n.5	995959
1m - 9999h59m	H.n	999959


●CT4S-2P, CT4S

Time range	Function setting mode	
	Counting display	Preset display
0.01s - 99.99s	5.00	9999
0.1s - 999.9s	5.00	9999
1s - 9999s	5.00	9999
1s - 99m59s	n.5	9959
0.1m - 999.9m	n	9999
1m - 9999m	n	9999
1m - 99h59m	H.n	9959
1h - 9999h	H	9999

### Timer output operation mode


Output mode	Time chart	Operation
ond (OND)		1) Time starts when INA signal turns on, if INA signal turns off, time resets. 2) Time starts when power turns on and when reset turns off during INA signal on. 3) Control output operates as hold or One-shot time.

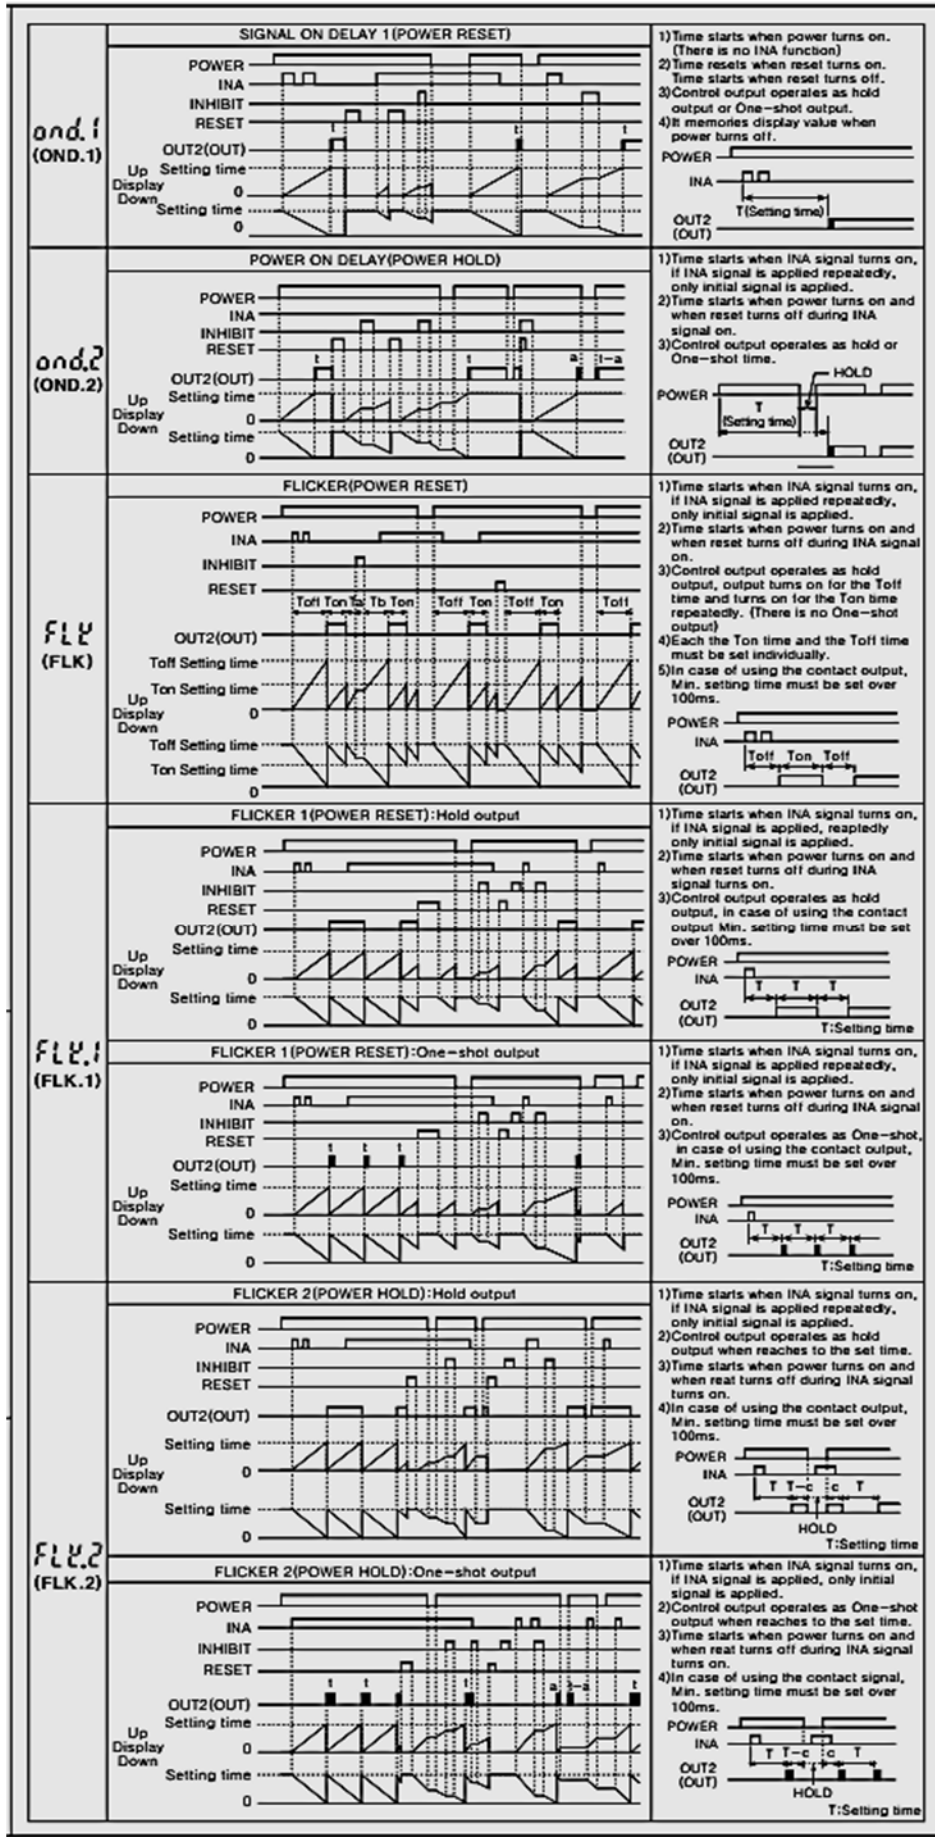

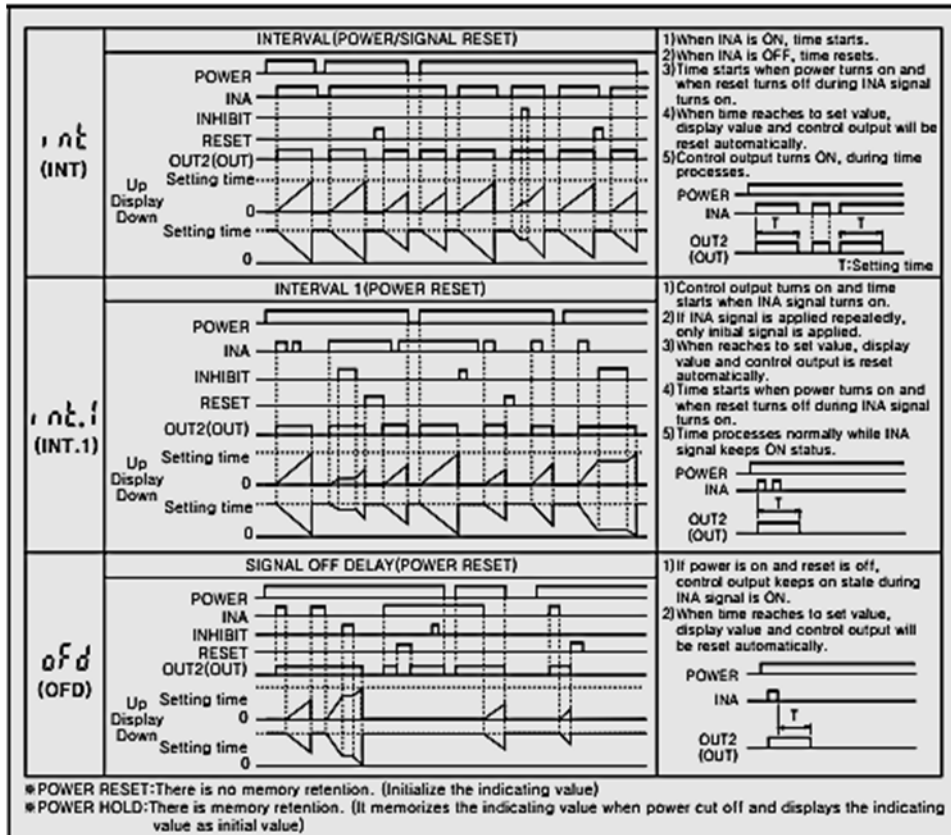


Ⓜ POWER RESET: There is no memory retention. (Initialize the indicating value)  
 Ⓜ POWER HOLD: There is memory retention. (It memorizes the indicating value when power cut off and displays the indicating value as initial value)

**Timer operation of CT6S-I (Indication only)**

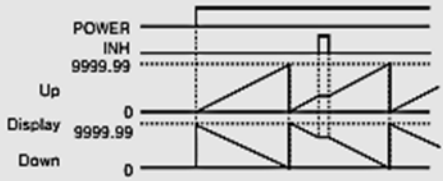

**Caution**

- The power ON/OFF
  - ① Power voltage rises for 100ms after power on and falls for 700ms after power off. Therefore be sure to apply input signal after 100ms and power turns on again after 700ms when power turns off.
  - ② When apply the power into CTS series, please apply the power in an instant by using Switch or Relay.
- Input signal line
  - ① Use as short a cable from the sensor to this unit as possible.
  - ② Use shielded cable for long input line.
  - ③ Wire as separating input line from the power line.
- Selection of input method
  - Be sure to change the input method after power off.
- Contact count input (When it is used as Counter)
  - If apply contact input at high speed mode (1k, 5k, 10k), it may miscount by chattering. Therefore set low speed mode (1 or 30cps) at contact input.
- When test dielectric voltage and insulation resistance of the control panel with this unit installed.
  - ① Please isolate this unit from the circuit of control panel.
  - ② Please make all terminals of this unit short-circuited.
- Do not use this unit at below places.
  - ① Place where there are severe vibration or impact.
  - ② Place where strong alkalis or acids are used.
  - ③ Place where there are direct ray of the sun
  - ④ Place where strong magnetic field or electric noise are generated.
- Installation environment
  - ① It shall be used indoor
  - ② Altitude Max. 2000m
  - ③ Pollution Degree 2
  - ④ Installation Category II

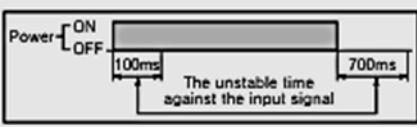

**\* It may cause malfunction if above instructions are not followed.**