



INSTALLATION GUIDE

Xpass

English

Version 2.10

Contents

Safety Instructions	3
Getting Started	4
Components	4
Features	5
Part names and features	5
Cables and connectors	6
Installation	7
Mounting the Bracket and Product.....	7
Installing the bracket.....	7
Connecting to Power.....	8
Connecting to a Network	9
TCP/IP	9
Connecting to an Door button/Door sensor	10
Digital input connection (Door button, Door sensor)	10
Digital input connection (Alarm, Emergency switch).....	10
Connecting to a Relay	11
Fail Safe Lock	11
Fail Secure Lock	11
Connecting to an Automatic door.....	12
Connecting as a standalone.....	12
Connecting to Secure I/O 2	13
Connecting as a Wiegand device	13
External Power Output.....	14
Resetting Network Settings.....	14
Product Specifications	15
Dimensions.....	16
FCC Compliance Information	17
Appendix	18
Disclaimers	18
Copyright Notice	18

Safety Instructions

Please read the following instructions carefully before using the product. This information is important for ensuring the safety of the user and for preventing damage to the user's property.

Warning

Violation of the instructions may cause serious injury or death.

Installation Instructions

Do not install the product in direct sunlight or in a location that is damp or dusty.

- This can cause a fire or electric shock.

Install the product in a dry place.

- Moisture can cause product damage or electric shock.

Do not install the product near any heat source such as electric heaters.

- This can cause a fire from overheat or electric shock.

Install the product in a place where there is no electromagnetic interference.

- This can cause product damage or electric shock.

Have qualified service professionals install or repair the product.

- Otherwise, it can cause a fire, electric shock, or injury.
- If the product is damaged due to a user's unauthorized installation or dismantling of the product, a service fee will be charged for repair.

Operating Instructions

Be careful not to spill any liquid such as water, drinks, or chemicals inside the product.

- This can cause fire, electric shock, or product damage.

Caution

Ignoring these instructions may result in minor injuries or damage to the product.

Installation Instructions

Protect the power cord from being walked on or pinched.

- This can cause product damage or injury.

Keep the product away from strong magnetic objects such as magnets, TVs, monitors (especially CRT monitors), or speakers.

- This can cause a product failure.

If installing the product outside where the product is completely exposed, it is recommended to install the product together with the enclosure.

Use a separate power supply for Secure I/O 2, electric lock and Xpass respectively.

- If connecting and using the power supply to these devices together, the devices may malfunction.

Operating Instructions

Do not drop the product or subject it to shock or impact during use.

- This can cause a product failure.

Do not press the buttons on the product with excessive force or with a sharp tool.


- This can cause a failure.

Clean the product with a soft, dry cloth. Do not use alcohol, benzene, or water.


- This can cause a product failure.

Getting Started


Components

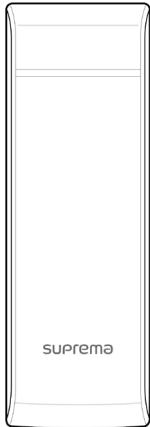


Xpass

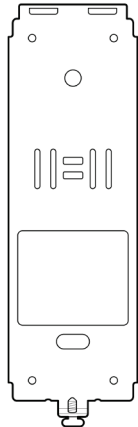


Main bracket

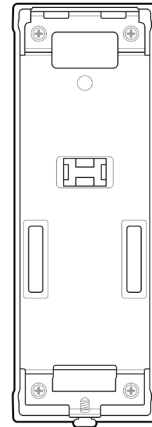


Extension bracket



Adapter




Diode



TCP/IP
extension cable




Mounting screws for bracket
(2 pcs)



PVC anchors
(2 pcs)



Heat shrink
tubes




Software CD

Note

The components may differ depending on where the product is installed.


Features

Part names and features

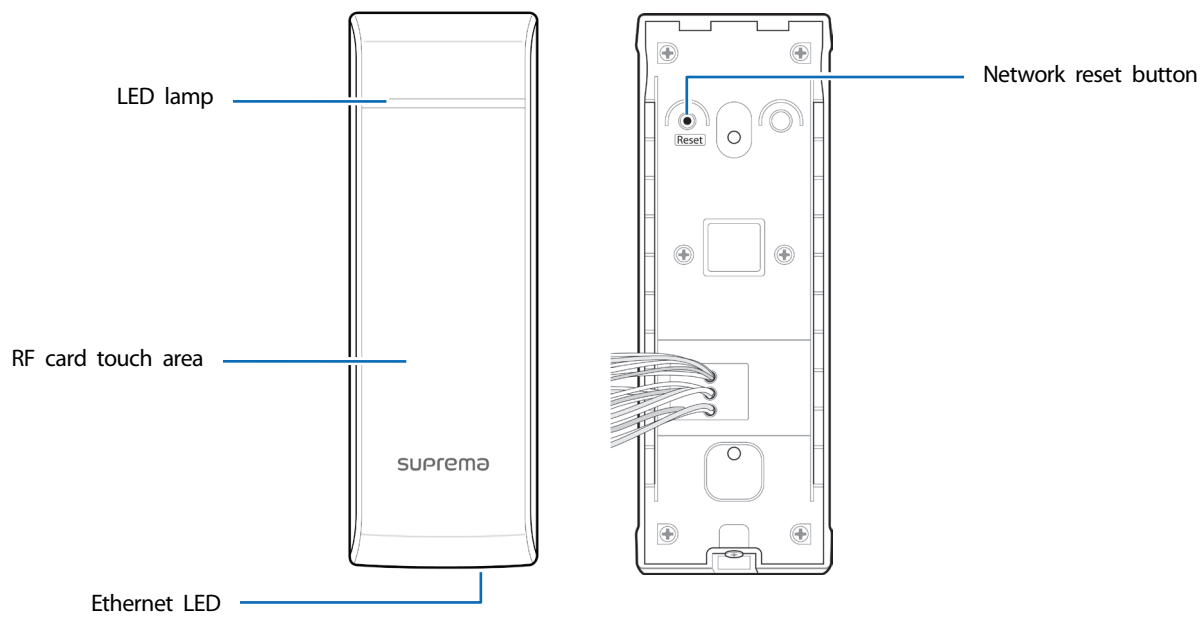

Name	Feature
LED lamp	- Green: Authentication success - Red: Authentication failure - Pink: Processing - Blue and sky-blue alternate flashing every 2 seconds: Normal operation - Red and pink alternate flashing every 2 seconds: The device is locked. - Blue and red alternate flashing every 2 seconds: The clock has been reset due to an empty internal battery. (The clock needs to be reconfigured.) - Blue and yellow alternate flashing every 2 seconds: An IP address has not been received when DHCP is set to USE. - Red flashes every 2 seconds on first use: Failure to reset. Contact the manufacturer. - Red flashes every 2 seconds in a normal operation: The device is secured. - Yellow flashes: Waiting for an input.
RF card touch area	Reads RF card for entering and exiting.
Network reset button	Resets the network configurations when the device does not work properly. For details, refer to the Resetting Network Setting .

Cables and connectors

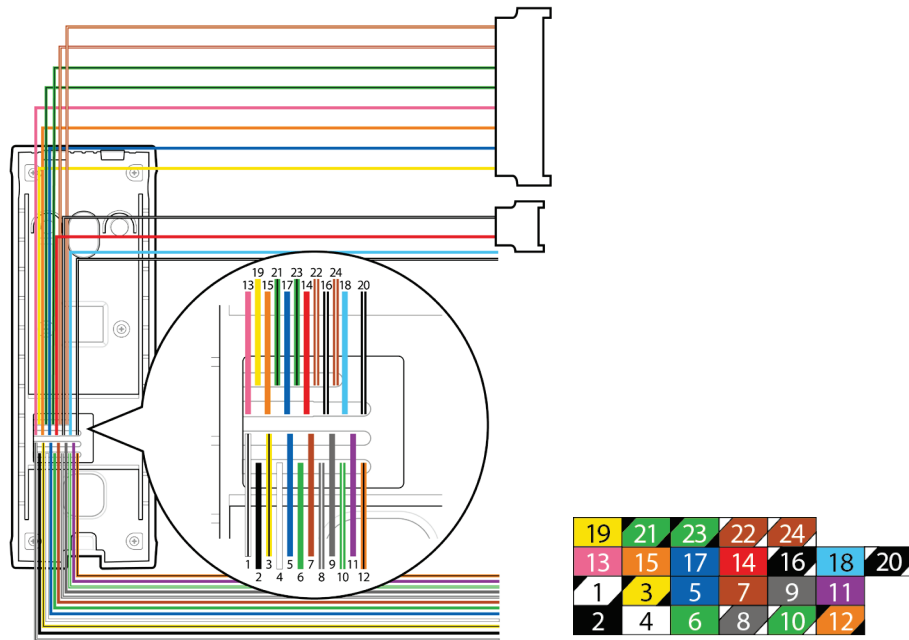


Pin	Pin name	Color
1	485 GND	White (Black stripe)
2	WG GND	Black
3	485 TRXN	Yellow (Black stripe)
4	WG D1	White
5	485 TRXP	Blue (White stripe)
6	WG D0	Green
7	TTL IN1	Brown
8	RLY NO	Gray (White stripe)
9	TTL GND	Gray
10	RLY COM	Green (White stripe)
11	TTL IN0	Purple
12	RLY NC	Orange (Black stripe)
13	ENET TXP	Pink
14	PWR +VDC	Red
15	ENET TXN	Orange
16	PWR GND	Black (White stripe)
17	ENET RXP	Blue
18	PWR OUT	Sky-blue
19	ENET RXN	Yellow
20	PWR GND	Black (White stripe)
21	VB1	Green (Black stripe)
22	VB2	Brown (White stripe)
23	VB1	Green (Black stripe)
24	VB2	Brown (White stripe)

Installation

Mounting the Bracket and Product

Installing the bracket


- 1 With the mounting screws for the bracket, mount the bracket firmly onto the surface where Xpass is to be installed.

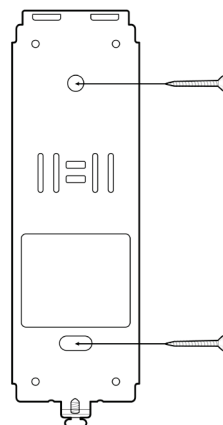


Note

If Xpass should be installed onto a concrete wall, make a hole with a drill, and then insert a PVC anchor into the hole before screwing the mounting screw.


- 2 Attach Xpass onto the mounted bracket.

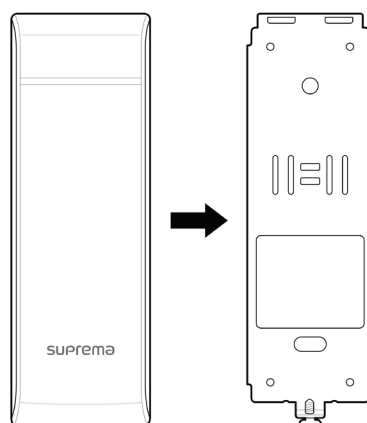

- 3 Assemble Xpass with the bracket by screwing the mounting screws on the bottom of Xpass.



Connecting to Power

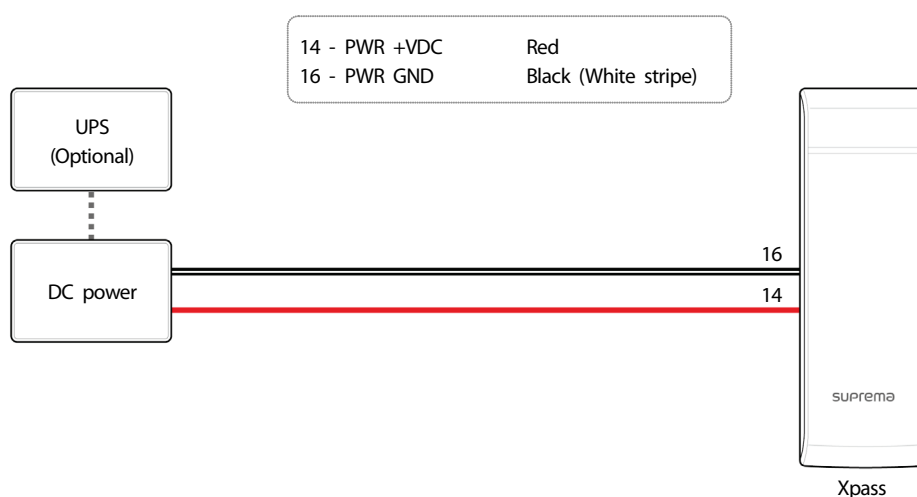

Note


- Use a power adapter that has a DC 12 V ($\pm 10\%$) specification of with the minimum current of 1,500 mA and has IEC/EN 60950-1 certification. If the power adapter is shared by other devices, the power adapter should provide a current more than the sum of the power consumption from this device (1,500 mA) and other devices.
- Use a separate power supply for Secure I/O 2, electric lock and Xpass respectively. If connecting and using the power supply to these devices together, the devices may malfunction.

Connecting to a Network

TCP/IP


LAN connection (connecting to a hub)

A normal CAT-5 cable can be used to connect to a hub.

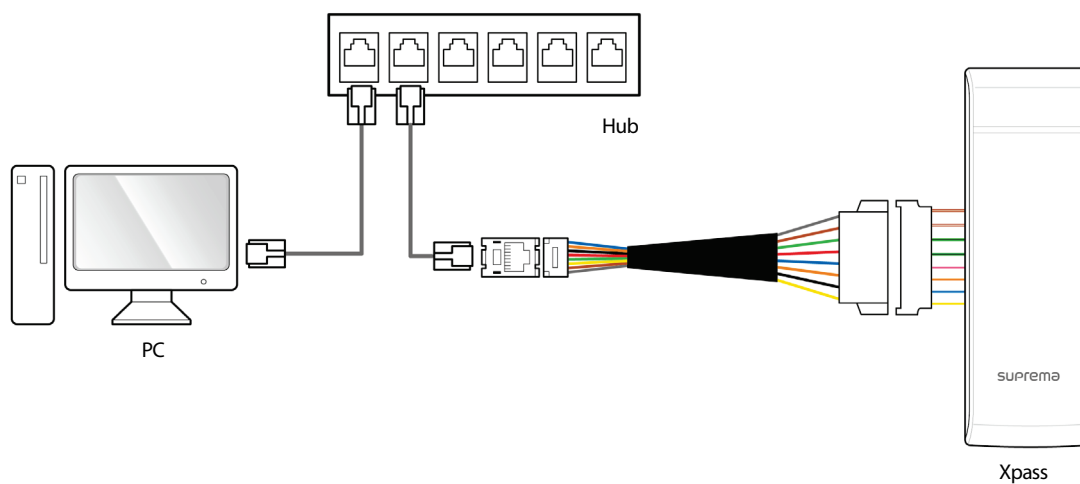


LAN connection (connecting directly to a PC)

Xpass can be connected directly to a PC by using a normal type CAT-5 cable because it supports an automatic MDI/MDIX function.

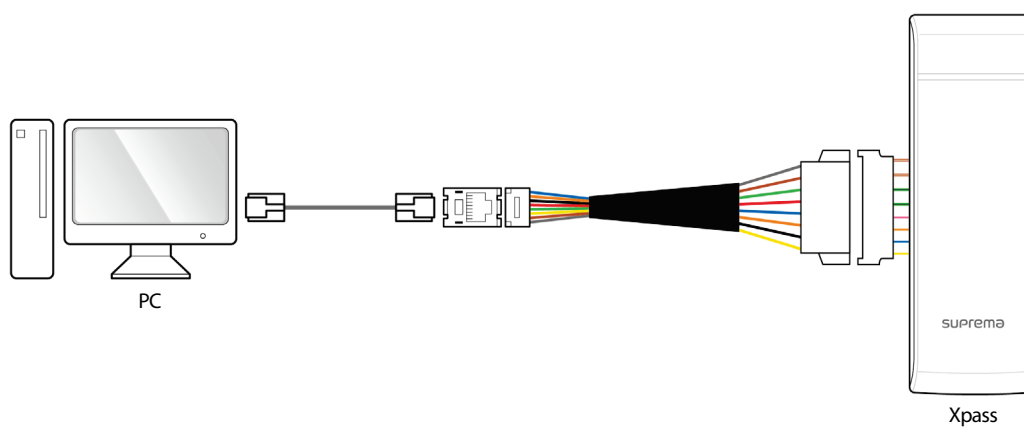


Connecting to an Door button/Door sensor

Digital input connection (Door button, Door sensor)

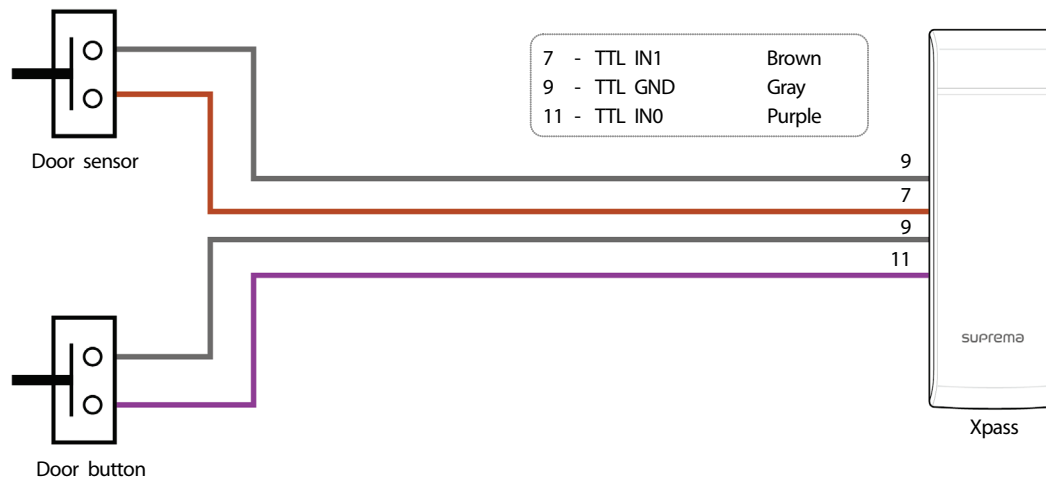


Digital input connection (Alarm, Emergency switch)

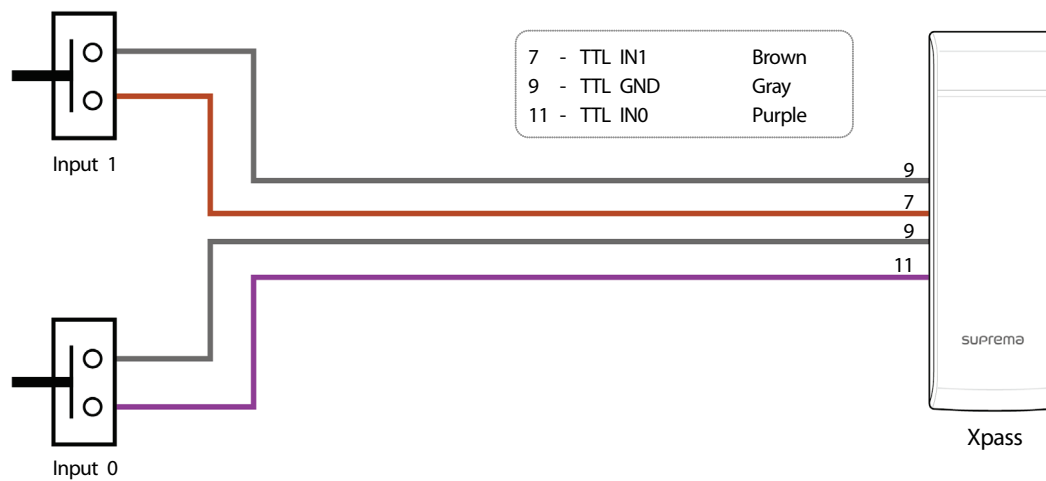

Connecting to a Relay

Fail Safe Lock

To use fail safe lock, connect N/C terminal as shown below. Normally, there is a current flowing through the relay and the door is opened when the relay is activated by blocking current flows. The door is opened when there is a blackout or power failure caused by external conditions.

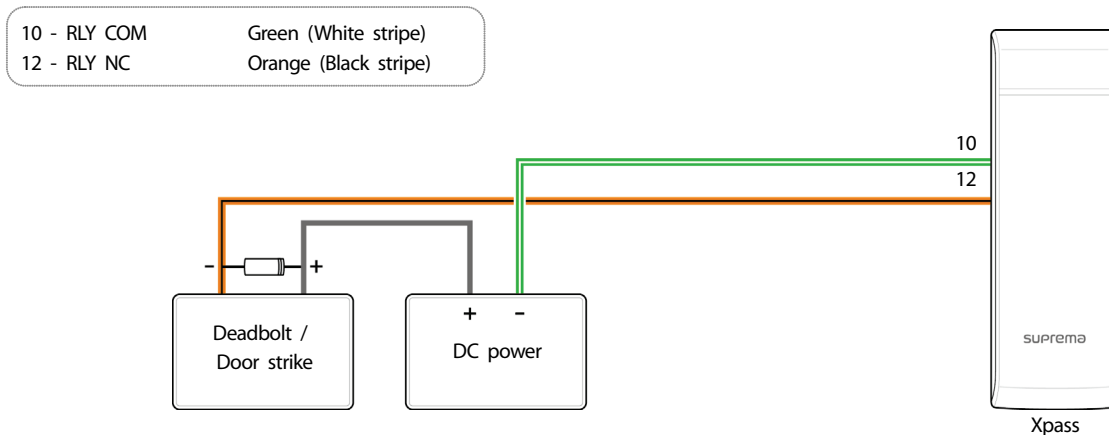


Note

- Install the diode at both ends of the wire for the door lock device as shown in the figure to protect the relay from being damaged by the reverse current induced when the door lock device operates.
- Make sure that the direction of the installed diode is correct.
- Install the diode close to the door lock device.
- Use a separate power source for Xpass from the door lock device.

Fail Secure Lock

To use fail secure lock, connect N/O terminal as shown below. Normally, there is no current flowing through the relay and the door is opened when the relay is activated by a current flows. The door is locked when there is a blackout or power failure caused by external conditions.

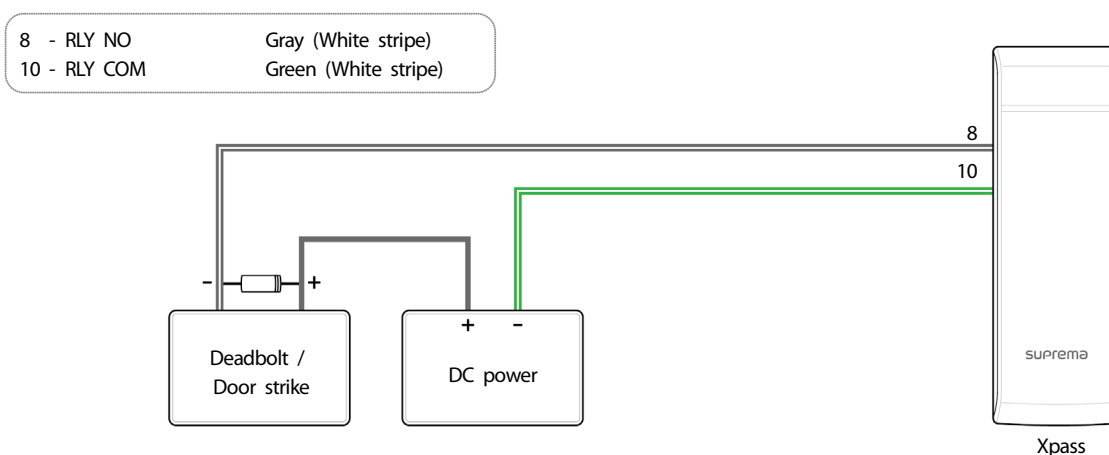


Note

- Install the diode at both ends of the wire for the door lock device as shown in the figure to protect the relay from being damaged by the reverse current induced when the door lock device operates.
- Make sure that the direction of the installed diode is correct.
- Install the diode close to the door lock device.
- Use a separate power source for Xpass from the door lock device.


Connecting to an Automatic door

- | | |
|--------------|----------------------|
| 8 - RLY NO | Gray (White stripe) |
| 10 - RLY COM | Green (White stripe) |

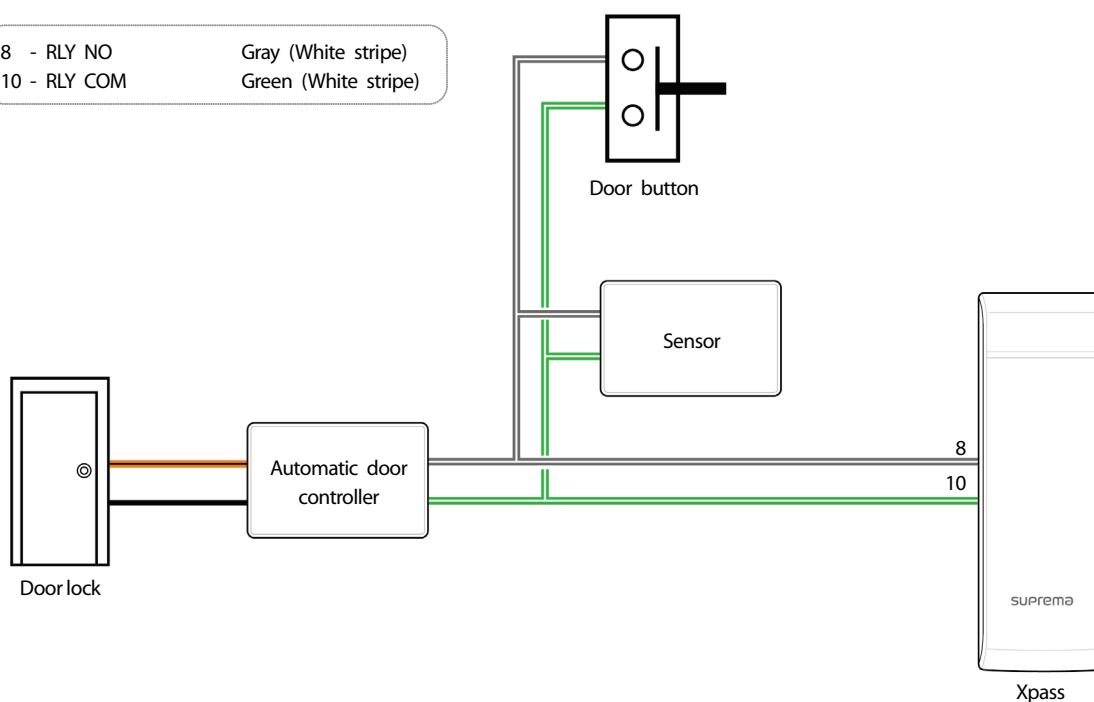

Connecting as a standalone


- | | |
|--------------|-----------------------|
| 9 - TTL GND | Gray |
| 11 - TTL IN0 | Purple |
| 7 - TTL IN1 | Brown |
| 10 - RLY COM | Green (White stripe) |
| 12 - RLY NC | Orange (Black stripe) |

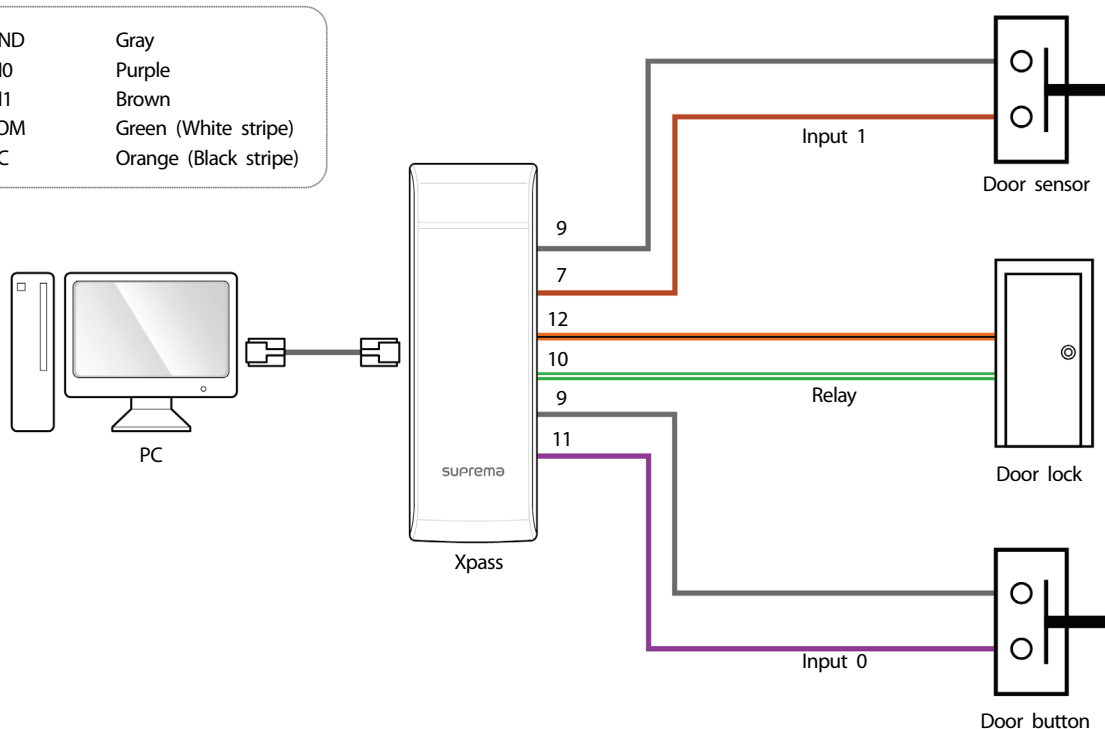


Connecting to Secure I/O 2

Refer to the following figure for connecting.


- RS-485 should be AWG24, twisted pair, and maximum length is 1.2 km.
- Connect a termination resistor (120Ω) to both ends of a RS-485 daisy chain connection. It should be installed at both ends of the daisy chain. If it is installed in the middle of the chain, the performance in communicating will deteriorate because it reduces the signal level.
- Up to 32 devices can be connected via daisy chain (1 master device and 31 other devices).

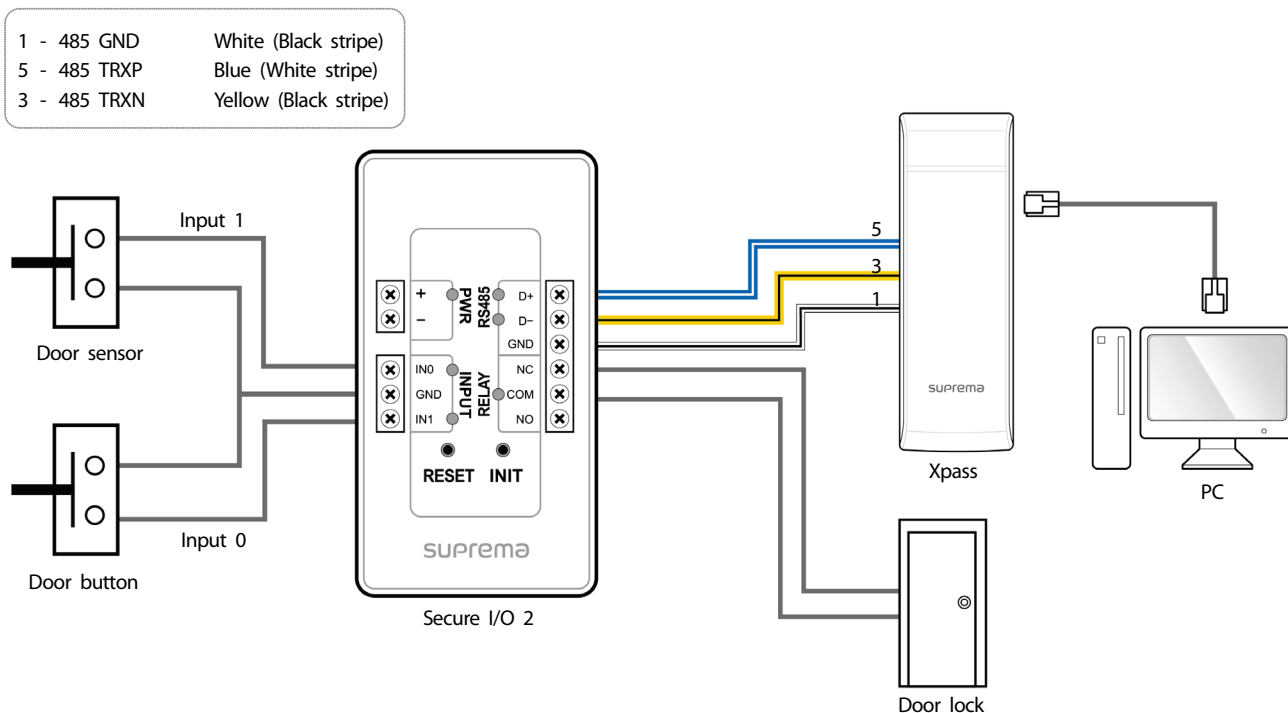

Connecting as a Wiegand device

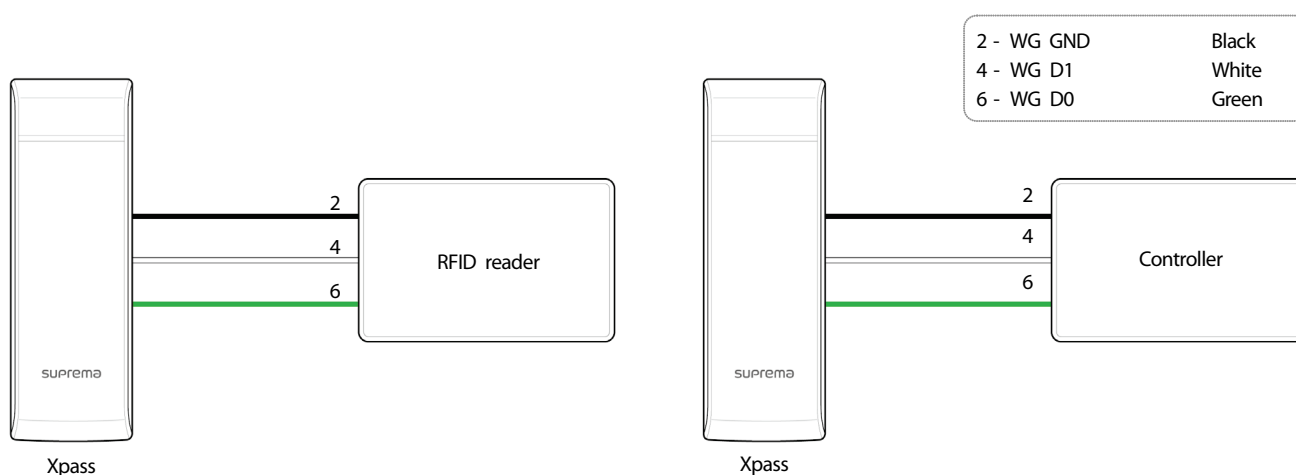

External Power Output

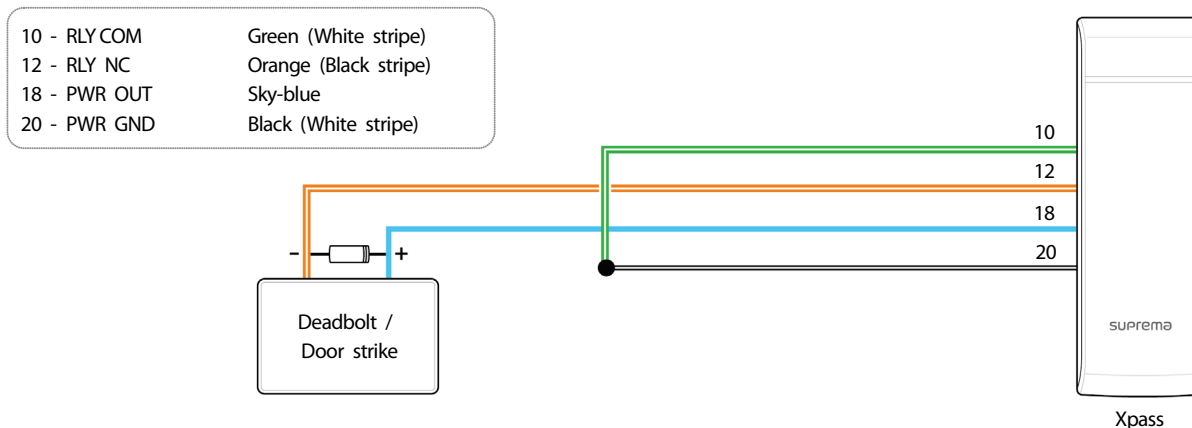

Note

- The external output provides a maximum current of 620 mA.
- Xpass connected to PoE supports the external power output.
- Be careful not to disconnect the power supply to Xpass when the external power output is connected to a door lock. Disconnecting the power supply to Xpass may cause security problems.
- The maximum switching current of the door lock should not exceed 620 mA. For more information on the maximum switching current of the door lock, contact the manufacturer.

Resetting Network Settings


- 1 Turn the power on.
- 2 Press the network reset button on the rear of device until the device restart automatically.
- 3 Connect the device with default values.
 - TCP/IP address: 192.168.0.1
 - Server mode: Not checked
 - RS-485: PC connection, 115200 bps
- 4 Change the TCP/IP address or RS-485 information.
- 5 Turn the power off later on and then check the network setting is properly.

Product Specifications

Category	Feature	Specification
Main	IP Rating	IP65
	RF Card	125KHz EM, 125KHz HID Prox, 13.56MHz Mifare/DESFire
	Multi-Controller	Yes (RF)
Capacity	Max. User (1:1)	40,000
	Max. User (1:N)	40,000
	Max. Text Log	50,000
Interface	TCP/IP	Yes
	RS-485	1ch
	Wiegand	1ch In or Out (Selectable)
	TTL Input	2 Inputs
	Relay	1 Relay
Relay	Voltage	Max. 24VDC
	Current	Typ. 0.5A, Max. 1.0A
Hardware	CPU	533MHz DSP
	Memory	16MB RAM + 8MB Flash
	LED	Multi-Color
	Sound	16-bit Hi-Fi
	Operating Temp.	-20°C ~ 50°C
	Tamper	Yes
	Power	12VDC
	PoE	Optional
	Dimensions (W x H x D mm)	45 x 130 x 27
	Certification	CE, FCC, KC, RoHS

Dimensions


(Unit: mm)

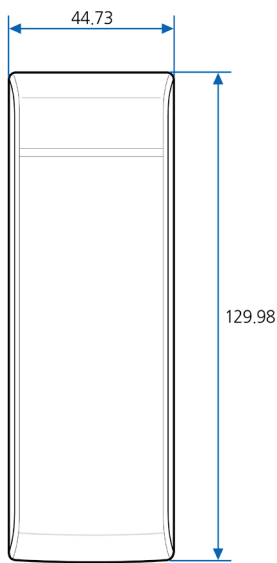


Front view



Side view

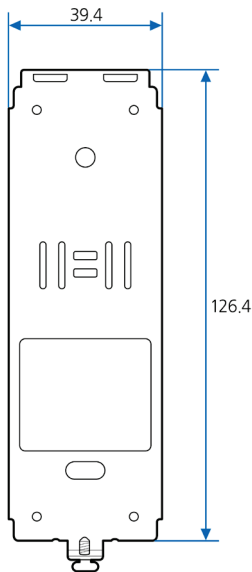

Main bracket

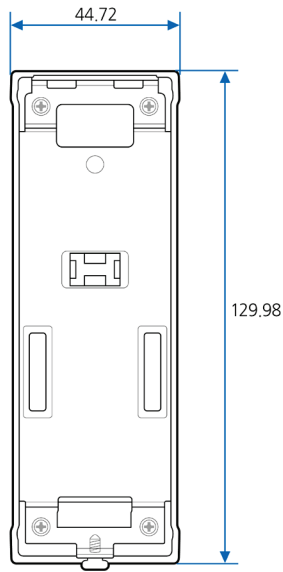

Extension bracket

FCC Compliance Information

THIS DEVICE COMPLIES WITH PART 15 OF THE FCC RULES.

Operation is subject to the following two conditions:

- (1) This device may not cause harmful interference, and
- (2) This device must accept any interference received, including interference that may cause undesired operation.

Note: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

Modifications not expressly approved by the manufacturer could void the user's authority to operate the equipment under FCC rules.

Appendix

Disclaimers

This document provides the information pertaining to Suprema's products. The right of use is granted only to the products that are covered by the sales agreement and conditions guaranteed by Suprema. Any license of intellectual property that is not dealt within this document is not granted.

Suprema does not provide any warranty or liability of fitness or merchantability for a particular purpose and of infringement of patents, copyrights, or other intellectual properties, regarding the sales or use of Suprema's products.

Do not use Suprema's products in either circumstances where people could be hurt or die as a consequence of malfunctions of the products or circumstances related to medical treatments, the rescue of lives, or life supports. If a user suffers an accident in one of the circumstances mentioned above, employees, subsidiaries, branches, partners, and distributors of Suprema are exempt from liability even when it is claimed that there is a significant fault in the design or production process, and also they are not liable for any direct or indirect cost or expenditure including legal costs.

Suprema can change the standard and specification of its products anytime without notice in order to improve the stability, functions, or design of the products. Designers should keep in mind that the functions or explanations denoted as "to be implemented" or "not defined" can be changed anytime. Suprema will implement or define such items in the shortest possible time, and will not accept any liability for problems incurred including compatibility issues.

Contact Suprema, sales representatives of Suprema, or local distributors in order to get the latest specifications before ordering products.

Copyright Notice

Suprema has the copyright of this document. The rights of other product names, brands, and trademarks belong to individuals or organizations who own them.



www.supremainc.com

Suprema Inc. 16F Parkview Office Tower, Jeongja-dong, Bundang-gu Seongnam, Gyeonggi, 463-863 Korea
Tel) +82-31-783-4502 Fax) +82-31-783-4503

Sales information sales@supremainc.com **Technical support** support@supremainc.com