

ABB TZIDC-210 Electro-Pneumatic Positioner datasheet

<http://www.manuallib.com/abb/tzidc-210-electro-pneumatic-positioner-datasheet.html>

The TZIDC-210 is an electronically configurable positioner with communication capabilities designed for mounting to pneumatic linear or rotary actuators. It features a small and compact design, a modular construction, and an excellent cost-performance ratio.

Fully automatic determination of the control parameters and adaptation to the final control element yield considerable time savings and an optimal control behavior.

ManualLib.com collects and classifies the global product instruction manuals to help users access anytime and anywhere, helping users make better use of products.

<http://www.manuallib.com>

TZIDC-210 Electro-Pneumatic Positioner

Compact, well-proven, and flexible



For PROFIBUS PA,
Flameproof enclosure

Low operating cost

Compact design

Well-proven technology and intelligence

Robust and environmentally ruggedized

Wide operating temperature range
– -40 ... 85 °C (-40 ... 185 °F)

Easy to commission, “single pushbutton” operating
philosophy

Mechanical position indicator

ATEX, FM, CSA, GOST and IECEx approvals

Contents

1	Description	3
1.1	Pneumatics.....	3
1.2	Operation.....	3
1.3	Communication	3
1.4	Modular design.....	3
2	Mounting versions	5
2.1	To linear actuators in accordance with the standard	5
2.2	To rotary actuators in accordance with the standard	5
2.3	Integral mounting to control valves	5
2.4	Special actuator-specific mounting	5
3	Operation	7
3.1	General.....	7
3.2	Operator panel	8
4	Communication	9
4.1	General.....	9
4.2	PROFIBUS PA	9
4.3	Benefits of PROFIBUS communication.....	9
4.4	Positioner for PROFIBUS PA.....	9
4.5	Device management for TZIDC-210	9
5	Specifications	10
5.1	Communication	10
5.2	Designation	10
5.3	Output.....	10
5.4	Travel.....	10
5.5	Air supply.....	10
5.6	Transmission data and influences.....	10
5.7	Environmental capabilities	11
5.8	Housing	11
5.9	Options	11
5.10	Accessories	12
6	Ex relevant specifications	13
6.1	ATEX / GOST Russia / GOST Ukraine	13
6.2	IECEX	14
6.3	FM/CSA.....	15
7	Electrical connections	19
8	Dimensions	21
9	Ordering information	24
9.1	Accessories	26

1 Description

The TZIDC-210 is an electronically configurable positioner with communication capabilities, mounting to pneumatic linear or rotary actuators. It features a small and compact design, a modular construction, and an excellent cost-performance ratio.

Fully automatic determination of the control parameters and adaptation to the final control element yield considerable time savings and an optimal control behavior.

1.1 Pneumatics

An I/P module with subsequent pneumatic amplifier is used to control the pneumatic actuator. The well-proven I/P module proportionally converts the permanent electrical positioning signal from the CPU into a pneumatic signal used to adjust a 3/3-way valve.

The air flow for pressurizing or depressurizing the actuator is continuously adjusted. As a result, excellent control is achieved. When reaching the set point, the 3/3-way valve is closed in center position to minimize the air consumption.

Four different pneumatics versions are available: for single-acting or double-acting actuators, each with "fail-safe" or "fail-freeze" function.

1.1.1 "Fail-safe" function

If the electrical power supply fails, the positioner output 1 is depressurized, and the pneumatic actuator's return spring moves the valve to the defined safe position. In case of a double-acting actuator the second output 2 is additionally pressurized.

1.1.2 "Fail-freeze" function

If the electrical power supply should fail, the positioner output 1 (and 2, if applicable) is closed and the pneumatic actuator stops ("freezes") the valve in the current position. If compressed air supply should fail, the positioner depressurizes the actuator.

1.2 Operation

The positioner has a built-in operating panel providing a 2-line LCD and 4 pushbuttons for optimal local configuration, commissioning and operational monitoring.

Alternatively, the appropriate configuration program and the available communication option can be used.

1.3 Communication

Communication with the TZIDC-210 positioner occurs via PROFIBUS PA.

1.4 Modular design

The TZIDC-210 basic model can be enhanced at any time by retrofitting optional equipment. Option modules for analog or digital position feedback or a shutdown-module can be installed. Additionally, a mechanical position indicator, proximity switches or 24 V microswitches are available for indicating the position independently of the mother board function.

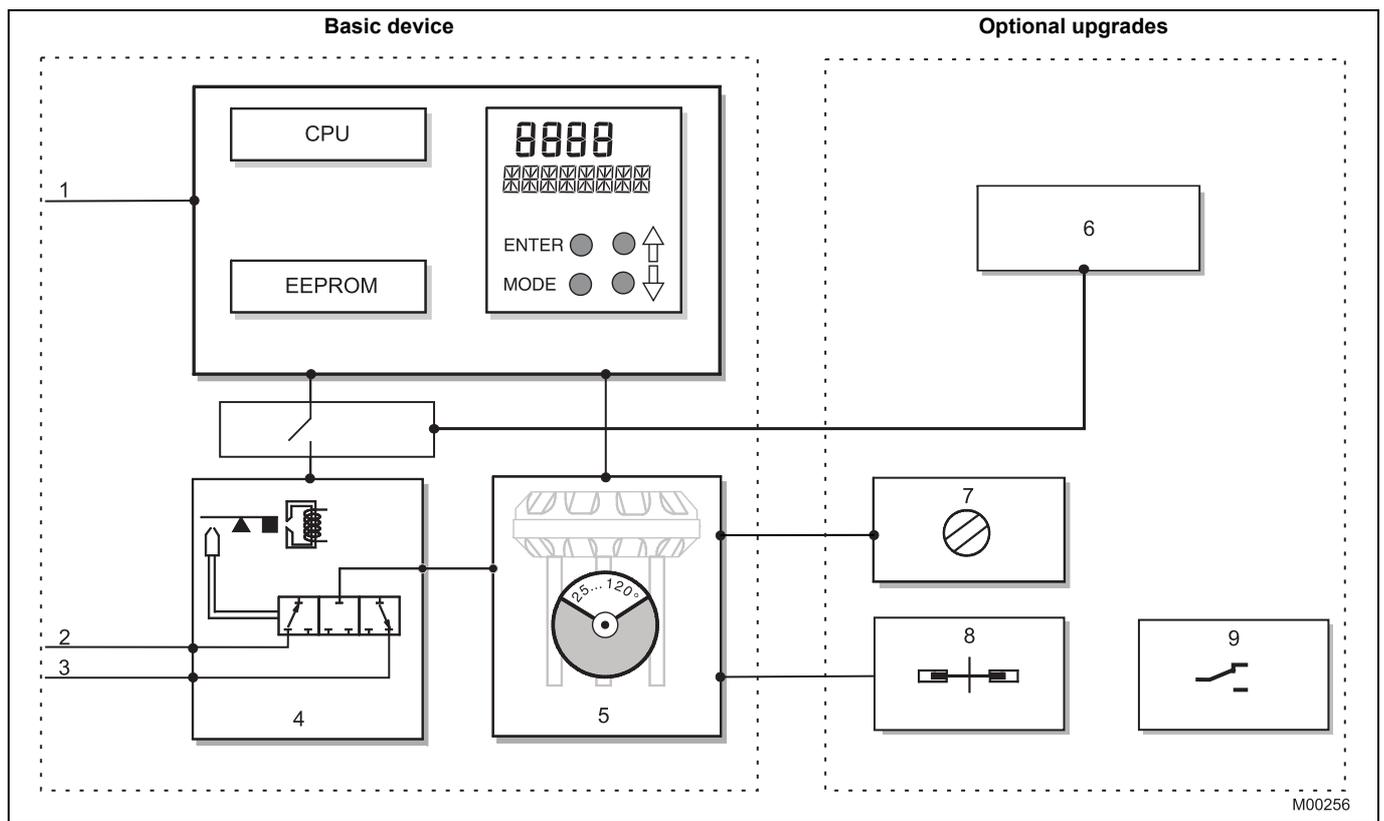


Fig. 1: schematic representation of the TZIDC-210

Basic device

- 1 Bus connector
- 2 Supply air, 1.4 ... 6 bar
- 3 Exhaust air
- 4 I/P module with 3/3-way valve
- 5 Displacement sensor (optional up to 270° rotation angle)

Optional upgrades

- 6 Plug-in module for safety shutdown (forced depressurization)
- 7 Mechanical position indicator
- 8 Mechanical feedback with proximity switches
- 9 Mechanical feedback with 24 V microswitches



IMPORTANT (NOTE)

With the optional upgrades, either the "mechanical feedback with proximity switches" (no. 8) or the "mechanical feedback with 24 V microswitches" (no. 9) can be used.

2 Mounting versions

2.1 To linear actuators in accordance with the standard

Lateral attachment is in accordance with DIN / IEC 534 (lateral attachment to NAMUR). The required attachment kit is a complete set of attachment material, but does not include the screwed pipe connections and air pipes.

2.2 To rotary actuators in accordance with the standard

This attachment is designed for mounting according to the standard VDI / VDE 3845. The attachment kit consists of a console with mounting screws for mounting on a rotary actuator. The adapter for coupling the positioner feedback shaft to the actuator shaft has to be ordered separately. Screwed pipe connections and air pipes have to be provided on site.

2.3 Integral mounting to control valves

The TZIDC-210 positioner featuring standard pneumatic action is available as an option for integral mounting.


The required holes are found at the back of the device.

The benefit of this design is that the point for mechanical stroke measurement is protected and that the positioner and actuator are linked internally. No external tubing is required.

2.4 Special actuator-specific mounting

In addition to the mounting methods described above, there are special actuator-specific attachments.

Please contact us for details.

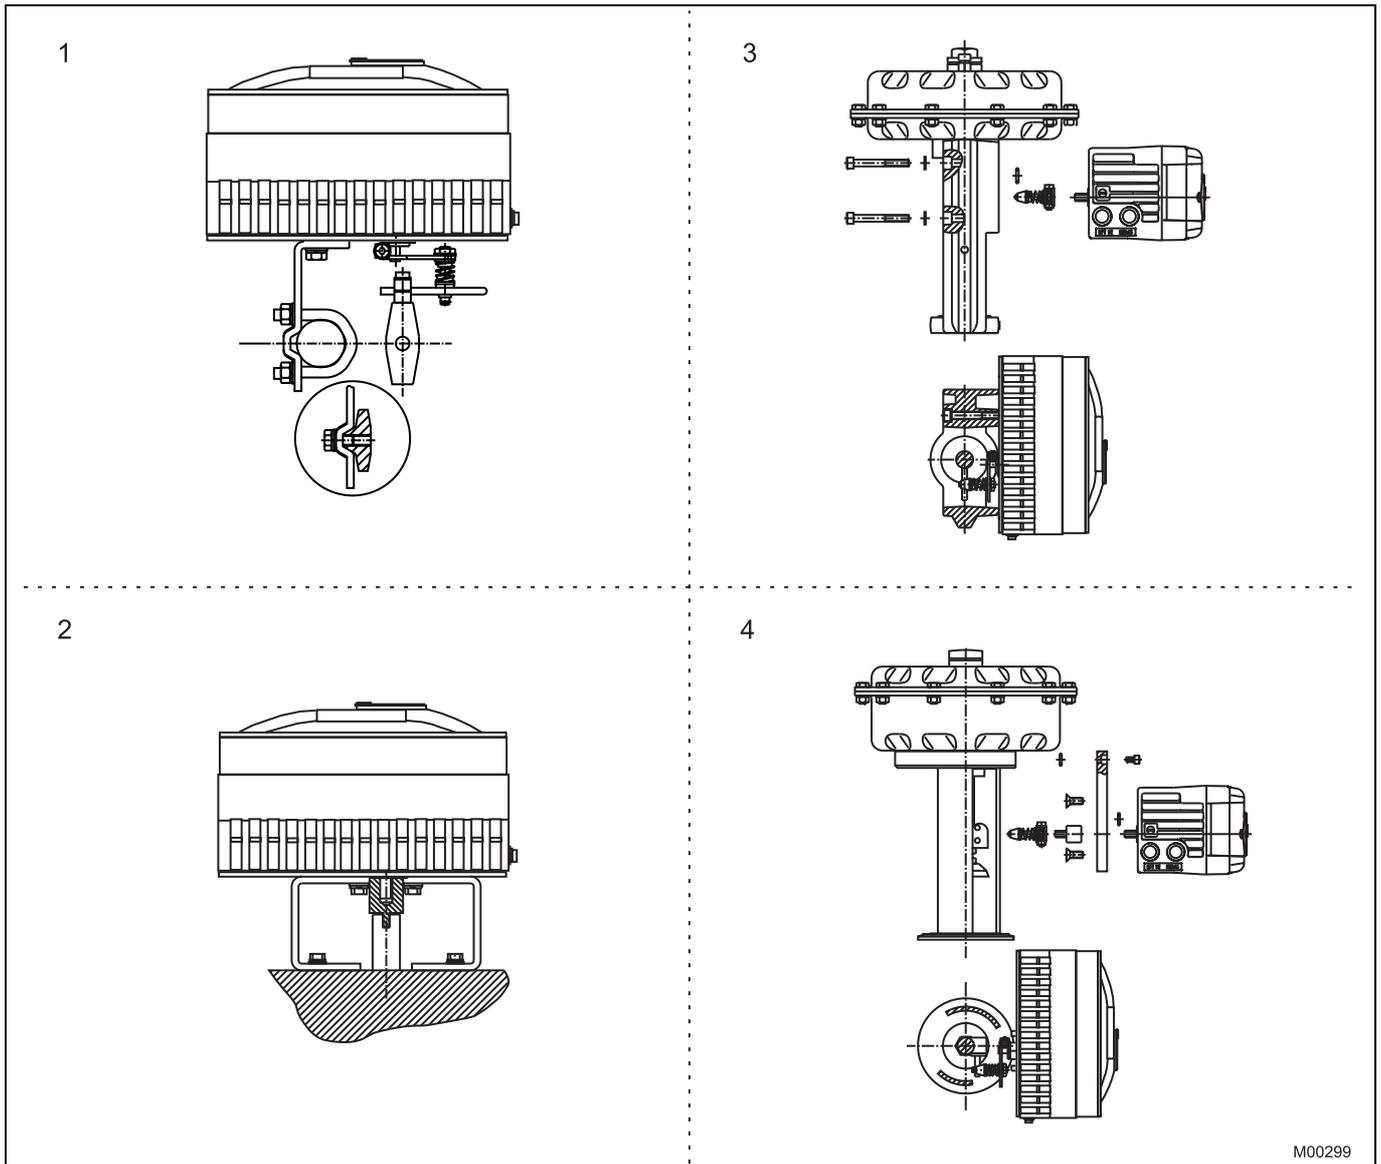

M00299

Fig. 2: Mounting options

- 1 Mounting to linear actuators acc. to DIN / IEC 534
- 2 Mounting to rotary actuators to VDI / VDE 3845

- 3 Integral mounting to control valves
- 4 Integral mounting to control valves by using an adapter panel

3 Operation

3.1 General

Microprocessor-based position control in the TZIDC-210 provides for optimal results. The positioner features high-precision control functions and high operational reliability. Due to their elaborate structure and easy accessibility, the device parameters can be quickly adapted to the respective application.

The total range of parameters includes:

- Operating parameters
- Adjustment parameters
- Monitoring parameters
- Diagnosis parameters
- Maintenance parameters

3.1.1 Operating parameters

Signal range 0 ... 100%

Subranges are configurable, min. range 20 %
Recommended range > 50 %

Action (positioning signal)

Increasing: Positioning signal 0 ... 100 % = direction 0 ... 100 %
Increasing: Positioning signal 0 ... 100 % = direction 100 ... 0 %

Characteristic curve (travel = f {signal})

Linear, equal percentage 1:25 or 1:50 or 25:1 or 50:1 or freely configurable with 20 reference points.

Travel limit

The positioning travel, i.e. the stroke or angle of rotation, can be reduced as required within the full range of 0 ... 100 %, provided that a minimum value of 20 % is observed.

Shut-off function

This parameter can be set separately for each end position. When the respective configured limit value is exceeded, the shut-off function causes immediate travel of the actuator until reaching the set end position.

End Position Behavior

Selection option for behavior when moving into the end position. Either the positioner additionally pressurizes the actuator and reaches full actuating force in the end position, or it continues to control the actuator in the end position and pressurizes the actuator only as much as is required to maintain the position.

Travel time prolongation

This function can be used to increase the max. travel time for full travel. This time parameter can be set separately for each direction.

i **IMPORTANT (NOTE)**
This function can only be used with the pneumatics with the safety function "fail-safe".

Switching points for the position

This parameter allows you to define two position limits for signaling (see option "Module for digital position feedback").

3.1.2 Adjustment parameters

The TZIDC-210 positioner has a special function for automatic adjustment of the parameters.

Additionally, the control parameters can be set manually to optimally adapt them to the process requirements.

Tolerance band

When reaching the tolerance band the position is considered as corrected. From this point on, the position is further slowly re-adjusted until the dead band is reached. The factory setting for this parameter is 0.3 %.

Dead band (sensitivity)

When reaching the dead band, the position is held. The factory setting for this parameter is 0.1 %.

Actuator spring action

Selection of the sensor shaft rotating sense (looking into the open case), if the valve is moved to the safe position by the actuator spring (actuator is depressurized via Y1/OUT1).

For double-acting actuators the actuator spring action corresponds to pressurizing the pneumatic output (OUT2).

Display 0 ... 100 %

Adjusting the display (0 ... 100%) according to the direction of action for opening or closing the valve.

3.1.3 Monitoring parameters

Various functions for permanent operational monitoring are implemented in the TZIDC-210 operating program, e.g.:

- Internal positioning time-out
- Sensor monitoring
- Backup monitoring

While automatic commissioning is in progress, the current state is continuously indicated on the integrated LCD. Remaining messages can be retrieved via the user interface.

The fieldbus enables users to implement enhanced monitoring in the control system. A special window displays the most important process variables ONLINE such as the positioning signal (in %), the position (in %), the control deviation (in %) as well as the status messages.

3.1.4 Diagnosis parameters

The diagnosis parameters of the TZIDC-210 program inform the operator about the operating conditions of the valve.

From this information the operator can derive which maintenance works are required, and when.

Additionally, limit values can be defined for these parameters. When they are exceeded, an alarm is reported.

The following values are e.g. determined:

- Number of movements performed by the valve
- Total travel

The diagnostic parameters and limit values can be called up, set and reset using the configuration program.

3.2 Operator panel

The TZIDC-210 positioner's operator panel with four pushbuttons allows for

- operational monitoring
- manual control
- configuration
- fully automatic commissioning

The operator panel is protected by a hinged cover which can be opened during operation even in hazardous areas, i.e. the positioner can be locally operated any time as required.

3.2.1 Single-button commissioning

Commissioning the TZIDC-210 positioner is especially easy. The standard Autoadjust function for automatic adaptation of the device parameters can be started by simply pressing a single front panel button, and without knowing parameterization details.

Depending on the selected actuator type (linear or rotary), the displayed zero position is automatically adapted:

- for linear actuators counter-clockwise (CTCLOCKW)
- for rotary actuators clockwise (CLOCKW).

Besides this standard function, a customized "Autoadjust" function is available. The function is launched either via the operator's panel or the configuration program.

3.2.2 Display

The information indicated by the 2-line LCD is permanently updated and adapted during operation, to inform the operator in an optimal way.

During control operation the following TZIDC-210 data can be called up by pressing the pushbuttons briefly:

Up button	Cyclic communication:
	- Setpoint (%)
	- Setpoint status
	Acyclic communication:
	- Status of communication
Down button	Operating mode on the bus and bus address
Enter	Software Version



Fig. 3: TZIDC-210 with removed cover, view of the operator panel

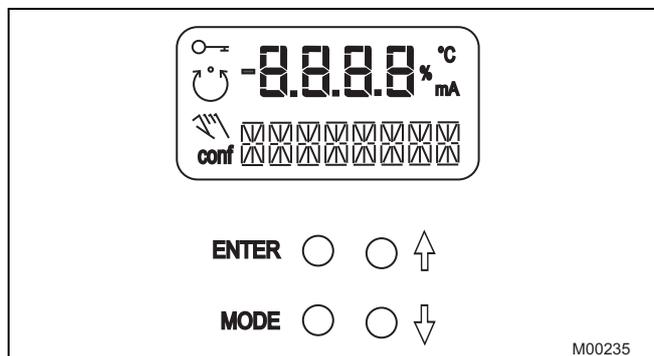


Fig. 4: TZIDC-210 operating elements and display

4 Communication

4.1 General

PROFIBUS is a manufacturer-independent, open fieldbus standard for use in the manufacturing industry and process automation. It is ideally suited for time-critical applications with high transmission rates as well as for complex communication activities. The flexible structure allows the mechanical mount and transmission speed to be easily adapted to the specific application. A standard communication protocol is used on a universal basis.

4.2 PROFIBUS PA

PROFIBUS PA was developed primarily for process automation solutions.

The transmission method (physical layer in the ISO/OSI model) complies with IEC 61158. The power supply for the field devices is provided concurrent with signal transmission via the fieldbus line. PROFIBUS PA is also suited for use in explosion-proof installations.

4.3 Benefits of PROFIBUS communication

- Standardized device profiles ensure interoperability of devices from various manufacturers
- Acyclic access to device data (even during operation) for configuration, diagnostics and service
- High system uptimes based on comprehensive device and bus diagnostics as well as default value strategies in the event of an error
- Support for efficient facility management through provision of operating values

4.4 Positioner TZIDC-210 for PROFIBUS PA

The TZIDC-210 positioner complies with the Profibus PA profile for process devices "Electro-pneumatic actuators V3.0". This ensures interoperability in connection with third-party control systems.

In conformance with PROFIBUS conventions, data can be output during cyclic data transfer in operating modes AUT, MAN or RCAS and can be written in operating mode O/S (out-of-service).

Newly set parameters are saved in the non-volatile memory directly upon download to the device, and become active immediately.

4.5 Device management for TZIDC-210

For the TZIDC-210, a graphic user interface known as the "DTM" is available. The DTM is based on FDT/DTM technology (FDT 1.2) and can be integrated in a control system as well as a separate PC with the DVS401 configuration software (SMART VISION). The device can thus be commissioned, operated and serviced from a single user interface.

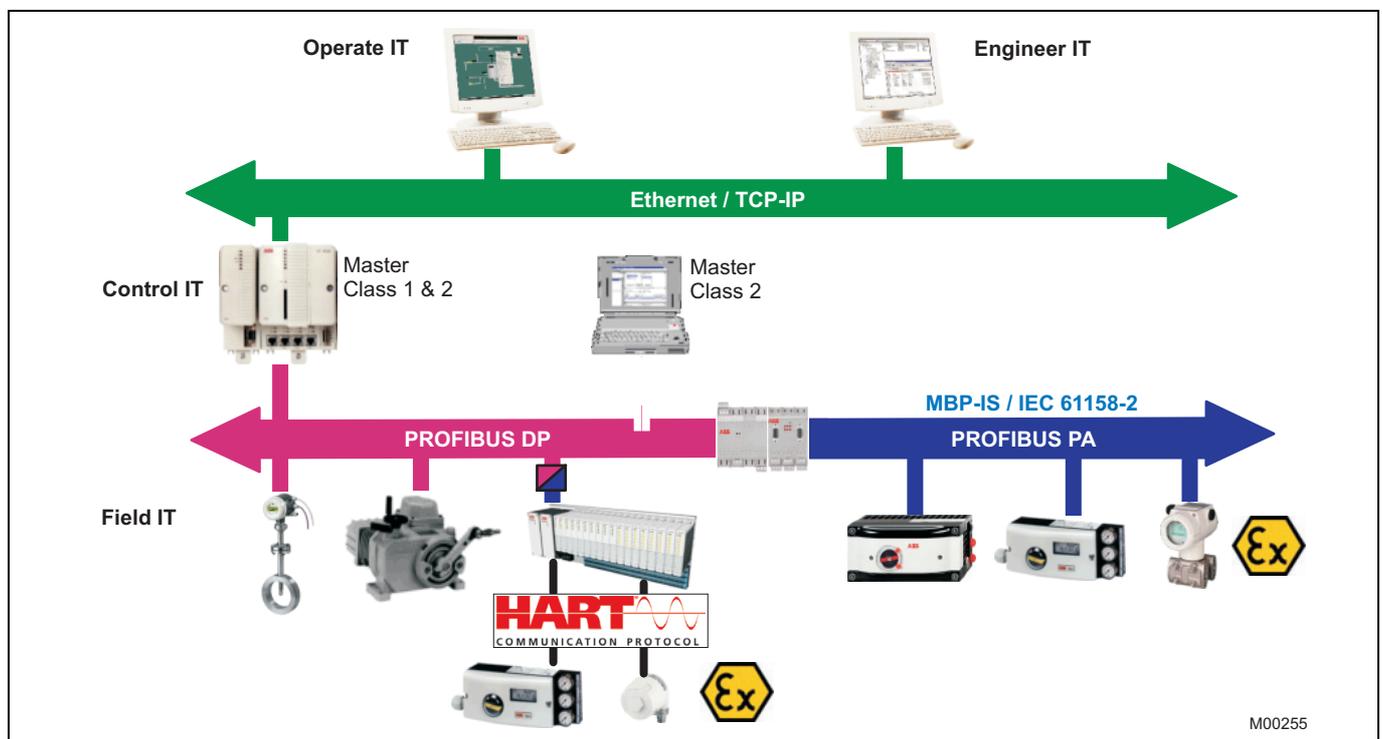


Fig. 5: Communication via PROFIBUS

5 Specifications

5.1 Communication

Profiles	Profibus PA profile for process devices
Block types	Electro-pneumatic actuators V3.0 1 AO Functional block 1 Transducer block 1 physical block
Physical Layer	In compliance with IEC 61158-2
Transmission rate	31.25 Kbit/s
Supply voltage	Power feed from the PA bus, 9.0 ... 32.0 V DC
Max. permissible voltage	35 V DC
Power consumption	10.5 mA
Current in the event of an error	15 mA (10.5 mA + 4.5 mA)

5.2 Designation

Device name	TZIDC-X10
PNO ID no.	0x0639
Dev. ID	0X3200028xyz
Bus address	Between 0 and 126, default address 126

5.3 Output

Range	0 ... 6 bar (0 ... 90 psi)
Air capacity	at 1.4 bar (20 psi) supply pressure 5.0 kg/h = 3.9 Nm ³ /h = 2.3 scfm at supply pressure of 6 bar (90 psi) 13 kg/h = 10 Nm ³ /h = 6.0 scfm
Output function	For single or double-acting actuators, air is vented from actuator or actuator is blocked in case of (electrical) power failure
Shut-off values	end position 0 % = 0 ... 45 % end position 100 % = 55 ... 100 %

5.4 Travel

Rotation angle	
Used range	
25 ... 120°	rotary actuators, optionally 270°
25 ... 60°	linear actuators
Travel time prolongation	
Setting range	0 ... 200 seconds, separately for each direction

5.5 Air supply

Instrument air	free of oil, water and dust acc. to DIN / ISO 8573-1 pollution and oil content according to Class 3 (purity: max. particle size: 5 µm, max. particle density: 5 mg / m ³ ; oil content: max. concentration: 1 mg / m ³ ; pressure dew point: 10 K below operating temperature
Supply pressure	1.4 ... 6 bar (20 ... 90 psi)

i IMPORTANT (NOTE)

Do not exceed the maximum operating pressure of the actuator!

Air consumption	< 0.1 kg/h / 0.05 scfm (independent of supply pressure)
------------------------	---

5.6 Transmission data and influences

Output Y1	
Increasing:	Increasing output signal 0 ... 100 % Increasing pressure at output Y1
Decreasing:	Increasing output signal 0 ... 100 % Decreasing pressure at output Y1

Characteristic deviation	≤ 0,5 %
Tolerance band	0.3 ... 10 %, adjustable
Dead band	0,1 ... 10 %, adjustable
Resolution (A/D conversion)	> 16000 steps
Sample rate	20 ms
Influence of ambient temperature	≤ 0.5 % per 10 K
Influence of vibration	≤ ± 1 % to 10 g and 80 Hz

Seismic requirements

Meets requirements of DIN / IEC 68-3-3 Class III for strong and strongest earthquakes.

Influence of mounting orientation

Not measurable.

Meets the requirements of the following directives

- EMC Directive 2004/108/EC
- EC Directive for CE conformity marking

5.7 Environmental capabilities

Ambient temperature

For operation, storage and transport: -40 ... 85 °C (-40 ... 185 °F)
When using proximity switches SJ2-S1N (NO): -25 ... 85 °C (-13 ... 185 °F)

Relative humidity

Operational (with closed housing and air supply switched on): 95 % (annual average), condensation permissible
Transport and storage: 75 % (annual average), non-condensing

5.8 Housing

Material/IP rating

Aluminum with ≤ 0.1 % copper, IP rating: IP 65 (optional IP 66)/NEMA 4X

Surface/color

Electrostatic dip painting with epoxy resin; stove-hardened.
Housing painted matt black, RAL 9005; housing cover: Pantone 420.

Electrical connections

Screw terminals: Max. 1.0 mm² (AWG 17) for options
Max. 2.5 mm² (AWG 14) for bus connection

i IMPORTANT (NOTE)

Do not expose the terminals to mechanical strain!

Four thread combinations for cable entry and pneumatic connection

- Cable: thread 1/2-14NPT, air pipe: thread 1/4-18 NPT
- Cable: thread M20 x 1,5, air pipe: thread 1/4-18 NPT
- Cable: thread M20 x 1,5, air pipe: thread G 1/4
- Cable: thread G 1/2, air pipe: thread Rc 1/4

(Optional: with cable gland(s) and blind plugs as necessary)

Weight

3,0 kg (1,36 lb)

Mounting orientation

Any

Dimensions

See "Dimensions"

5.9 Options

Module for the emergency shutdown function

Supply voltage: 24 V DC (20 ... 30 V DC)
(electrically isolated from input signal)
Safe position is activated when: Voltage < 5 V
Explosion protection: see certificate (operating instructions)

A separate 24 V DC signal is normally applied to the emergency shutdown module, which connects through the signal from the microprocessor to the I/P module.

When the 24 V DC signal is interrupted, the pneumatic module executes the respective safety function, depending on the mechanical construction:

The positioner output Y1 is depressurized, and the valve is moved to the safe position. In case of a double-acting actuator the second output Y2 is additionally pressurized.

i IMPORTANT (NOTE)

The emergency shutdown module can only be used with pneumatics with the safe position "fail-safe".

The emergency shutdown module works independently of the mother board, i.e. all information from the final control element is available in the supervisory process control system at any time.

Digital position feedback with proximity switches¹⁾

Two proximity switches for independent position signaling. Switching points adjustable between 0 ... 100%

Current circuits acc. to DIN 19234 / NAMUR

Supply voltage: 5 ... 11 V DC
Signal current < 1 mA: Switching state logical "0"
Signal current > 2 mA: Switching state logical "1"

Direction of action (logical state)

Proximity switch	Position			
	< Lim. 1	> Lim. 1	< Lim. 2	> Lim. 2
SJ2-SN (NC)	0	1	1	0
SJ2-S1N (NO)	1	0	0	1

i IMPORTANT (NOTE)

When using SJ2_S1N (NO), the TZIDC positioner may only be used at an ambient temperature range from -25 ... 85 °C.

Digital position feedback with 24 V microswitches¹⁾

Two microswitches for independent position signaling. Switching points adjustable between 0 ... 100 %.

Voltage: max. 24 V AC / DC
Load rating: max. 2 A
Contact surface: 10 µm Gold (AU)

Mechanical position indicator

Indicator disk in enclosure cover, linked with positioner feedback shaft through magnetic coupling.

i IMPORTANT (NOTE)

These options are also available for retrofitting by Service.

- 1) The proximity switches or 24 V microswitches for digital feedback are activated directly via the positioner axis and can only be used in combination with the optionally available mechanical position indicator.

5.10 Accessories

Mounting material

- Attachment kit for linear actuators to DIN/IEC 534 / NAMUR
- Attachment kit for rotary actuators to VDI / VDE 3845
- Attachment kit for integral mounting to control valves
- Attachment kit for actuator-specific attachment upon request

Pressure gauge block

- With pressure gauges for supply and output pressure.
- Pressure gauges with housing \varnothing 28 mm (1.1 inch), with connection block in aluminum, black
- Installation material for mounting on positioner

Filter regulator

All metal version in brass, varnished black, bronze filter element (40 μ m) and condensate drain.

Max. pre-pressure 16 bar (232.06 psi), output adjustable to 1.4 ... 6 bar (20 ... 90 psi)

PC software for configuration and operation

DSV401 (SMART VISION) with DTM available on CD-ROM

6 Ex relevant specifications

6.1 ATEX / GOST Russia / GOST Ukraine

6.1.1 Flameproof enclosure

Designation:	II 2 G Ex d IIC T4/T5/T6
Type Examination Test Certificate:	DMT 02 ATEX E 029 X
Type:	TZIDC-200 Doc. 901132
Device class:	II 2 G
Standards:	EN 60079-0: 2009 EN 60079-1: 2007

Special conditions for ATEX, flameproof enclosure



DANGER – risk of explosion

Hot parts inside the housing may pose a risk of explosion.

Never open the device immediately after switch-off. Always wait at least four minutes before opening the device!

- Prior to final installation, the operator must decide how the device is to be used, either:
 - as a device featuring the "Ex i" type of protection; or
 - as a device with the "Ex d" type of protection.
 The selected type of use must be permanently marked on the name plate.
 Specific conditions of the surrounding environment, such as chemical corrosion, must be taken into account when affixing the permanent mark. Only the manufacturer may change the selected type of use following a re-examination
- Variants that, according to declarations, also meet the requirements for the "intrinsically safe" type of protection may no longer be used as "intrinsically safe" if they have been previously used as a flameproof type of protection
- Manipulation of the device in any form by the user is not permitted. Only the manufacturer or an explosion protection specialist may modify the device
- The IP 65 / NEMA 4x IP rating is only achieved if the splash guard is screwed in place. Devices must never be operated without the splash guard
- The device may only be operated using instrument air that is free from oil, water and dust. Flammable gases, oxygen or oxygen-enriched gases must not be used
- Medium strength adhesive must be used to secure the cable entries and line entries and stop them from twisting and self-loosening
- In the event of high torsional forces resulting from wear to the shaft for the position pickoff (significant control deviation), the bearing sleeves must be replaced
- If the positioner is operated at an ambient temperature of above 60 °C (140 °F) or below -20 °C (-4 °F), ensure that the cable entries and lines in use are suitable for an operating temperature that corresponds to the maximum ambient temperature increased by 10 K, or the minimum ambient temperature



NOTICE – damage to parts!

If the sealing surface is damaged, "Ex d" explosion protection is no longer guaranteed. Handle the housing cover carefully. Place the housing cover only on a smooth and clean surface!

6.1.2 Operation as intrinsically safe equipment

Designation:	II 2 G Ex ia IIC T6 resp. T4 Gb II 2 G Ex ib IIC T6 resp. T4 Gb II 3 G Ex ic IIC T6 resp. T4 Gc
Type-Examination Test Certificate:	TÜV 02 ATEX 1831 X
Type:	TZIDC-210
Standards:	EN 60079-0:2009 EN 60079-11:2007 EN 60079-27:2008

Temperature class	Ambient temperature range
T4	-40 ... 85 °C
T5	-40 ... 50 °C
T6 ¹⁾	-40 ... 40 °C

- 1) When using the "digital feedback" plug-in module in temperature class T6, the maximum permissible ambient temperature range is -40 ... 35 °C (-40 ... 95 °F)

Electrical data for ia/ib/ic for groups IIB/IIC

With the intrinsically safe Ex i IIC type of ignition protection, only for connection to a certified FISCO power supply unit or a barrier, i.e., a power supply unit with maximum values according to the following table:

Signal circuit (Terminal +11 / -12)	Voltage = 24 V Current = 250 mA Output = 1.2 W Characteristic curve = linear $L_i < 10 \mu\text{H}$ $C_i < 5 \text{ nF}$
--	---

With the intrinsically safe Ex i IIC type of ignition protection, only for connection to a certified intrinsically safe circuit with max. values:

Shutdown contact input (Terminal +85 / -86)	$U_i = 30 \text{ V}$ $C_i = 3.7 \text{ nF}$ L_i negligibly small
Mechanical digital feedback ²⁾ (Terminals Limit1 +51 / -52 or Limit2 +41 / -42)	For max. values, see EC type examination test certificate number PTB 00 ATEX 2049 X

- 2) When using SJ2_S1N (NO) proximity switch, the positioner may only be used at an ambient temperature range from -25 ... 85 °C (-13 ... 185 °F).

Special conditions for ATEX, operation as intrinsically safe equipment

- Prior to final installation, the operator must decide how the device is to be used, either:
 - as a device featuring the intrinsically safe "Ex i" type of protection; or
 - as a device with the "Ex d" type of protection.
 The selected type of use must be permanently marked on the name plate.
 Specific conditions of the surrounding environment, such as chemical corrosion, must be taken into account when affixing the permanent mark. Only the manufacturer may change the selected type of use following a re-examination
- Variants that, according to declarations, also meet the requirements for the "flameproof enclosure" type of protection may no longer be used as "intrinsically safe" if they have been previously used as a flameproof type of protection

6.2 IECEX

6.2.1 Flameproof enclosure

Designation:	Ex d IIC T4/T5/T6
Type Examination Test Certificate:	IECEX BVS 07.0030X, Issue No.: 0
Type:	TZIDC-210
Temperature class:	T4, T5, T6
Permissible ambient temperature:	T4: $-40\text{ °C} < T_{\text{amb}} < 85\text{ °C}$ T5: $-40\text{ °C} < T_{\text{amb}} < 80\text{ °C}$ T6: $-40\text{ °C} < T_{\text{amb}} < 65\text{ °C}$
Standards:	IEC 60079-0: 2011 IEC 60079-1: 2007

6.2.2 Operation as intrinsically safe equipment

Designation:	Ex ia IIC T6 resp. T4 Gb
Certificate No.:	IECEX TUN 04.0015X
Issue No.:	5
Type:	TZIDC-210
Standards:	IEC 60079-0:2011 IEC 60079-11:2011

IECEX certification conditions, operation as intrinsically safe equipment

Special conditions relevant to the safe use of intrinsically safe positioners:

The local communication interface (LCI) for the TZIDC and the TZIDC-200 may only be operated at $U_m \leq 30\text{ V DC}$ outside the potentially explosive area.

Special conditions for the safe use of positioners labeled "Ex nA II T6" or "Ex nL IIC T6":

Only connect devices to circuits in zone 2 that are suitable for use in potentially explosive atmospheres classified as zone 2 and the prevailing conditions at the installation site.

It is only permissible to connect, disconnect and switch live circuits when carrying out installation, maintenance or repair work.

Please note: It is considered to be unlikely that a potentially explosive atmosphere would be present at the same time that installation, maintenance, or repair work is being carried out.

For the "mechanical digital feedback" circuit, external measures must be taken to prevent the nominal voltage from being exceeded by more than 40 % in the event of transient disturbances.

Only use non-flammable gases as pneumatic auxiliary energy.

Only use suitable cable entries that meet the requirements of IEC 60079-15.

Temperature class	Ambient temperature range
T4	-40 ... 85 °C
T6 1)	-40 ... 40 °C

1) When using the "digital feedback" plug-in module in temperature class T6, the maximum permissible ambient temperature range is -40 ... 35 °C (-40 ... 95 °F)

Electrical TZIDC-210 data for ia/ib/ic for groups IIB/IIC

With the intrinsically safe Ex i IIC type of ignition protection, only for connection to a certified FISCO power supply unit or a barrier, i.e., a power supply unit with maximum values according to the following table:	
Signal circuit (Terminal +11 / -12 or + / -)	Voltage = 24 V Current = 250 mA Output = 1.2 W Characteristic curve = linear $L_i < 10\text{ }\mu\text{H}$ $C_i < 5\text{ nF}$

The following modules may be operated as an option:

With the intrinsically safe Ex i IIC type of ignition protection, only for connection to a certified intrinsically safe circuit with max. values:	
Plug-in module for shutdown contact input (Terminal +51 / -52 or +85 / -86)	$U_i = 30\text{ V}$ $I_i = 320\text{ mA}$ $P_i = 1.1\text{ W}$ $C_i = 3.7\text{ nF}$ L_i negligibly small

6.3 FM/CSA

6.3.1 FM Approval

TZIDC-210 Positioner, Model V18349-a014b3cd3ef
IS/I,II,III/1/ABCDEFG/T6,T5,T4 Ta = 40 °C, 55 °C, 85 °C-901265
Entity, FISCO

Entity and FISCO Parameters							
Terminals	Type	Groups	Parameters				
			V _{max}	I _{max}	P _i	C _i	L _i
+11 / -12	Entity	A-G	24 V	250 mA	1.2 W	2.8 nF	7.2 µH
+11 / -12	FISCO	A-G	17.5 V	360 mA	2.52 W	2.8 nF	7.2 µH
+11 / -12	FISCO	C-G	17.5 V	380 mA	5.32 W	2.8 nF	7.2 µH
+51 / -52	Entity	A-G	16 V	20 mA	-	60 nF	100 µH
+41 / -42	Entity	A-G	16 V	20 mA	-	60 nF	100 µH
+85 / -86	Entity	A-G	30 V	-	-	3.7 nF	< 1 µH

NI/II/2/ABCD/T6,T5,T4 Ta = 40 °C, 55 °C, 85 °C
S/II,III/2/EFG/T6,T5,T4 Ta = 40 °C, 55 °C, 85 °C
Enclosure type 4x


- a = Case/Mounting – 1, 2, 3, 4, 5 or 6
- b = Output/Safe protection – 1, 2, 3 or 4
- c = Optional modules (shutdown) – 0 or 5
- d = Optional mechanical kit for digital position feedback – 0, 1 or 2
- e = Design (varnish/coding) – 1 or 2
- f = Device identification label – 0, 1 or 2

TZIDC-210 Positioner, Model V18349-a012b3cd3ef
XP/II/2/CD/T6, T5, T4 TA = 82 °C
DIP/II, III/2/FG/T6, T5, T4 Ta = 82 °C
Enclosure type 4x

- a = Case/Mounting – 1, 2, 3, 4, 5 or 6
- b = Output/Safe protection – 1, 2, 3 or 4
- c = Optional modules (shutdown) – 0 or 5
- d = Optional mechanical kit for digital position feedback – 0, 1 or 2
- e = Design (varnish/coding) – 1 or 2
- f = Device identification label – 0, 1 or 2

CSA Certification 1555690
Explosion proof; enclosure 4X
Temperature range: -40 to 85 °C
T5, max. 85 °C ; T6, max. 70 °C
CL I; Div 1; Grp. C-D
CL II; Div 1; Grp. E-F-G
CL III

6.3.2 FM Control Document

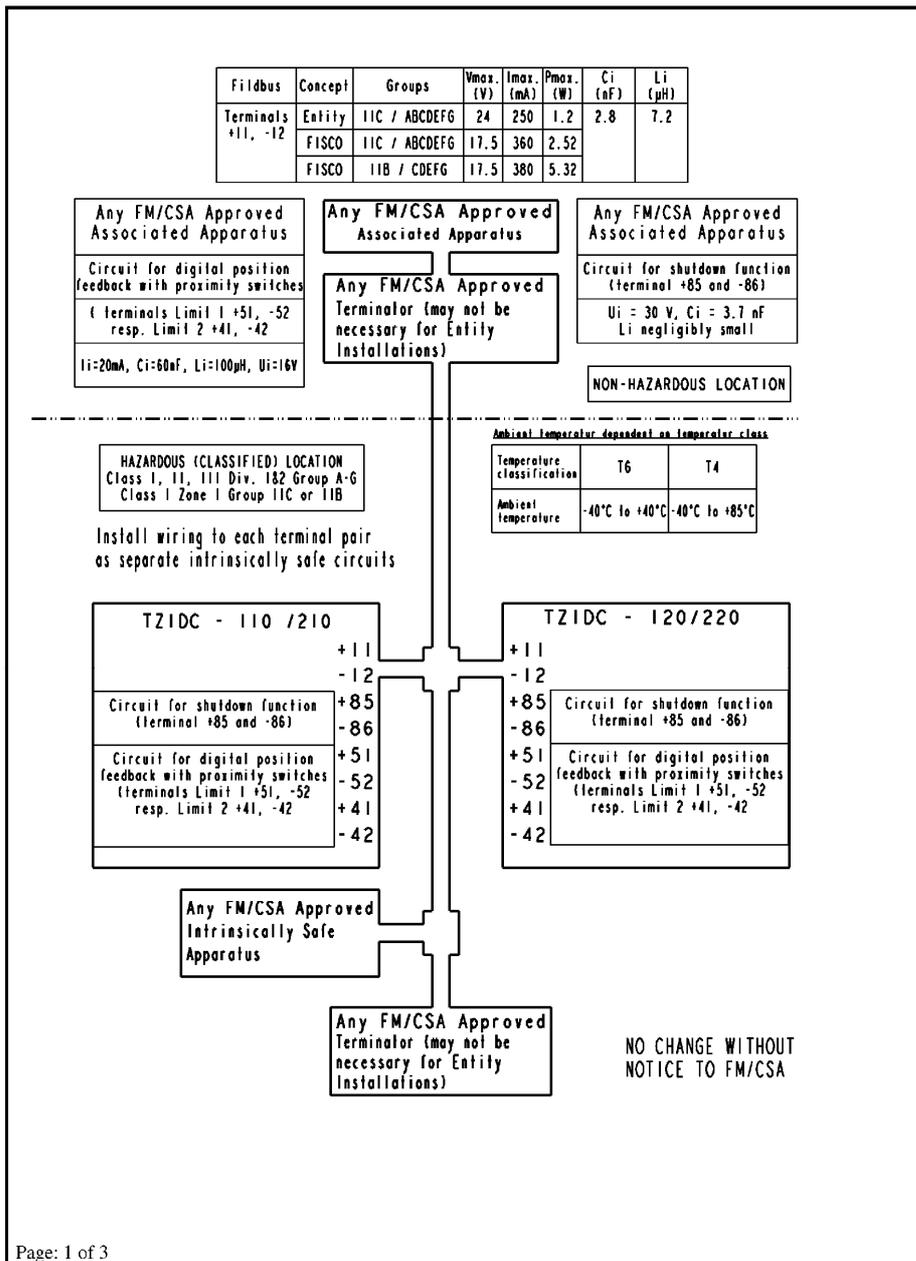

Page: 1 of 3

-	-	2003	Date	Name	Title	Scale
			Name	27.03.03	Thiem.	FM/CSA-Control-Document
			Appr.			/
			Std.			
3	Rev.2	26.06.06	Thie.	ABB Automation Products	Drwg.-No. (Part-No.)	
2	Rev.1	22.05.06	Thie.		901265	
1	Rev.0	27.03.	Thie.			
Rev.	Chang	Date	Name		Supersedes Dwg. :	Part Class:

Page: 2 of 3								
FM/CSA-CONTROL-DOCUMENT_901265								
FISCO rules								
<p>The FISCO Concept allows the interconnection of intrinsically safe apparatus to associated apparatus not specifically examined in such combination. The criterion for such interconnection is that the voltage (V_{max}), the current (I_{max}) and the power (P_i) which intrinsically safe apparatus can receive and remain intrinsically safe, considering faults, must be equal or greater than the voltage (U_o, V_{oc}, V_t), the current (I_o, I_{sc}, I_t) and the power (P_o) which can be provided by the associated apparatus (supply unit). In addition, the maximum unprotected residual capacitance (C_i) and inductance (L_i) of each apparatus (other than the terminators) connected to the Fieldbus must be less than or equal to 5nF and 10 μH respectively.</p> <p>In each I.S. Fieldbus segment only one active source, normally the associated apparatus, is allowed to provide the necessary power for the Fieldbus system. The allowed voltage (U_o, V_{oc}, V_t) of the associated apparatus used to supply the bus must be limited to the range of 14V d.c. to 24V d.c. All other equipment connected to the bus cable has to be passive, meaning that the apparatus is not allowed to provide energy to the system, except to a leakage current of 50 μA for each connected device. Separately powered equipment needs a galvanic Isolation to insure that the intrinsically safe Fieldbus circuit remains passive.</p> <p>The cable used to interconnect the devices needs to comply with the following parameters:</p> <p>Loop resistance R': 15...150 Ω/km Inductance per unit length L': 0.4...1mH/km Capacitance per unit length C': 80...200 nF/km $C' = C' \text{ line/line} + 0.5C' \text{ line/screen}$, if both lines are floating or $C' = C' \text{ line/line} + C' \text{ Line/screen}$, if the screen is connected to one line Length of spur cable: max. 30m Length of trunk cable: max. 1km Length of splice: max. 1m Terminators At each end of the trunk cable an approved line terminator with the following parameters is suitable: $R = 90...100 \Omega$ $C = 0...2.2 \mu$F. System evaluation The number of passive devices like transmitters, actuators, connected to a single bus segment is not limited due to I.S. Reasons. Furthermore, if the above rules are respected, the inductance and capacitance of the cable need not to be considered and will not impair the intrinsic safety of the installation.</p>								
-	-			2003	Date	Name	Title	Scale
					27.03.03	Thiem.	FM/CSA-Control-Dokument	/
3	Rev.2	26.06.06	Thie.	ABB			Drwg.-No. (Part-No.)	
2	Rev.1	22.05.06	Thie.	Automation Products			901265	
1	Rev.0	27.03.	Thie.					
Rev.	Chang	Date	Name				Supersedes Dwg. :	Part Class:

Page: 3 of 3							
FM/CSA-CONTROL-DOCUMENT_901265							
<p>Installation Notes For FISCO and Entity Concepts:</p> <ol style="list-style-type: none"> 1. The Intrinsic Safety Entity concept allows the interconnection of FM/CSA Approved Intrinsically safe devices with entity parameters not specifically examined in combination as a system when: U_o or V_o or $V_t \leq V_{max}$, I_o or I_{sc} or $I_t \leq I_{max}$, $P_o \leq P_i$. C_a or $C_o \geq \sum C_i + \sum C$ cable. For inductance use either L_a or $L_o \geq \sum L_i + \sum L$ cable or $L_c / R_c \leq (L_a / R_a$ or $L_o / R_o)$ and $L_i / R_i \leq (L_a / R_a$ or $L_o / R_o)$ 2. The Intrinsic Safety FISCO concept allows the interconnecting of FM/CSA Approved Intrinsically safe devices with FISCO parameters not specifically examine in combination as a system when: U_o or V_o or $V_t \leq V_{max}$, I_o or I_{sc} or $I_t \leq I_{max}$, $P_o \leq P_i$. 3. Control equipment connected to the Associated Apparatus must not use or generate more than 250 Vrms or Vdc. 4. Installation should be in accordance with ANSI/ISA RP12.6 (except chapter 5 for FISCO Installations) "Installation of Intrinsically Safe System for Hazardous (Classified) Locations" and the National Electrical Code® (ANSI/NFPA 70) Sections 504 and 505. 5. The configuration of associated Apparatus must be Factory Mutual Research /Canadian Standards Association Approved under the associated concept. 6. Associated Apparatus manufacturer's installation drawing must be followed when installing this equipment. 7. No revision to drawing without prior Factory Mutual Research Approval/Canadian Standards Association. 8. Special conditions for safe use The operation of the local communication interface (LKS) and of the programming interface (X5) is only allowed outside of the Hazardous explosive area. <p>NONINCENDIVE, CLASS I, DIV. 2, GROUP A, B, C, D, AND FOR CLASS II AND III, DIV. 1&2, GROUP E, F, G HAZARDOUS LOCATION INSTALLATION.</p> <ol style="list-style-type: none"> 1. Install per National Electrical Code (NEC) using threaded metal conduit. Intrinsic safety barrier required. Max. Supply voltage 30 V. For T-code see table. 							
<ol style="list-style-type: none"> 2. A dust tight seal must be used at the conduit entry when the positioner is used in a Class II & III Location. 3. WARNING: Explosion Hazard – do not disconnect equipment unless power has been switched off or the area is known to be Non-Hazardous. WARNING: Substitution of components may impair suitability for hazardous locations. 							
2003	Date	Name	Title	Scale			
	27.03.03	Thiem.	FM/CSA-Control-Document	/			
		Appr.					
		Std.					
ABB				Drwg.-No. (Part-No.)			
Automation Products				901265			
3	Rev.2	26.06.06	Thie.				
2	Rev.1	22.05.06	Thie.				
1	Rev.0	27.03.	Thie.				
Rev.	Chang	Date	Name	Supersedes Dwg. :		Part Class:	

7 Electrical connections


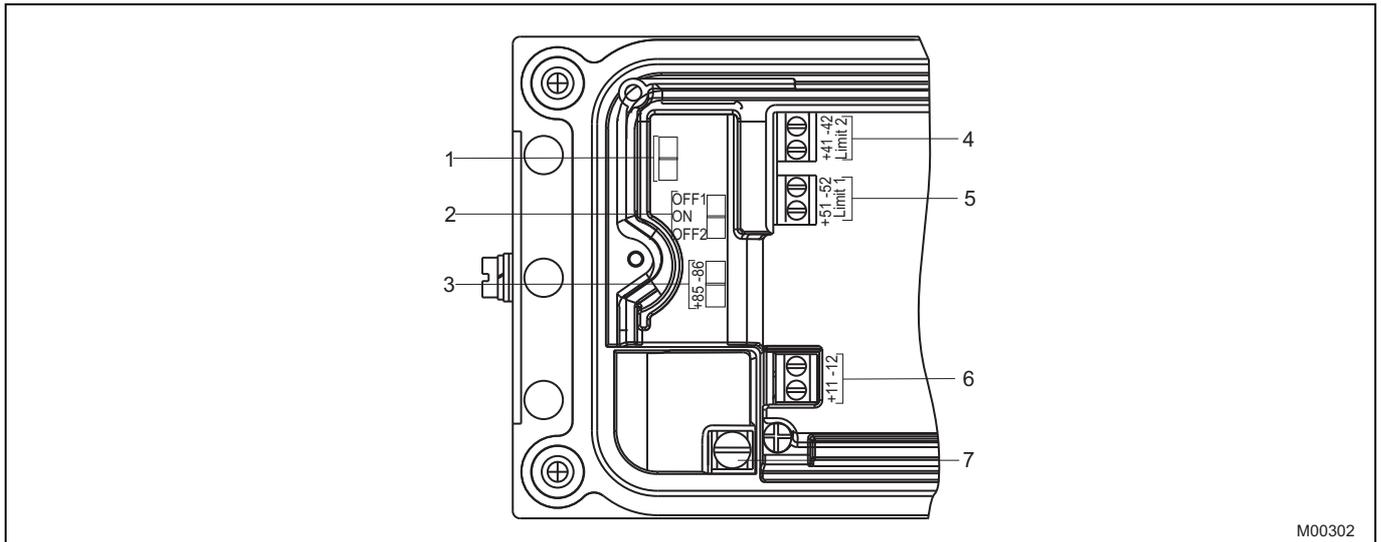


Fig. 6: Screw terminals, overview

- | | |
|--|-------------------|
| 1 Not assigned | 5 Same as 4 |
| 2 Service switch for emergency shutdown module | 6 Bus connector |
| 3 Terminals of the shutdown module | 7 Grounding screw |
| 4 Digital position feedback, either proximity switches or 24 V microswitches | |

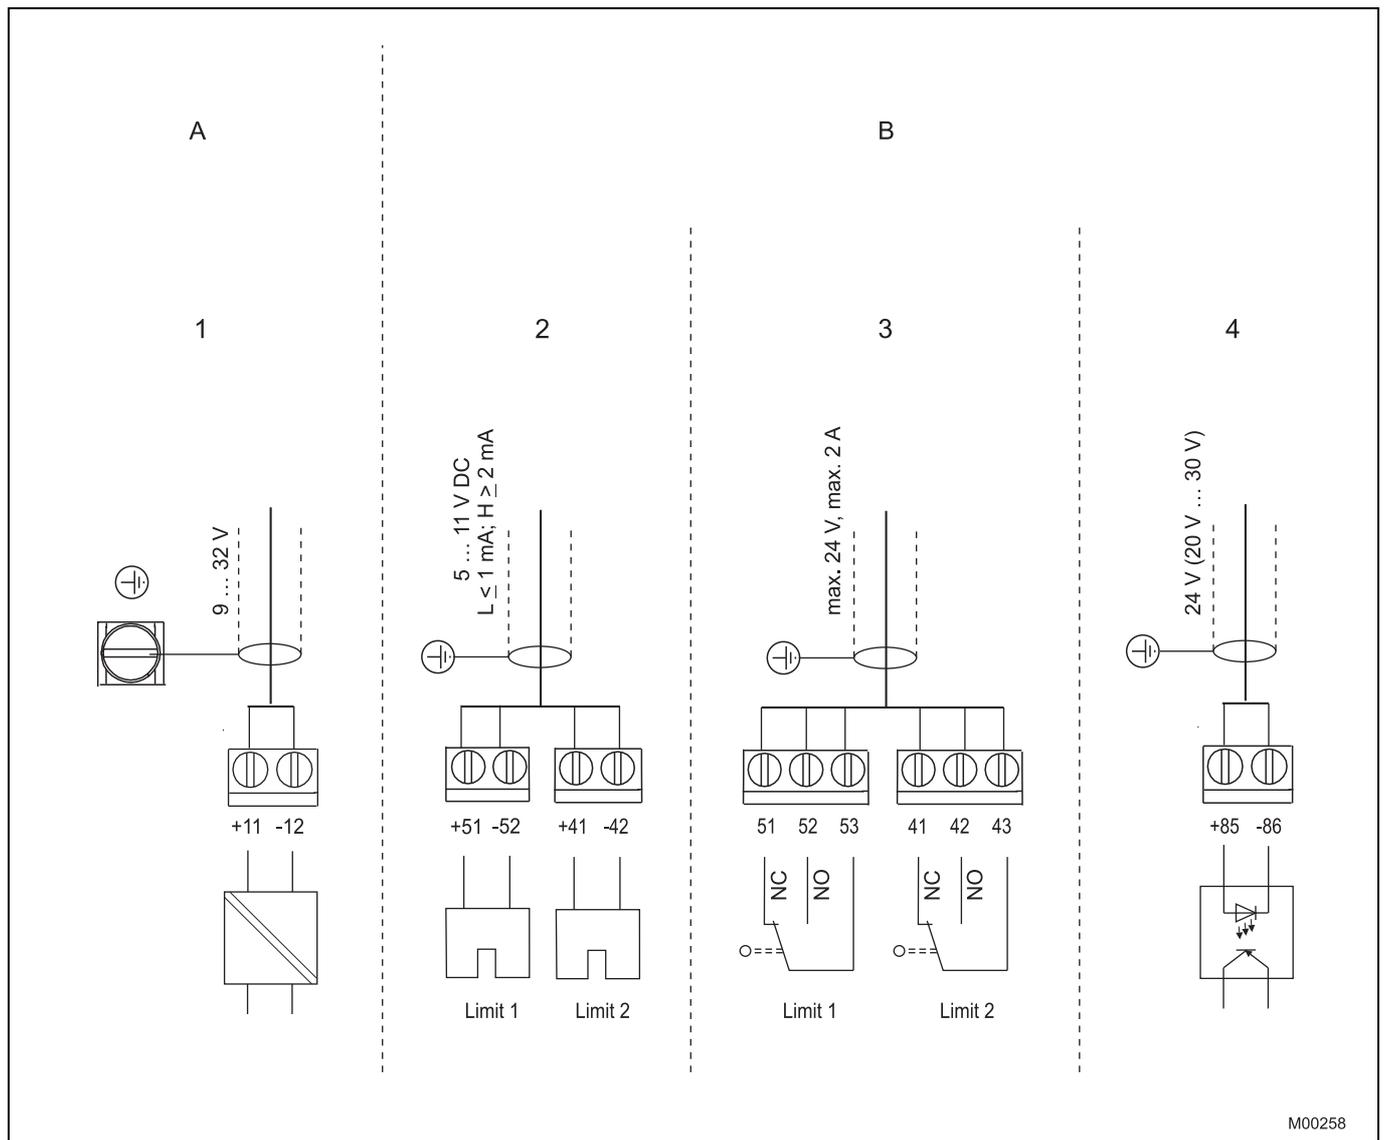

M00258

Fig. 7: Pin configuration

A Basic model
B Options

1 Fieldbus, bus feed
2 Proximity switches
3 Microswitches
4 Emergency shutdown module



IMPORTANT (NOTE)

Keep cable shields as short as possible and connect on both sides.

8 Dimensions

All dimensions in mm (inch)

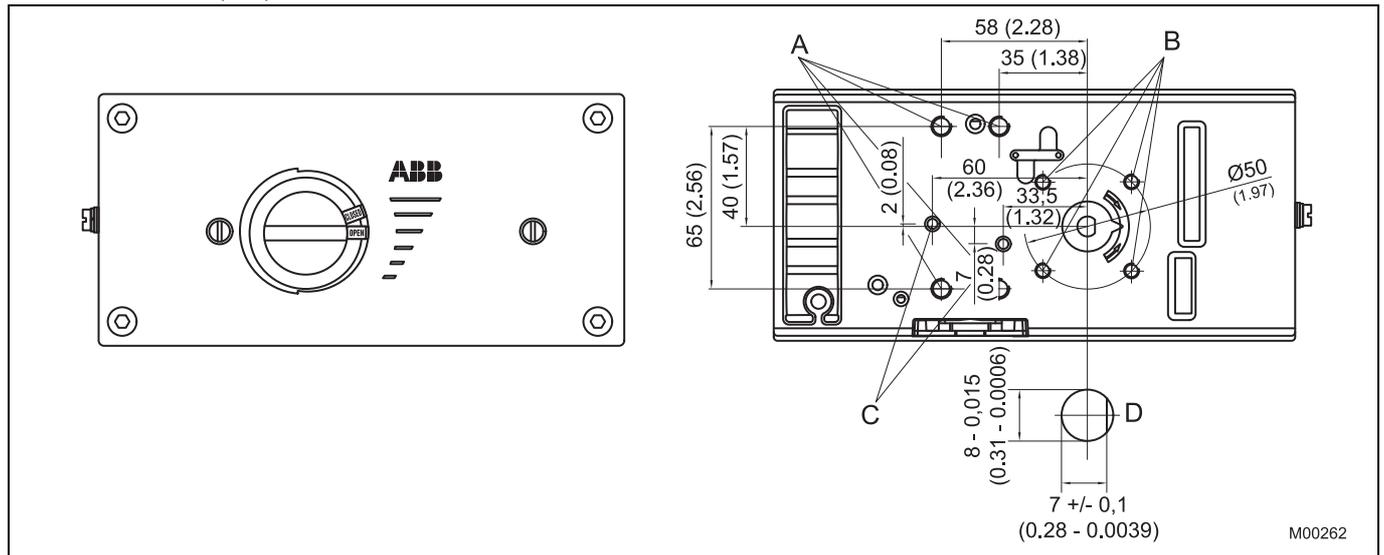


Fig. 8: Top view

- A Tap hole M8 (10 mm (0.39 inch) low)
- B Tap hole M6 (8 mm (0.32 inch) low)
- C Tap hole M5 x 0.5 (air connections in version for integral mounting)
- D Sensor shaft (larger than scale)

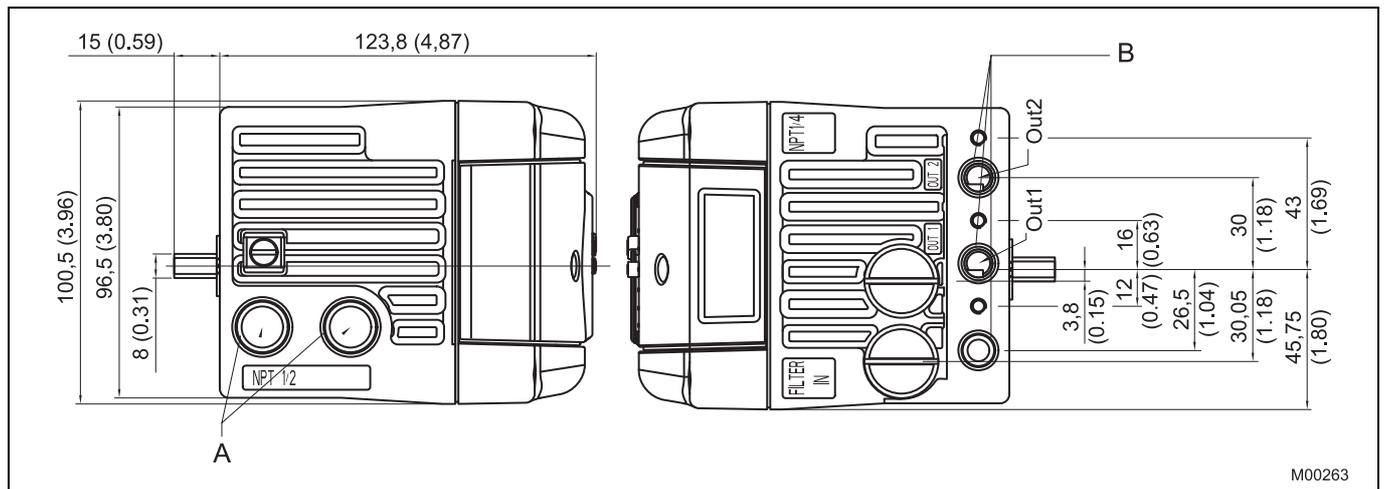


Fig. 9: Left and right side view

- A NPT 1/2" or M20 x 1.5
- B Pneumatic connections, NPT 1/4" -18 or G1/4"


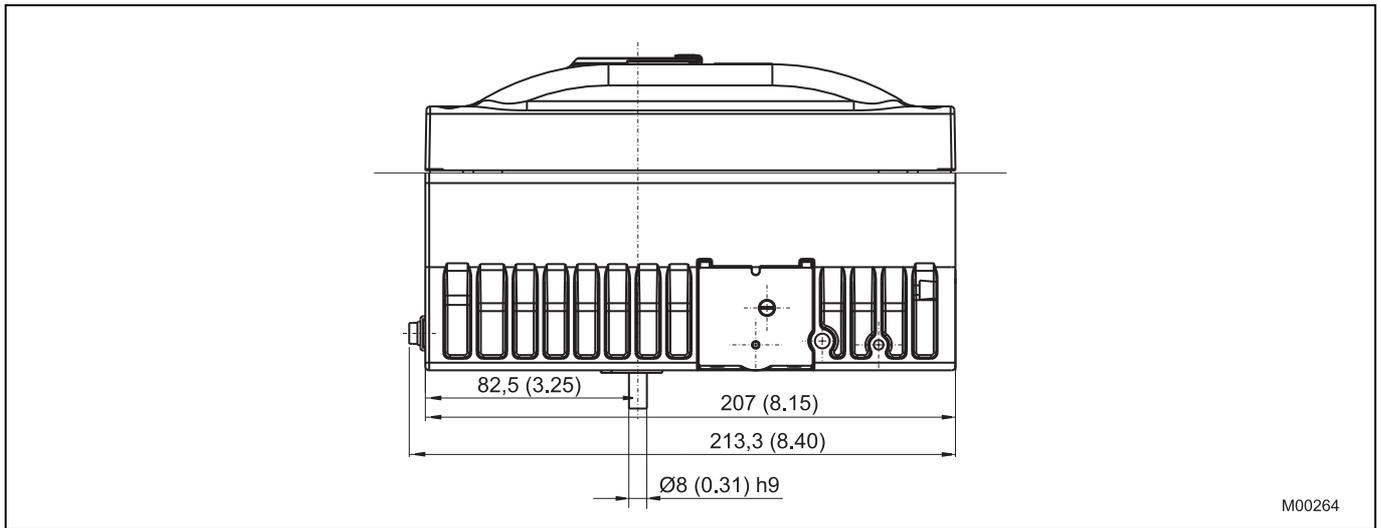


Fig. 10: Bottom view

A Pneumatic connections, NPT 1/4"-18 or G1/4"

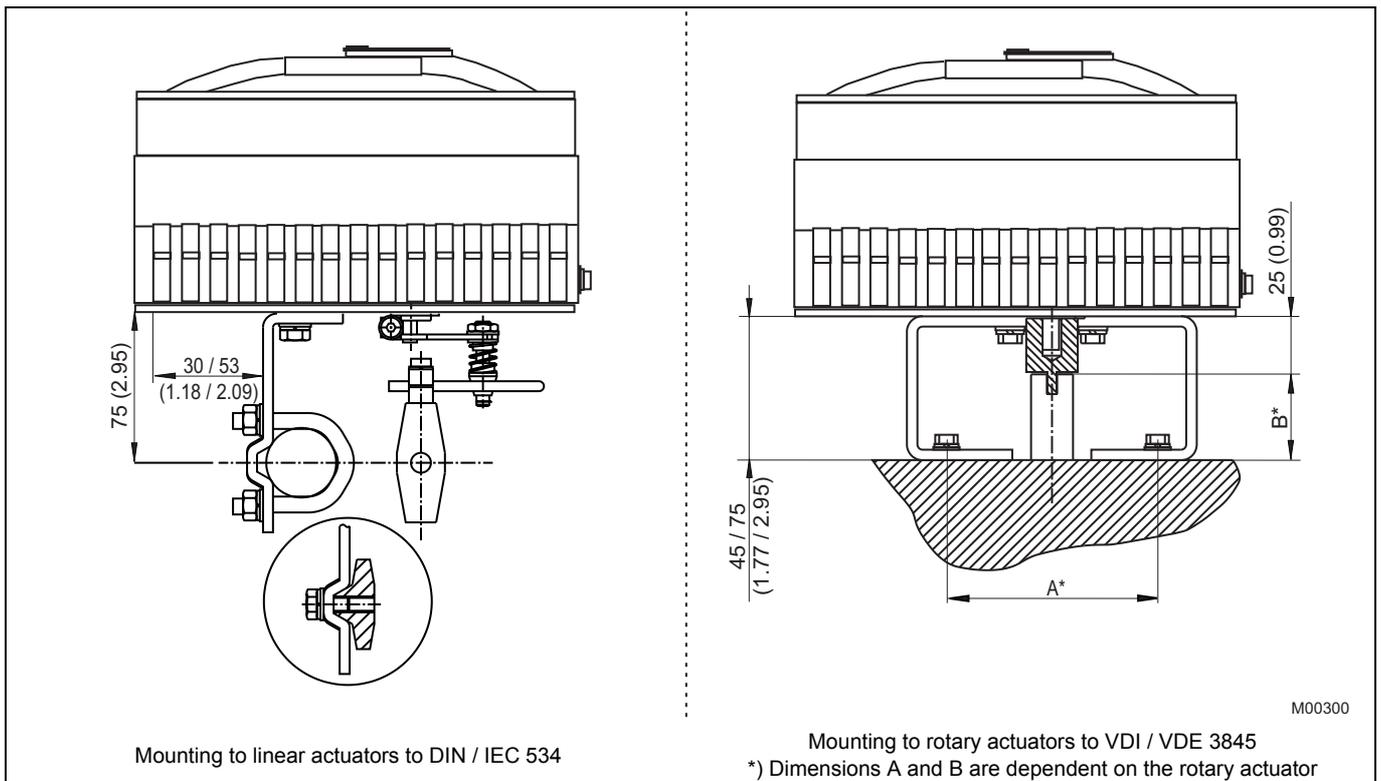

Mounting to linear actuators to DIN / IEC 534

Mounting to rotary actuators to VDI / VDE 3845
*) Dimensions A and B are dependent on the rotary actuator

Fig. 11: Mounting drawings

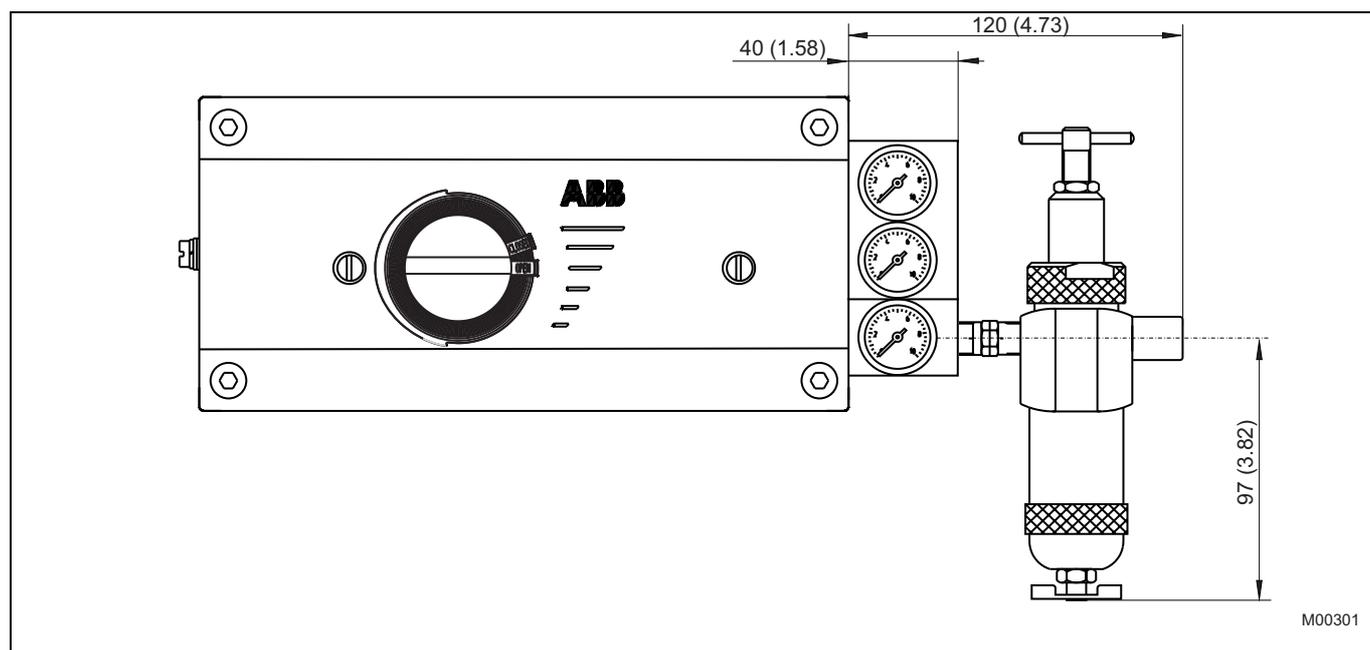


Fig. 12: Positioner TZIDC-210 with pressure gauge block and filter regulator

9 Ordering information

	Main Code											Add. Code					
	Variant digit No.	1	2	3	4	5	6	7	8	9	10						
TZIDC-210 Electro-Pneumatic Positioner, with flameproof enclosure, for PROFIBUS PA, intelligent, software-configurable	V18349	X	X	X	X	X	X	X	X	X	X	X	X	X	X	XX	
Case / Mounting																	
Case made of aluminium, varnished, for mounting to linear actuators acc. DIN / IEC 534 / NAMUR or to rotary actuators acc. VDI / VDE 3845		1	0														
Case made of aluminium, varnished, with mechanical position indicator, for mounting to linear actuators acc. DIN / IEC 534 / NAMUR or to rotary actuators acc. VDI / VDE 3845		2	0														
Case made of aluminium, varnished, for integral mounting to control valves (see dimensional drawing)		3	0														
Case made of aluminium, varnished, with mechanical position indicator, for integral mounting to control valves (see dimensional drawing)		4	0														
Case made of aluminium, varnished, for mounting to rotary actuators acc. VDI / VDE 3845 with extended rotation angle up to 270°		5	0														
Case made of aluminium, varnished, with mechanical position indicator, for mounting to rotary actuators acc. VDI / VDE 3845 with extended rotation angle up to 270°		6	0														
Operation																	
With operator panel and display integrated in the enclosure cover																	1
Explosion Protection																	
ATEX Ex d II C T4/T5/T6 Gb																	1
FM / CSA Class 1, Div. 1, Group C-D (explosion-proof)																	2
ATEX II 2 G Ex ia IIC T6 resp. T4 Gb + Ex d																	3
FM / CSA Intrinsically Safe																	4
IECEX ia IIC T6 resp. T4 Gb																	5
IECEX Ex d II C T4/T5/T6 Gb																	6
GOST Russia - Ex d IIC T4 / T5 / T6																	D
Output / Safe Position (in case of an electrical power failure)																	
Single acting, fail safe																	1
Single acting, fail freeze																	2
Double acting, fail safe																	3
Double acting, fail freeze																	4
Connections																	
Cable: Thread M20 x 1.5, air pipe: Thread G 1/4																	1
Cable: Thread M20 x 1.5, air pipe: Thread 1/4-18 NPT																	2
Cable: Thread 1/2-14 NPT, air pipe: Thread 1/4-18 NPT																	3
Cable: Thread G 1/2, air pipe: Thread Rc 1/4																	7

Continued on next page

1) Only with cable connection NPT thread

	Main Code													Add. Code					
	Variant digit No.	1	2	3	4	5	6	7	8	9	10	11	12		13	14	15	16	17
TZIDC-210 Electro-Pneumatic Positioner, with flameproof enclosure, for PROFIBUS PA, intelligent, software-configurable	V18349	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	XX
Option Module for Shutdown Function																			
Without														0					
Plug-in module for shutdown function													2)	5					
Optional Mechanical Kit for Digital Position Feedback																			
Without															0	3			
Mechanical kit for digital position feedback with proximity switches SJ2-SN (NC or logical 1)														3)	1	3			
Mechanical kit for digital position feedback with proximity switches SJ2-S1N (NO or logical 0)														4)	2	3			
Mechanical kit for digital position feedback with 24 V AC / DC microswitches (change-over contacts)														5)	3	3			
Design (Varnish / Coding)																			
Standard																		1	
Others																		2	
Device Identification Label																			
Without																			0
Label including text, with separate sticker logical 1)																		6)	1
Label including text, with separate stainless steel label 11.5 x 60 mm (0.45 x 2.36 in.)																		6)	2
Documentation Language																			
German																			M1
Italian																			M2
Spanish																			M3
French																			M4
English																			M5
Swedish																			M7
Finnish																			M8
Polish																			M9
Portuguese																			MA
Russian																			MB
Czech																			MC
Dutch																			MD
Danish																			MF
Greek																			MG
Latvian																			ML
Hungarian																			MM
Estonian																			MO
Bulgarian																			MP
Romanian																			MR
Slovak																			MS
Lithuanian																			MU
Slovenian																			MV
Certificate of Compliance																			
Certificate of compliance with the order acc. EN 10204-2.1 (DIN 50049-2.1) with item description																			CF2
Test report 2.2 acc. EN 10204 (DIN 50049-2.2)																			CF3
Inspection Certificate																			
Inspection certificate 3.1 acc. EN 10204																			CBA

- 2) Only for fail safe pneumatic
- 3) No IECEx
- 4) Only for ambient temperature range -25 ... 85 °C, no IECEx
- 5) Only for Ex d version
- 6) Plain text, max. 16 letters

9.1 Accessories

Accessories	Order number
Mounting bracket	
EDP300 / TZIDC Mounting bracket for rotary actuators (mounting to VDI / VDE 3845), dimension A/B = 80/20 mm	319603
EDP300 / TZIDC Mounting bracket for rotary actuators (mounting to VDI / VDE 3845), dimension A/B = 80/30 mm	319604
EDP300 / TZIDC Mounting bracket for rotary actuators (mounting to VDI / VDE 3845), dimension A/B = 130/30 mm	319605
EDP300 / TZIDC Mounting bracket for rotary actuators (mounting to VDI / VDE 3845), dimension A/B = 130/50 mm	319606
Lever	
EDP300 / TZIDC Lever 30 mm	7959151
EDP300 / TZIDC Lever 100 mm	7959152
Adapter	
EDP300 / TZIDC Adapter (shaft coupler) for rotary actuators (mounting to VDI / VDE 3845)	7959110
EDP300 / TZIDC Form - locking shaft adapter	7959371
Pressure gauge block	
TZIDC Pressure gauge block, 0.6 MPa, single acting, G 1/4 connection	7959364
TTZIDC Pressure gauge block, 0.6 MPa, single acting, Rc 1/4 connection	7959358
TZIDC Pressure gauge block, 0.6 MPa, single acting, NPT 1/4 connection	7959360
TZIDC Pressure gauge block, 0.6 MPa, double acting, G 1/4 connection	7959365
TZIDC Pressure gauge block, 0.6 MPa, double acting, Rc 1/4 connection	7959359
TZIDC Pressure gauge block, 0.6 MPa, double acting, NPT 1/4 connection	7959361
Filter regulator	
TZIDC Filter regulator, brass, connections thread G 1/4, incl. material for mounting to pressure gauge block	7959119
TTZIDC Filter regulator, brass, connections thread 1/4-18 NPT, incl. material for mounting to pressure gauge block	7959120
Attachment kit	
EDP300 / TZIDC Attachment kit for linear actuators, stroke 10 ... 35 mm	7959125
EDP300 / TZIDC Attachment kit for linear actuators, stroke 20 ... 100 mm	7959126
EDP300 / TZIDC Attachment for remote sensor control unit (for wall or pipe mounting)	7959381
EDP300 / TZIDC Attachment kit for Fisher 1051-30, 1052-30	7959214
EDP300 / TZIDC Attachment kit for Fisher 1061 size 130	7959206
EDP300 / TZIDC Attachment kit for Fisher 471	7959195
EDP300 / TZIDC Attachment kit for Fisher 657 / 667 Size 10 ... 90 mm	7959177
EDP300 / TZIDC Attachment kit for Fisher Gulde 32/34	7959344
EDP300 / TZIDC Attachment kit for Gulde DK	7959161
EDP300 / TZIDC Attachment kit for Keystone 79U/E-002(S) ... 79U/E-181(S)	7959147
EDP300 / TZIDC Attachment kit for Masoneilan CAMFLEX II, VARIMAX, MINITORK II	7959144
EDP300 / TZIDC Attachment kit for Masoneilan VariPak 28000 series	7959163
EDP300 / TZIDC Attachment kit for MaxFlo MaxFlo	7959140
EDP300 / TZIDC Attachment kit for NAF 791290	7959207
EDP300 / TZIDC Attachment kit for NAMUR stroke 100 ... 170 mm	7959339
EDP300 / TZIDC Attachment kit for NELES BC6-20, B1C6-20, BJ8-20, B1J8-20	7959146
EDP300 / TZIDC Attachment kit for Valves Nuovo Pignone, lever for linear stroke, length 150 ... 250 mm	7959210
EDP300 / TZIDC Attachment kit for Samson 241, 271, 3271	7959145
EDP300 / TZIDC Attachment kit for Samson 3277	7959136
EDP300 / TZIDC Attachment kit for Schubert&Salzer GS 8020 / 8021 / 8023	7959200
EDP300 / TZIDC Attachment kit for SED SED stroke 100 mm	7959141
EDP300 / TZIDC Mounting Kit Uhde Type 4 Stroke 400 mm cropped	7959500
Cable gland	
TZIDC-2xx 1 x Ex d cable gland M20 x 1.5, 1 pipe plug M20 x 1.5, securing adhesive	7959244
TZIDC-2xx 2 x Ex d cable glands M20 x 1.5, securing adhesive	7959245
TZIDC-2xx 1 x Ex d cable gland 1/2 in. NPT, 1 pipe plug 1/2 in. NPT, securing adhesive	7959246
TZIDC-2xx 2 x Ex d cable glands 1/2 in. NPT, securing adhesive	7959247

Notes

Contact us

ABB Limited

Process Automation

Salterbeck Trading Estate
Workington, Cumbria
CA14 5DS
UK

Tel: +44 (0)1946 830 611

Fax: +44 (0)1946 832 661

ABB Inc.

Process Automation

125 E. County Line Road
Warminster, PA 18974
USA

Tel: +1 215 674 6000

Fax: +1 215 674 7183

ABB Automation Products GmbH

Process Automation

Schillerstr. 72
32425 Minden
Germany

Tel: +49 571 830-0

Fax: +49 571 830-1806

www.abb.com/positioners

Note

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents - in whole or in parts - is forbidden without prior written consent of ABB.

Copyright© 2014 ABB

All rights reserved

3KXE341005R1001



Sales



Service



Software