



MiniMax Plus Electronic Ignition Wiring Instructions

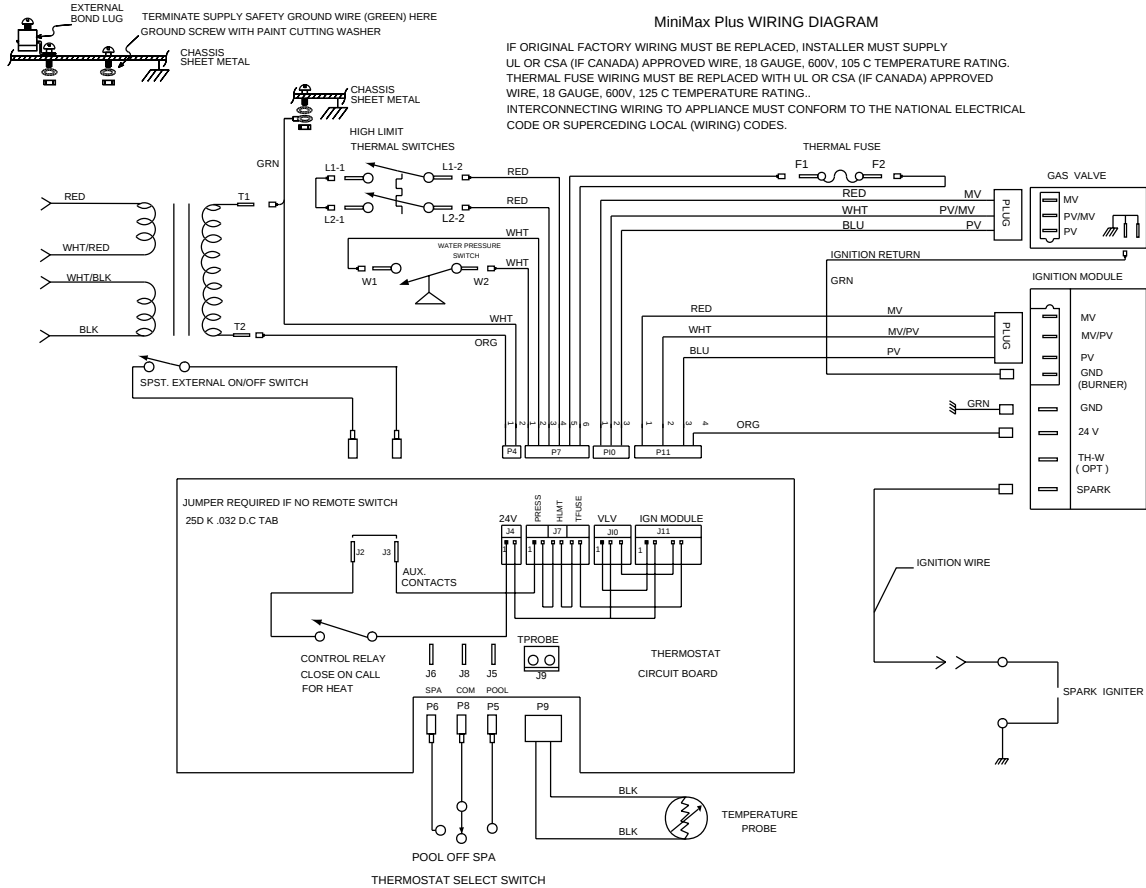


REMOTE SWITCH DUAL THERM IID ONLY

2 Wire Remote

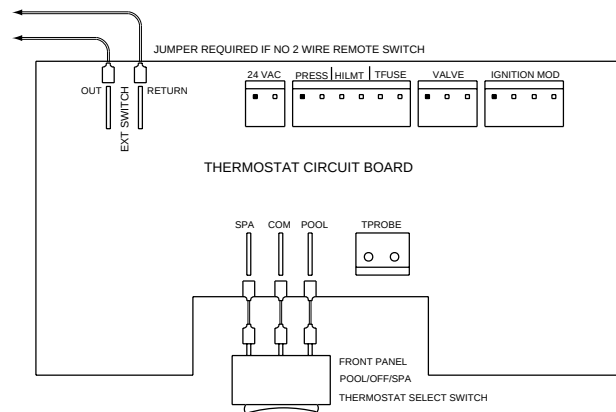

3 Wire Remote

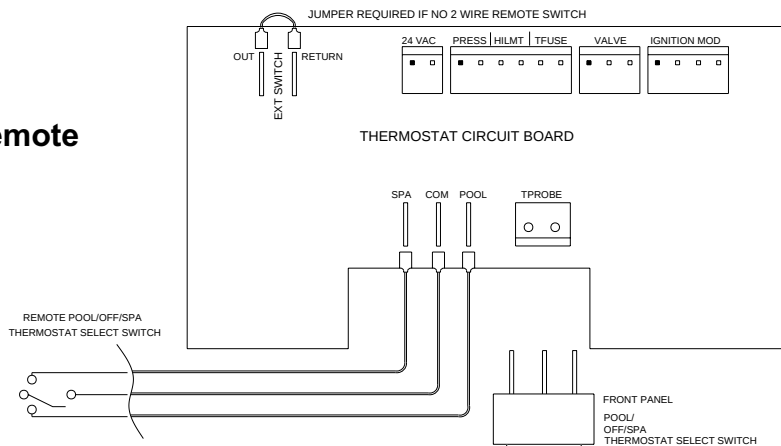

NOTE: When connecting a remote control to the MiniMax Plus, you must install the low voltage thermostat wires in separate conduit from **ANY** line voltage wires. Failure to follow these instructions will cause the thermostat relay to react erratically.

Pentair Pool Products™

Because *reliability* matters most