


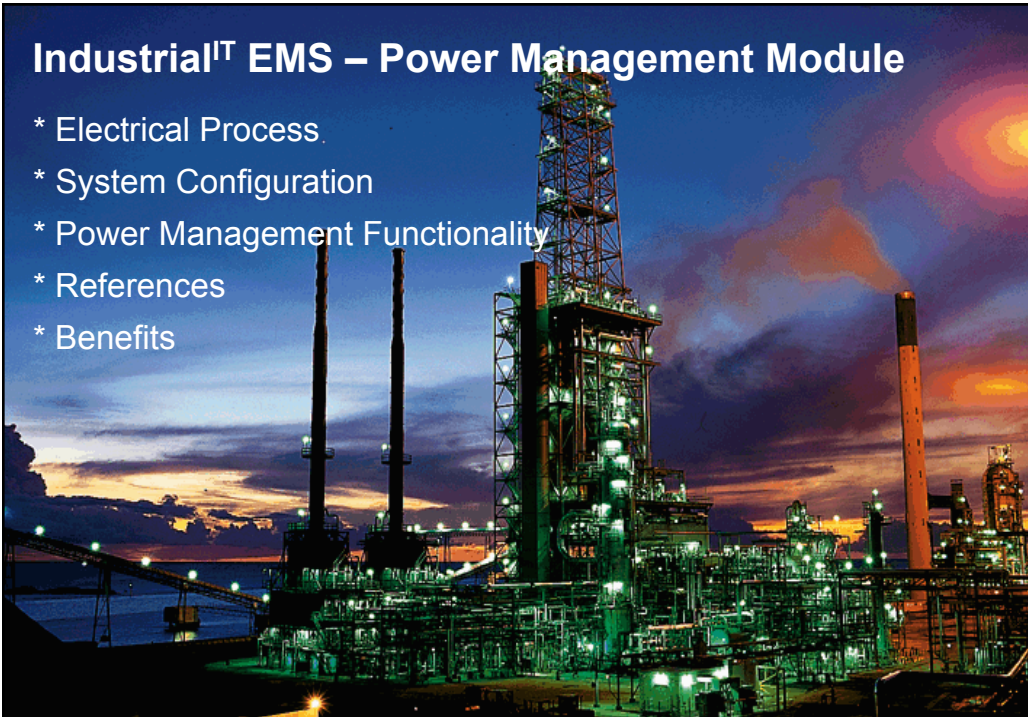


<p>Industrial<sup>IT</sup> EMS Power Management Module</p>	<p><b>Power Management for the Oil &amp; Gas, Petroleum and Chemical Industries</b></p>
	
<p>ABB SRU EMS - 1 © 2003</p>	

**Industrial<sup>IT</sup> EMS – Power Management Module**

- \* Electrical Process
- \* System Configuration
- \* Power Management Functionality
- \* References
- \* Benefits



## Qualification Criteria for ABB Power Management

### Critical Loads

Limited In-plant Generation

Load Shedding

Insufficient Reliability of Public Grid

Several Generators

Power Control

Contracted Power Importation

Different Electrical Operational

Configurations possible

Mode Control

Complex Distribution Networks

“Local only” Control facilities

SCADA

ABB SRU EMS - 3  
© 2003





## Why ABB Power Management?

- Thorough understanding of the electrical process
- +15 years experience in implementing Power Management Systems in many projects (green- and brown-field plants)
- Standard software, well documented, tested, proven technology
- Fast Response Time for Load Shedding, Mode Control, Power Control, Re-acceleration
- High Resolution and Accuracy of Sequence of Event recording
- Solution complies with class 3 EMC immunity
- Single responsibility: One supplier for Power Management System integrated with Protection, Governor, Excitation, Tap Changer, Motor Control Centre, Variable Speed Drive, etc.

ABB SRU EMS - 4  
© 2003



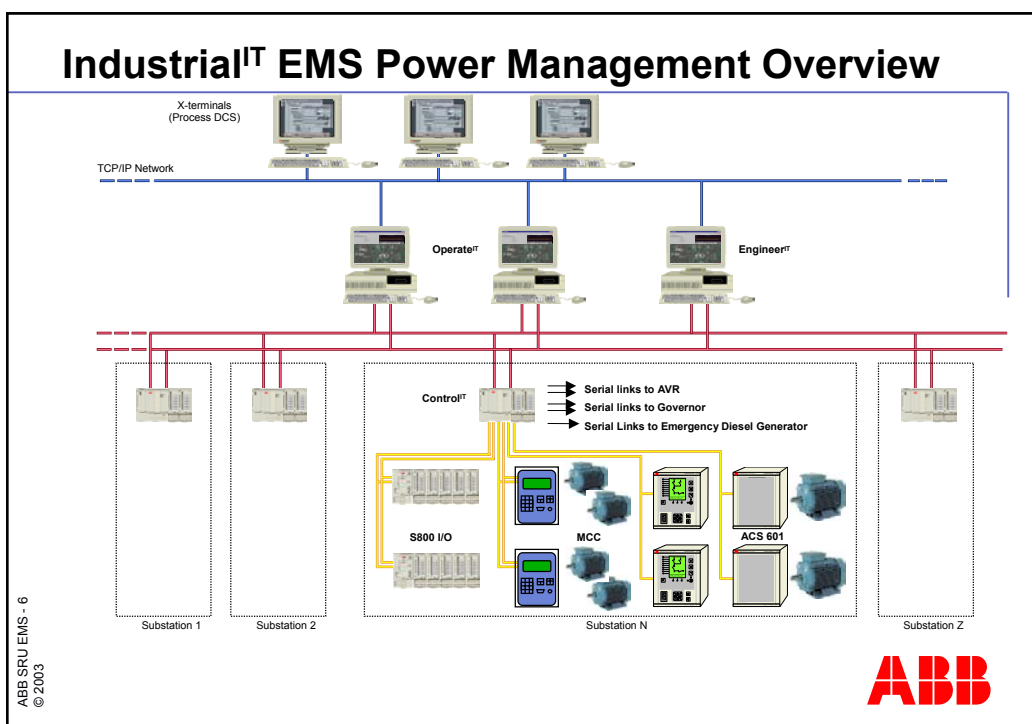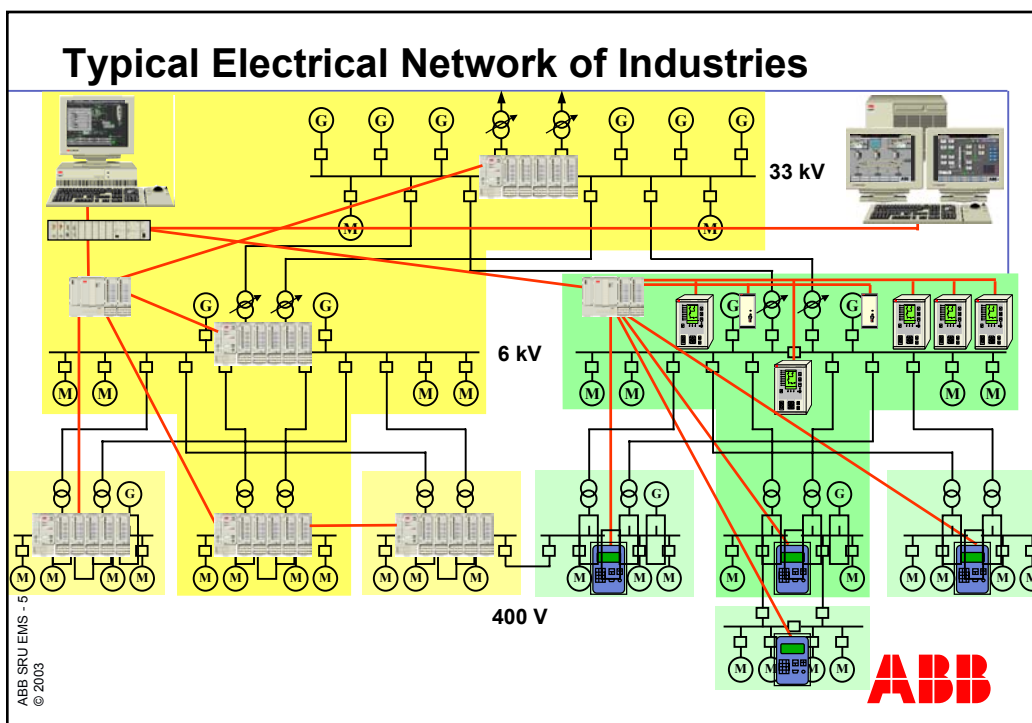

## Power Management Functionality

- Load Shedding
- Active and Reactive Power Control
- Mode Control
- Supervision, Control and Data Acquisition (SCADA)
- Re-Acceleration / Re-Starting
- Synchronisation

ABB SRU EMS - 7  
© 2003

**ABB**



## Load Shedding: the Types

- Fast Load Shedding on Loss of Power Resources
- Load Shedding on Frequency Drop
- Slow Load Shedding on Overload
- Slow Load Shedding for Peak Shaving
- Manual Load Shedding

ABB SRU EMS - 9  
© 2003



## Load Shedding: Keywords

- Fast
- Exact
- Flexible
- Coordinated
- Deterministic
- Security and Reliability
- Accurate Event Logging
- Operator Guidance
- Independent Back-up System


ABB SRU EMS - 10  
© 2003





## Load Shedding Example Displays

1. Load Shedding Control
2. Load Shedding Islands
3. Load Shedding Overview

ABB SRU EMS - 11  
© 2003

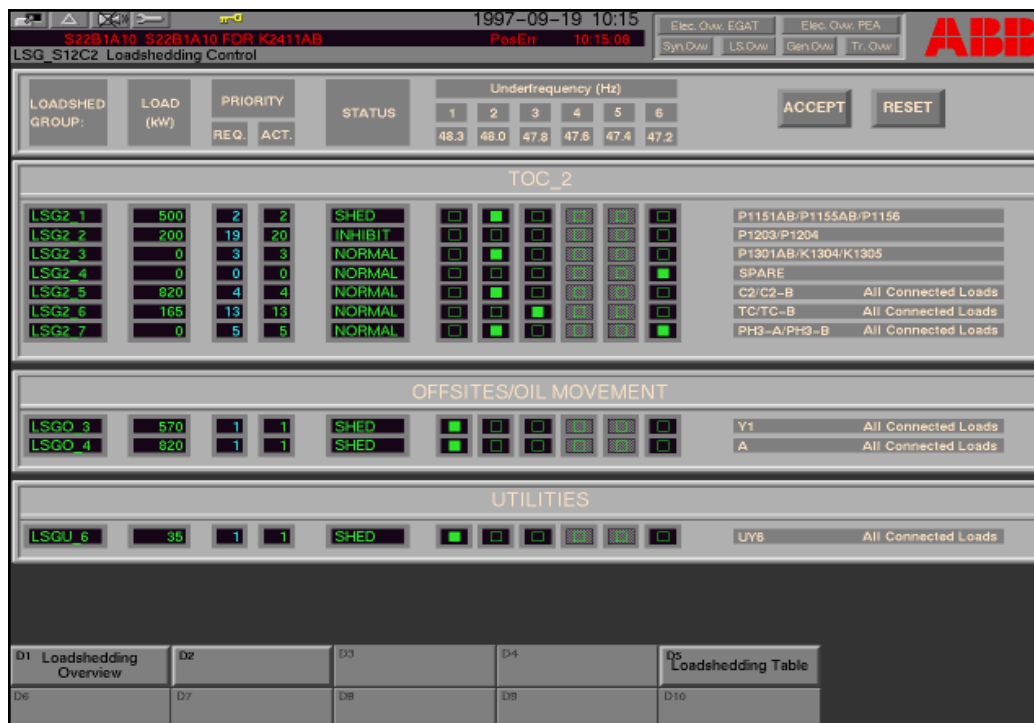

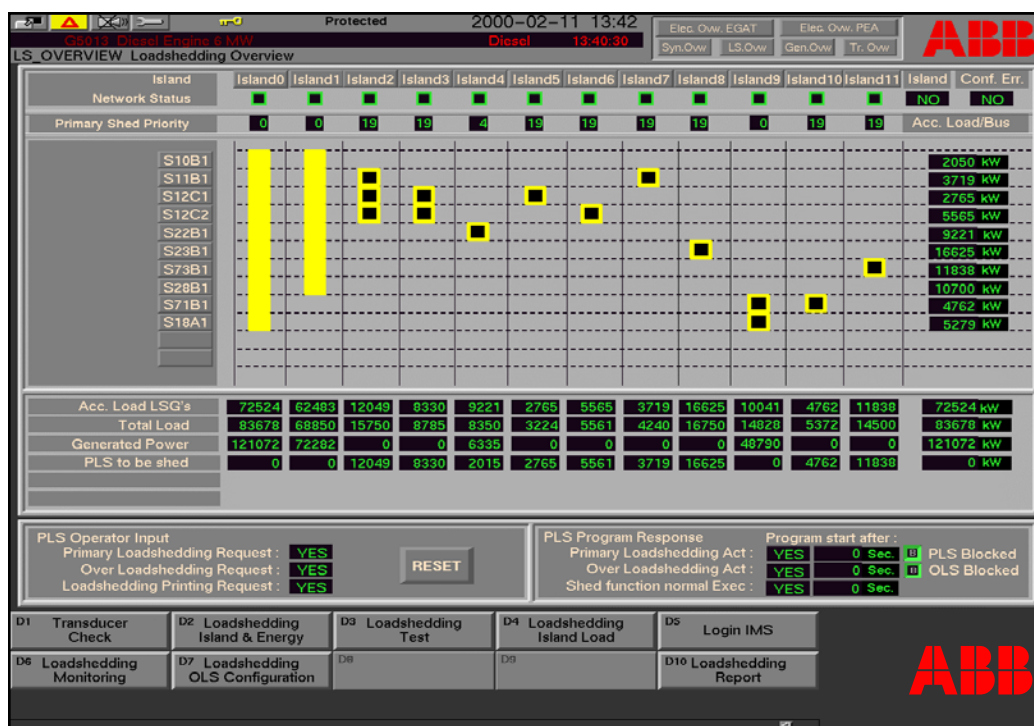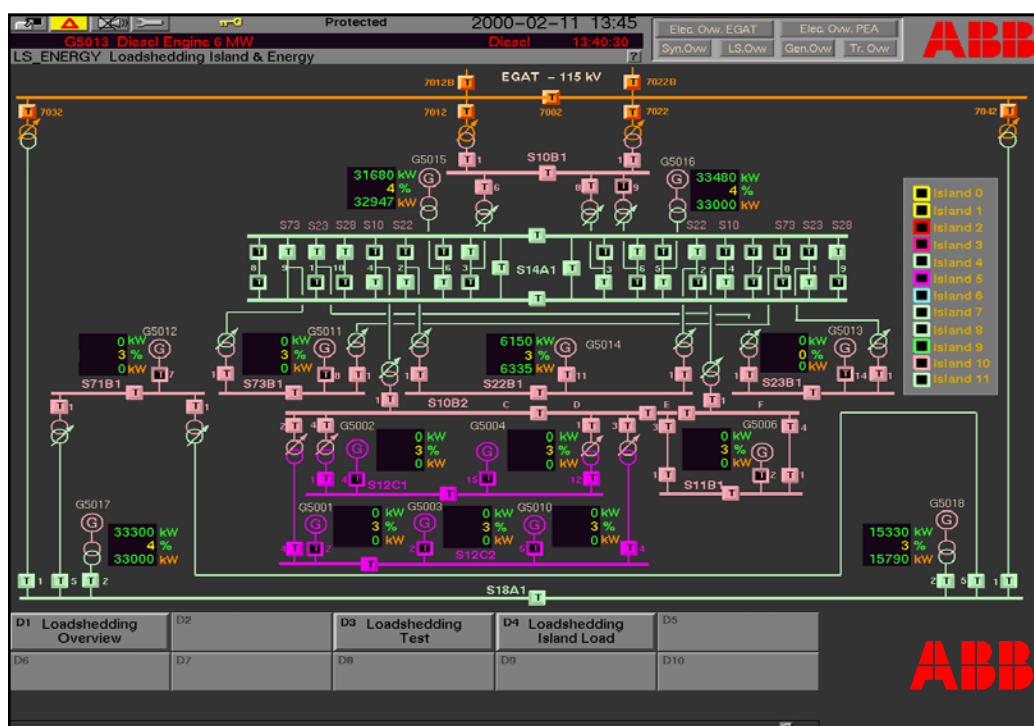

## Power Management Functionality

- Load Shedding
- **Active and Reactive Power Control**
- Mode Control
- Supervision, Control and Data Acquisition (SCADA)
- Re-Acceleration / Re-Starting
- Synchronisation

ABB SRU EMS - 15  
© 2003



## Display Generator Capability Diagram

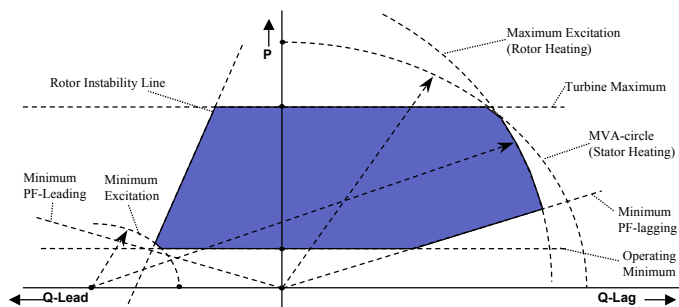


ABB SRU EMS - 16  
© 2003





## Active and Reactive Power Control

### ■ Active Power Sharing:

- Efficient Power Generation
- Power Exchange Optimization (Power Demand Control)
- Avoid Component Overloading
- Spinning Reserve Optimization
- Standby Optimization

### ■ Reactive Power Sharing:

- Achieve Stable Operation
- Power Factor Optimization

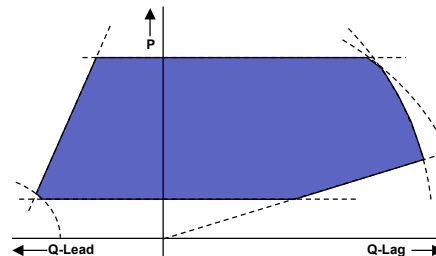


ABB SRU EMS - 17  
© 2003



**ABB**



## Power Control Example Displays



1. Calculated Control Margins
2. Generator Capability Diagram
3. Grid Capability Diagram
4. Maximum Demand Monitoring
5. Tie-line Monitoring
6. Mark V Vibration
7. Mark V Gas Turbine Generator Overview


ABB SRU EMS - 18  
© 2003

**ABB**

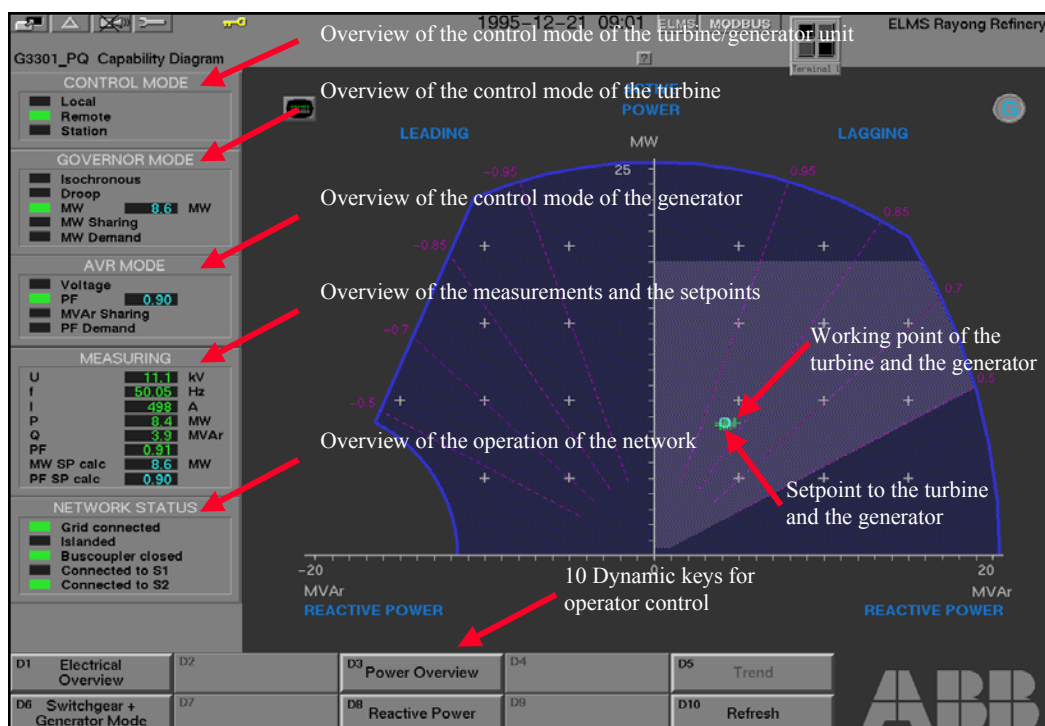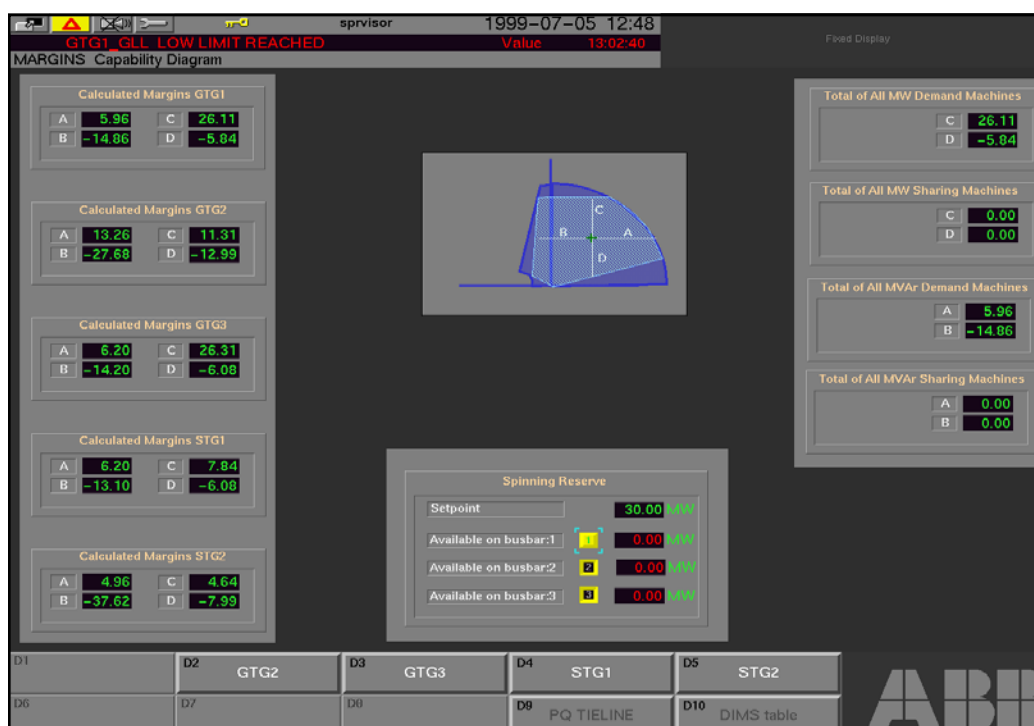

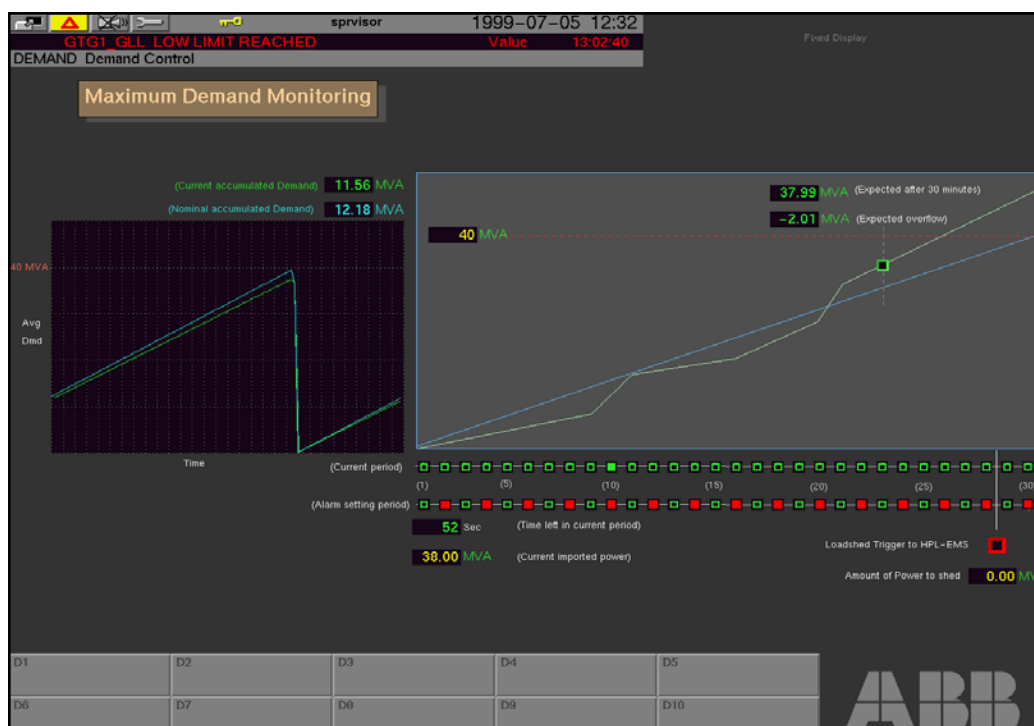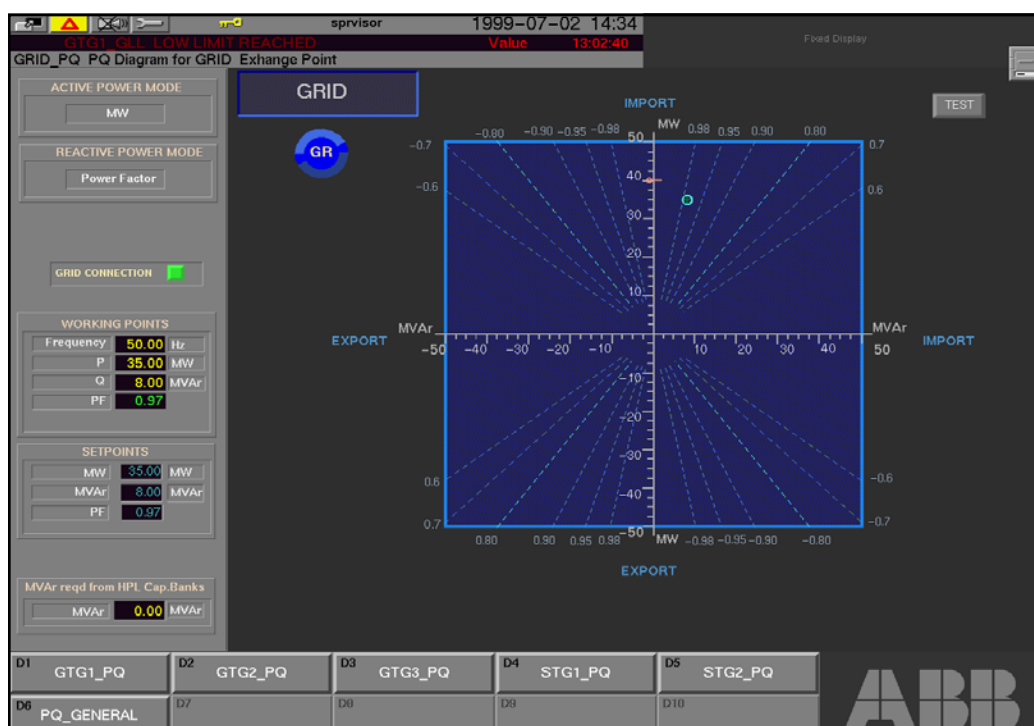

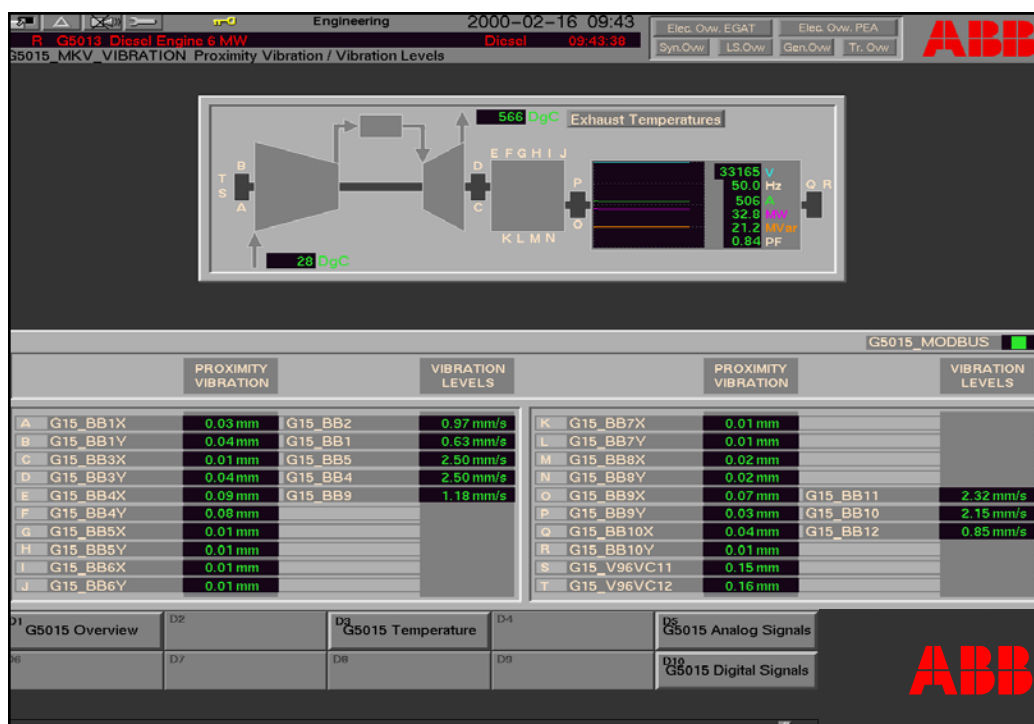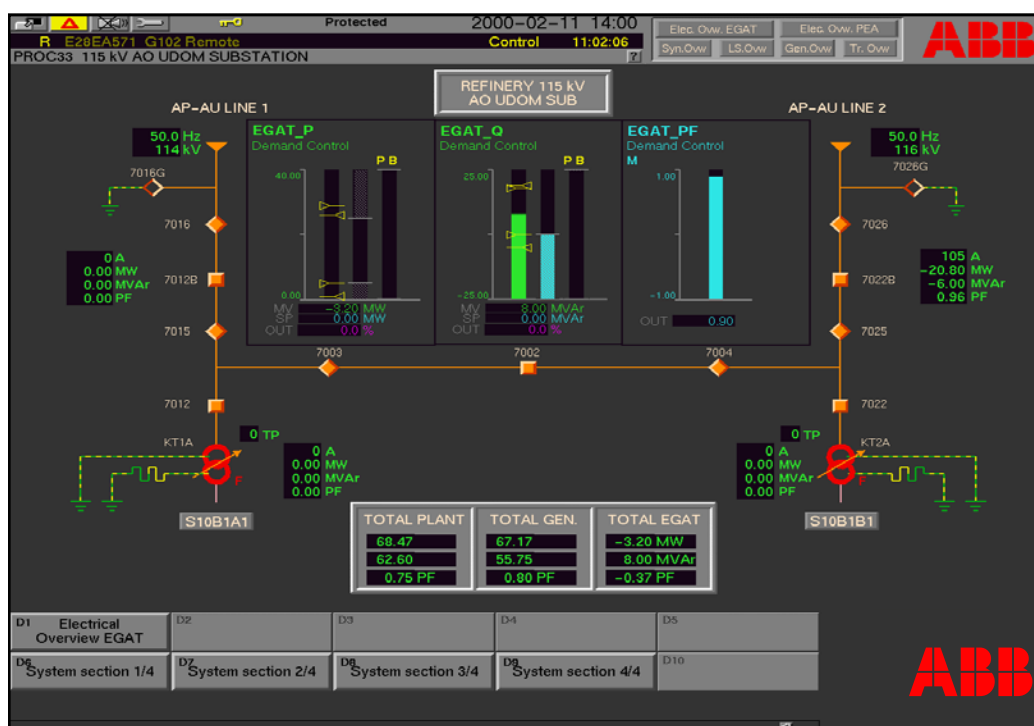

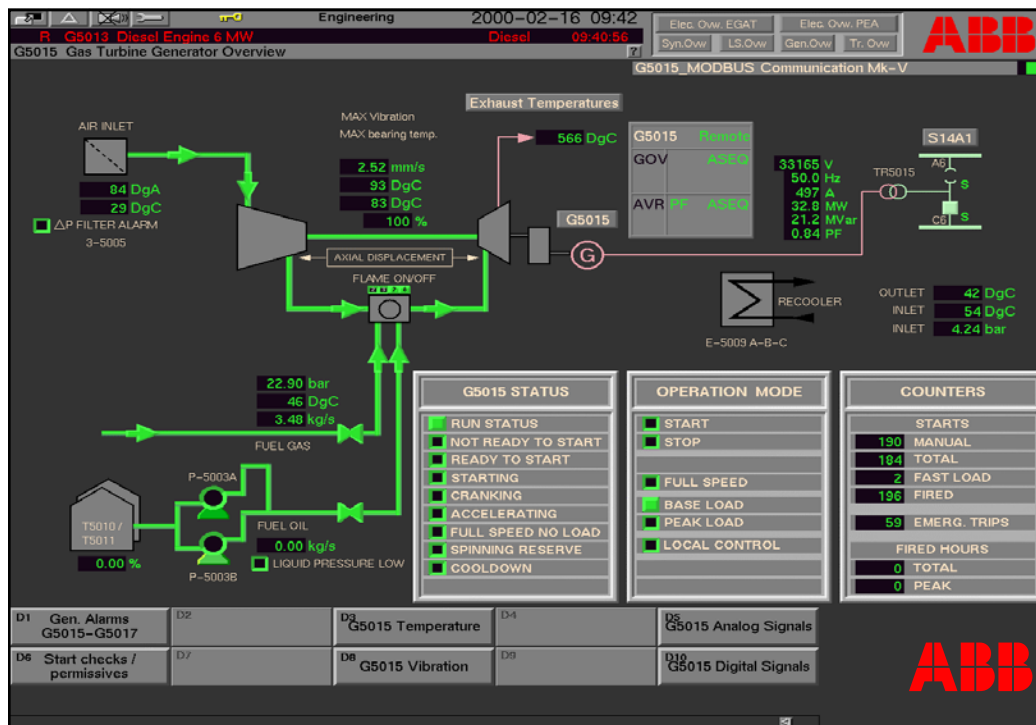

## Power Management Functionality

- Load Shedding
- Active and Reactive Power Control
- **Mode Control**
- Supervision, Control and Data Acquisition (SCADA)
- Re-Acceleration / Re-Starting
- Synchronisation

## Mode Control

- for Generators
- for Turbines
- for Transformers
- for Switchboards




ABB SRU EMS - 27  
© 2003

**ABB**

## Mode Control Example Display

ABB SRU EMS - 28  
© 2003

**ABB**

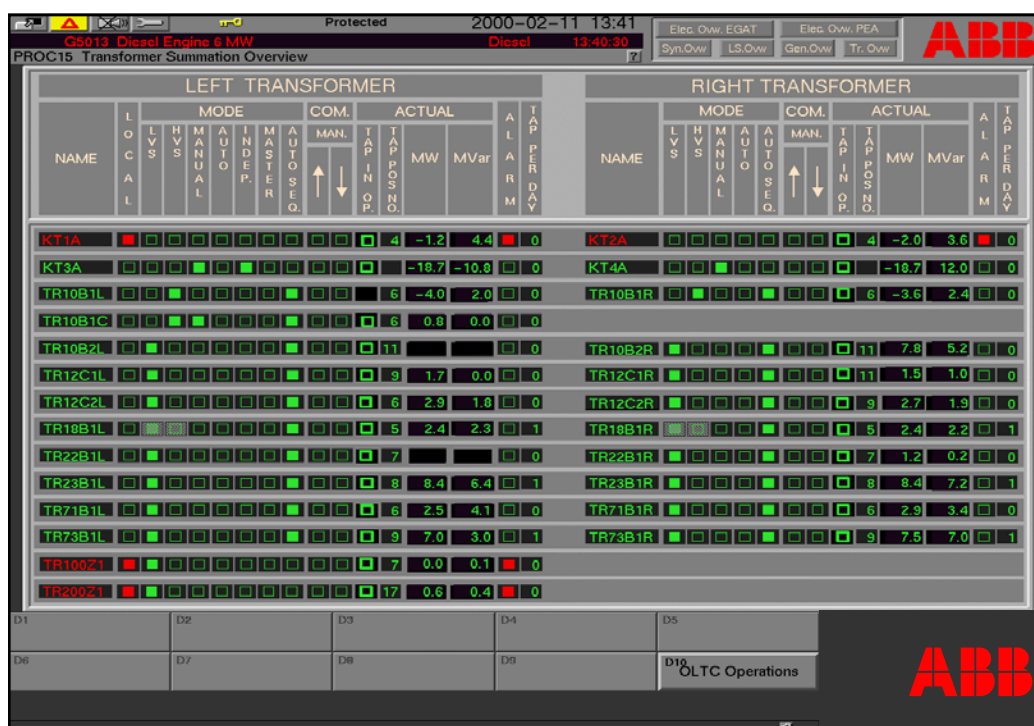

## Power Management Functionality

- Load Shedding
- Active and Reactive Power Control
- Mode Control
- Supervision, Control and Data Acquisition (SCADA)
- Re-Acceleration / Re-Starting
- Synchronisation

## Supervision, Control and Data Acquisition

- Clearly Structured Presentation
- Controls - Select Before Execute
- Status Indications
- Consistency Analysis
- Time Tagged Events (1 ms resolution)
- Alarm Handling, Reports, Trends
- Supervision and Self Diagnostics
- Single Window concept

ABB SRU EMS - 31  
© 2003



## Integration with Supervisory Systems

- Plant Information Systems - MIS
- Regional Dispatch Centres
- Power Generation Coordination Centres
- Energy Trading
- Utility Management Systems
- Process DCS

ABB SRU EMS - 32  
© 2003





## Integration with Subordinated systems

- Satellite Time Receiver (GPS)
- Alarm Annunciators
- SF-6 Density Monitoring Units
- Motor Control Centres
- Battery Chargers
- Meteorological Stations
- Diesel Generators
- Generator- and Turbine controller
- Protection and Control Units

ABB SRU EMS - 33  
© 2003



## Integrated Protection & Control Units

- Protection
- Measuring of U,I,E,  
calculation of P & Q
- Monitoring & Control
- Interlockings
- Alarm Annunciation
- Event Time Tagging
- Disturbance Recording
- Local Storage of trip-events
- Serial Communication to Power Management System

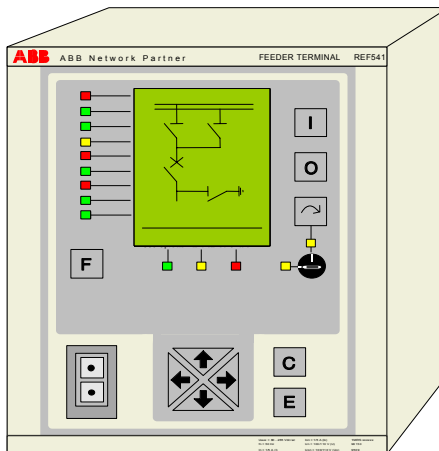


ABB SRU EMS - 34  
© 2003



## Power Management Functionality

- Load Shedding
- Active and Reactive Power Control
- Mode Control
- Supervision, Control and Data Acquisition (SCADA)
- **Re-Acceleration / Re-Starting**
- Synchronisation

ABB SRU EMS - 35  
© 2003



## Re-Starting

- Triggered by Load Shedding or Undervoltage
- Individual Motors
- Priority per Motor
- Max. allowed Time Delay per Motor
- Network Configuration Check
- Network Restoration

ABB SRU EMS - 36  
© 2003



## Power Management Functionality

- Load Shedding
- Active and Reactive Power Control
- Mode Control
- Supervision, Control and Data Acquisition (SCADA)
- Re-Acceleration / Re-Starting
- Synchronisation

ABB SRU EMS - 37  
© 2003



## Synchronisation

- Automatic Synchronisation after Boiler Trip
- Automatic Synchronisation initiated by Operator
- Semi Automatic Synchronisation
- Manual Synchronisation


ABB SRU EMS - 38  
© 2003




## Synchronisation Example Displays

1. Synchronisation Overview
2. Synchronisation Display

ABB SRU EMS - 39  
© 2003

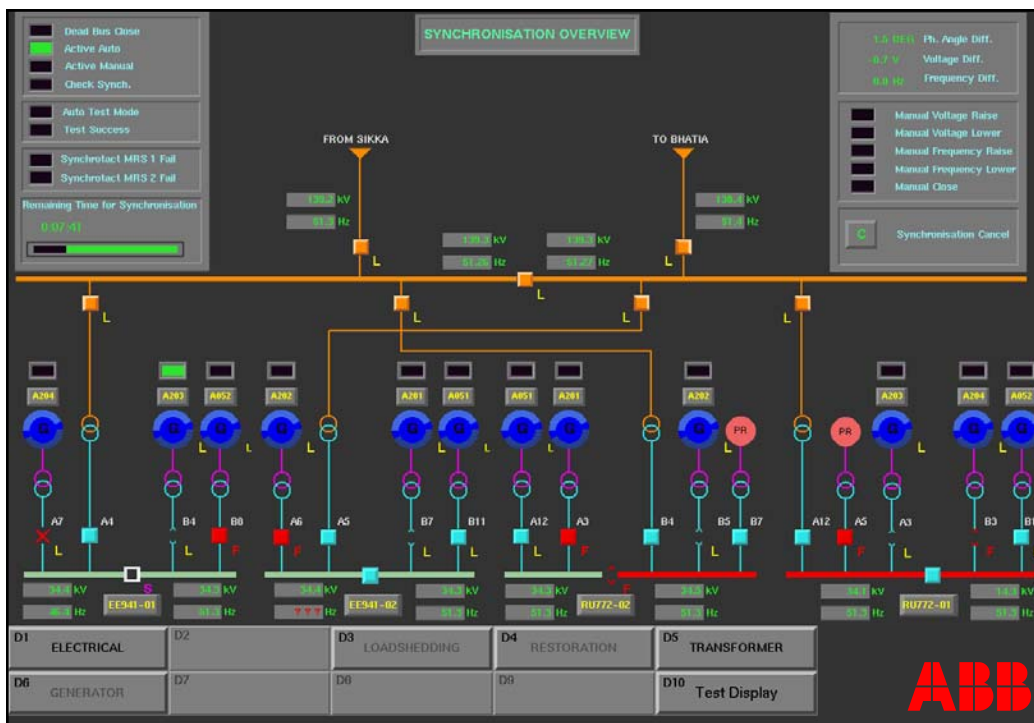

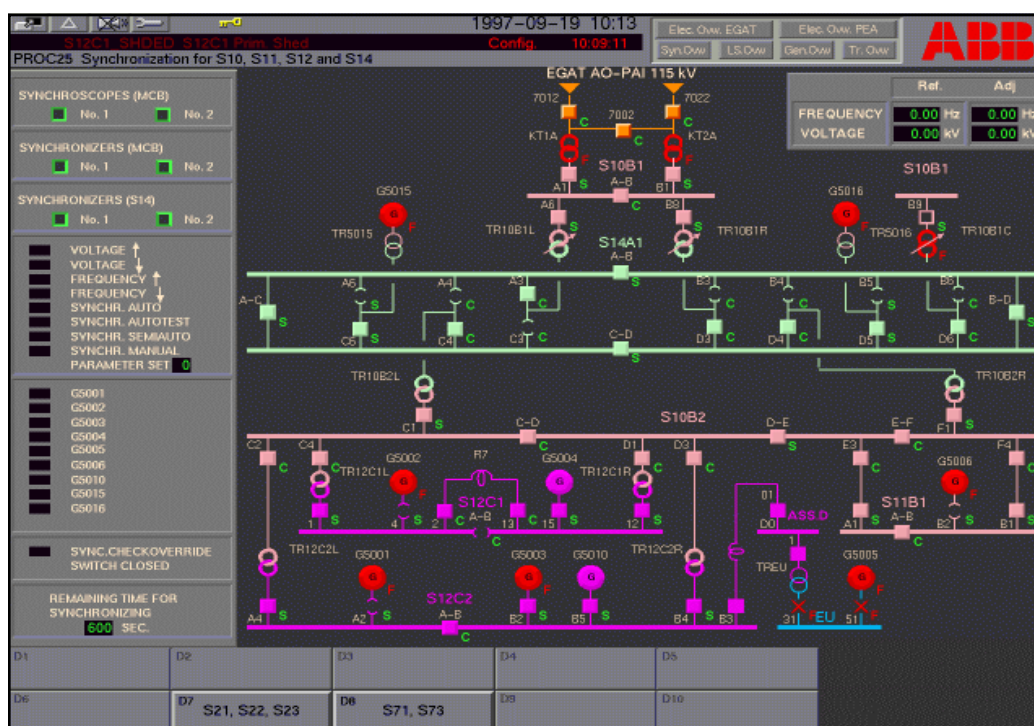

## Power Management Functionality: Summary

- Load Shedding
- Active and Reactive Power Control
- Mode Control
- Supervision, Control and Data Acquisition (SCADA)
- Re-Starting
- Synchronisation
- Circuit breaker Control
- Transformer Control
- Motor Control
- Generator Control
- Network Configuration Determination

## References

-  HAR, refinery in Greece
-  Shell Pernis refinery in the Netherlands
-  Shell BLNG in Brunei
-  Shell PDO in Oman
-  Hoogovens, steel-industry in the Netherlands
-  ThaiOil, ThaiLube, RRC refineries in Thailand
-  La Roche, CHP in UK
-  Petrobras: REPAR, REDUC, RLAM refineries in Brazil
-  Reliance: Hazira, Jamnagar & Haldia refineries in India
-  AFPC, Omar refinery in Syria
-  MLNG Satu, Dua & Tiga in Malaysia
-  StatOil Gullfaks & BP Amoco Valhall in Norway

ABB SRU EMS - 43  
© 2003



## ABB Power Management allows you to:

- Avoid black-outs (up to 500 kUSD / hour)
  - Power control including voltage control, frequency control, sharing power among generators and tie-line(s).
  - High Speed Consistency Load Shedding (< 100 ms.)
- Reduce electricity costs
  - Peak-shaving
  - Re-active Power Control & Sharing
- Minimize operational costs
  - Decreased number of operators
  - Event driven maintenance
  - Single Window concept
- Reduce investment costs
  - Minimized cabling and engineering
  - Optimized network design

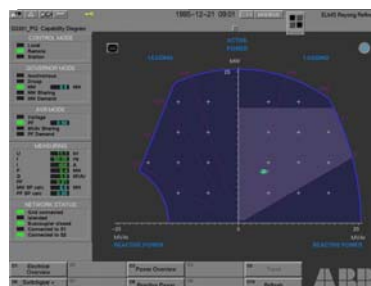


ABB SRU EMS - 44  
© 2003

