



IECEx Certificate of Conformity

INTERNATIONAL ELECTROTECHNICAL COMMISSION IEC Certification Scheme for Explosive Atmospheres

for rules and details of the IECEx Scheme visit www.iecex.com

Certificate No.: IECEx VTT 09.0002X issue No.:2

Status: **Current**

Certificate history:

Issue No. 2 (2011-4-6)
Issue No. 1 (2009-8-26)
Issue No. 0 (2009-6-10)

Date of Issue: **2011-04-06** Page 1 of 4

Applicant: **Vaisala Oyj**
Vanha Nurmijärventie 21
FI-01670 Vantaa
Finland

Electrical Apparatus: **Humidity and temperature transmitter type HMT360**
Optional accessory:

Type of Protection: **Intrinsic safety**

Marking: **Ex ia IIC T4 Ga**

Approved for issue on behalf of the IECEx
Certification Body:

Risto Sulonen

Position:

Team Leader

Signature:
(for printed version)


8.4.2011

Date:

1. This certificate and schedule may only be reproduced in full.
2. This certificate is not transferable and remains the property of the issuing body.
3. The Status and authenticity of this certificate may be verified by visiting the [Official IECEx Website](http://www.iecex.com).

Certificate issued by:

VTT Expert Services Ltd.
Otakaari 7 B, Espoo
P.O.Box 1001
FI-02044 VTT
Finland





IECEx Certificate of Conformity

Certificate No.: IECEx VTT 09.0002X

Date of Issue: 2011-04-06

Issue No.: 2

Page 2 of 4

Manufacturer: **Vaisala Oyj**
Vanha Nurmijärventie 21
FI-01670 Vantaa
Finland

Manufacturing location(s):

This certificate is issued as verification that a sample(s), representative of production, was assessed and tested and found to comply with the IEC Standard list below and that the manufacturer's quality system, relating to the Ex products covered by this certificate, was assessed and found to comply with the IECEx Quality system requirements. This certificate is granted subject to the conditions as set out in IECEx Scheme Rules, IECEx 02 and Operational Documents as amended.

STANDARDS:

The electrical apparatus and any acceptable variations to it specified in the schedule of this certificate and the identified documents, was found to comply with the following standards:

IEC 60079-0 : 2004 Edition: 4.0	Electrical apparatus for explosive gas atmospheres - Part 0: General requirements
IEC 60079-0 : 2007-10 Edition: 5	Explosive atmospheres - Part 0: Equipment - General requirements
IEC 60079-11 : 2006 Edition: 5	Explosive atmospheres - Part 11: Equipment protection by intrinsic safety "i"
IEC 60079-26 : 2006 Edition: 2	Explosive atmospheres - Part 26: Equipment with equipment protection level (EPL) Ga

*This Certificate **does not** indicate compliance with electrical safety and performance requirements other than those expressly included in the Standards listed above.*

TEST & ASSESSMENT REPORTS:

A sample(s) of the equipment listed has successfully met the examination and test requirements as recorded in

Test Report:

[FI/VTT/ExTR09.0002/02](#)

Quality Assessment Report:

[FI/VTT/QAR09.0001/01](#)



IECEx Certificate of Conformity

Certificate No.: IECEx VTT 09.0002X

Date of Issue: 2011-04-06

Issue No.: 2

Page 3 of 4

Schedule

EQUIPMENT:

Equipment and systems covered by this certificate are as follows:

The humidity and temperature transmitter, type HMT 360, for the measurement of temperature and humidity with the following associated sensor heads:

HMP361 wall-mounting probe
HMP362 probe can be used in conjunction with sampling cells
HMP363 probe for restricted space
HMP364 probe for low and high pressure
HMP365 probe for elevated temperature
HMP367 probe for high moisture applications
HMP368 probe for pressure pipes or liquids

Electrical data (maximum values per channel):

$U_i = 28 \text{ V}$
 $I_i = 100 \text{ mA}$
 $P_i = 700 \text{ mW}$
 $C_i = 1 \text{ nF}$
 L_i negligibly low

CONDITIONS OF CERTIFICATION: YES as shown below:

- 1) The equipment with display window and/or with associated cable of the sensor head can be used in Zone 0 Group IIC areas only if the danger of ignition due to electrostatic charge is avoided.
- 2) With the installation of the equipment in Zone 0 Group II area it has to be ensured that sparks due to impact or friction do not occur.
- 3) The serial interface must only be used outside the explosion hazardous area. The associated serial interface cable 25905ZZ is to be used
- 4) Allowed ambient temperature range is $-40^\circ\text{C} \dots +60^\circ\text{C}$



IECEx Certificate of Conformity

Certificate No.: IECEx VTT 09.0002X

Date of Issue: 2011-04-06

Issue No.: 2

Page 4 of 4

DETAILS OF CERTIFICATE CHANGES (for issues 1 and above):

Changes in HM360PRB documents.



1. **EC-TYPE EXAMINATION CERTIFICATE**
2. **Equipment or Protective Systems Intended for use in
Potentially explosive atmospheres
Directive 94/9/EC**
3. Reference: **VTT 09 ATEX 028X Issue 2**
4. Equipment: **Humidity and temperature transmitter**
Certified types: **HMT360**
5. Manufactured by: **Vaisala Oyj**
6. Address: **Vanha Nurmijärventie 21
FI-01670 Vantaa
Finland**
7. This equipment and any acceptable variations thereto are specified in the schedule and possible supplement(s) to this certificate and the documents therein referred to.
8. VTT Expert Services Ltd, notified body number 0537, in accordance with Article 9 of the Council Directive 94/9/EC of March 1994, certifies that the assembly has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres given in Annex II to the Directive.
9. The examination and test results are recorded in confidential Report no. VTT-S-02707-11.
10. Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN 60079-0 (2006/ 2009)
EN 60079-11 (2007)
EN 60079-26 (2007)



11. If the sign "X" is placed after the certificate number, it indicates that this equipment is subject to special conditions for safe use specified in the schedule to this Certificate
12. This EC-Type examination certificate relates only to the design, examination and tests of the specified equipment in accordance to the directive 94/9/EC.

Further requirements of the Directive may apply to the manufacturing process and supply of this equipment. These are not covered by this certificate.
13. The marking of the equipment shall include the following:



II 1 G

Ex ia IIC T4 Ga

Espoo, 06.04.2011

VTT Expert Services Ltd



Martti Siirola
Research scientist



Risto Sulonen
Senior research scientist

14. **Schedule**

15. **EC-TYPE EXAMINATION CERTIFICATE VTT 09 ATEX 028X Issue 2**

16. Description of equipment:

The humidity and temperature transmitter, type HMT 360, for the measurement of temperature and humidity with the following associated sensor heads:

HMP361 wall-mounting probe
HMP362 probe can be used in conjunction with sampling cells
HMP363 probe for restricted space
HMP364 probe for low and high pressure
HMP365 probe for elevated temperature
HMP367 probe for high moisture applications
HMP368 probe for pressure pipes or liquids

Electrical data (maximum values per channel):

$U_i = 28 \text{ V}$, $I_i = 100 \text{ mA}$, $P_i = 700 \text{ mW}$, $C_i = 1 \text{ nF}$, L_i negligibly low

7. Report No. VTT-S-02707-11

18. Special conditions for safe use

- 1) The equipment with display window and/or with associated cable of the sensor head can be used in Zone 0 Group IIC areas only if the danger of ignition due to electrostatic charge is avoided.
- 2) With the installation of the equipment in Zone 0 Group II area it has to be ensured that sparks due impact or friction do not occur.
- 3) The serial interface must only be used outside the explosion hazardous area. The associated serial interface cable 25905ZZ is to be used
- 4) Allowed ambient temperature range is $-40^\circ\text{C} \dots +60^\circ\text{C}$

19. Essential Health and Safety Requirements

Met by compliance with the standards listed on the front page.

Certificate history

Issue	Date	Report No.	Comment
-	2009-06-11	VTT-S-03434-09	Prime certificate
1	2009-08-26	-	EPL Ga marking added Expansion of ambient temp. range
2	2011-04-06	VTT-S-02707-11	Changes in HM360PRB documents

Espoo, 06.04.2011

VTT Expert Services Ltd



Martti Siirola
Research scientist



Risto Sulonen
Senior research scientist



1. **EC-TYPE EXAMINATION CERTIFICATE**
2. **Equipment or Protective Systems Intended for use in
Potentially explosive atmospheres
Directive 94/9/EC**
3. Reference: **VTT 04 ATEX 023X**
4. Equipment: **Humidity and temperature transmitter assembly**
Certified types: **HMT360**
5. Manufactured by: **Vaisala Oyj**
6. Address: **Vanha Nurmijärventie 21
FIN-01670 Vantaa
Finland**
7. This equipment and any acceptable variations thereto is specified in the schedule and possible supplement(s) to this certificate and the documents therein referred to.
8. VTT Industrial Systems, notified body number 0537, in accordance with Article 9 of the Council Directive 94/9/EC of March 1994, certifies that the assembly has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres given in Annex II to the Directive.
9. The examination and test results are recorded in confidential Report no TUO26-044075.
10. Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN 50281-1-1 (1998)



11. If the sign "X" is placed after the certificate number, it indicates that these equipment is subject to special conditions for safe use specified in the schedule to this Certificate
12. This EC-Type examination certificate relates only to the design, examination and tests of the specified equipment in accordance to the directive 94/9/EC.

Further requirements of the Directive may apply to the manufacturing process and supply of these equipment. These are not covered by this certificate.

13. The marking of the equipment shall include the following:



II 1 D

IP 65 T = 70 °C

Espoo, 7.4.2004

VTT INDUSTRIAL SYSTEMS
Electrical Ex-apparatus



I018
(EN45004, liite A)



Martti Siirola
Research scientist



Risto Sulonen
Senior research scientist

14. **Schedule**

15. **EC-TYPE EXAMINATION CERTIFICATE NO. VTT 04 ATEX 023X**

16. Description of assembly

The humidity and temperature transmitter assembly consists of Exi-certified (PTB 00 ATEX 2112X) transmitter type HMT 360 protected against impact with stainless steel cover specified in the drawing DRW217315, Rev A.

Electrical data of supply circuits:

Maximum values per channel:

U_i	= 28 V
I_i	= 100 mA
P_i	= 700 mW
C_i	= 1 nF
L_i	negligibly low

Degree of protection: IP65 (without the cover)

17. Report No. TUO26-044075

18. Special conditions for safe use

Ambient temperature range of the assembly is -40 °C...+60°C without the display and -20 °C...+ 60 °C with the display.

With the operation of the humidity and temperature transmitter assembly in areas which require category 1 apparatus the supply circuit have to be connected to appropriate intrinsically safe supply unit.

19. Essential Health and Safety Requirements


Met by compliance with the standard EN 50281-1-1.

Espoo, 7.4.2004

VTT INDUSTRIAL SYSTEMS
Electrical Ex-apparatus



Martti Siirola
Research scientist

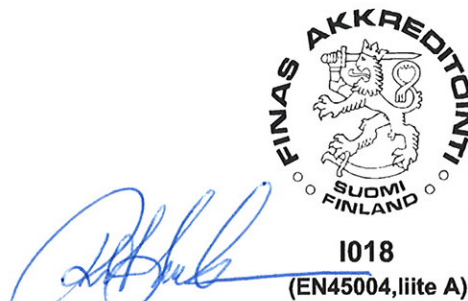

Risto Sulonen
Senior research scientist

CERTIFICATE OF COMPLIANCE

HAZARDOUS (CLASSIFIED) LOCATION ELECTRICAL EQUIPMENT

This certificate is issued for the following equipment:

HMT360*abcdefghi4jklAmn. Transmitter and Probe or Transmitter only.*

IS / I,II,III / 1 / ABCDEFG / T5 Ta = 60°C - DRW211603, Entity;

NI / I, / 2 / ABCD / T5 Ta = 60°C; S / II,III / 2 / FG / T5 Ta = 60°C

Entity Parameters:

Terminals	V_{Max} (V)	I_{Max} (mA)	P_{Max} (W)	C_i (nF)	L_i (μH)
Ch 1: + and -	28	100	0.7	1	0
Ch 2: + and -	28	100	0.7	1	0

a = Probe type: 0, 1, 2, 3, 4, 5, 7 or 8.

b = Transmitter type: any single letter A-Z.

c = Display: 1 or 2.

d = Output channels: 1 or 2.

e = Analog output signal (Ch1): any single letter A-Z.

f = Analog output signal (Ch 2): any single letter A-Z.

g = Output range: any single letter A-Z.

h = Units: 1 or 2.

i = Cable bushings: A, B, C or 4.

j = Manual: Any single letter A-Z.

k = Cable length: (any single letter) A-Z or 0, 1, 2 or 3.

l = Humidity sensor: 0, 1, 2, 3, 4, 5, 6, 7, 8 or A.

m = Sensor protection: 0, 1, 2, 3, 4, 6 or 7.

n = Installation kit: A-Z or 0.



Equipment Ratings:

Intrinsically Safe Class I, II, III, Division 1, Groups A, B, C, D, E, F, & G; also as Class I, Zone 0, AEx ia IIC; in accordance with Entity requirements when installed per installation drawing DRW211603; and Nonincendive Class I, Division 2, Groups A, B, C, & D; Suitable for Class II & III, Division 2, Groups F & G, for use in an indoor hazardous (classified) locations with a temperature rating of T5, Ta = 60°C.

FM Approved for:

Vaisala Oyj
Helsinki, Finland

This certifies that the equipment described has been found to comply with the following Approval Standards and other documents:

Class 3600	1998
Class 3610	1999
Class 3611	1999
Class 3810	1989
Including Supplement #1	1995


Original Project ID: 3010615

Approval Granted: January 9, 2002

Subsequent Revision Reports / Date Approval Amended

Report Number	Date	Report Number	Date
3016167	March 14, 2003		
3017701	August 7, 2003		
030916	November 3, 2003		
051221	May 24, 2006		
091102	November 5, 2009		


FM Approvals LLC


J. E. Marquedant
Group Manager, Electrical

5 November 2009
Date

REV	QTY	DESCRIPTION / INFO / ECO No.	DESIGN	CHECKED / Reviewed	ACCEPTED / Approved
B		List of approved probe types added	ECO212870	RHA	

Wiring diagram for intrinsically safe operation of the HMT360-series humidity and temperature transmitter.

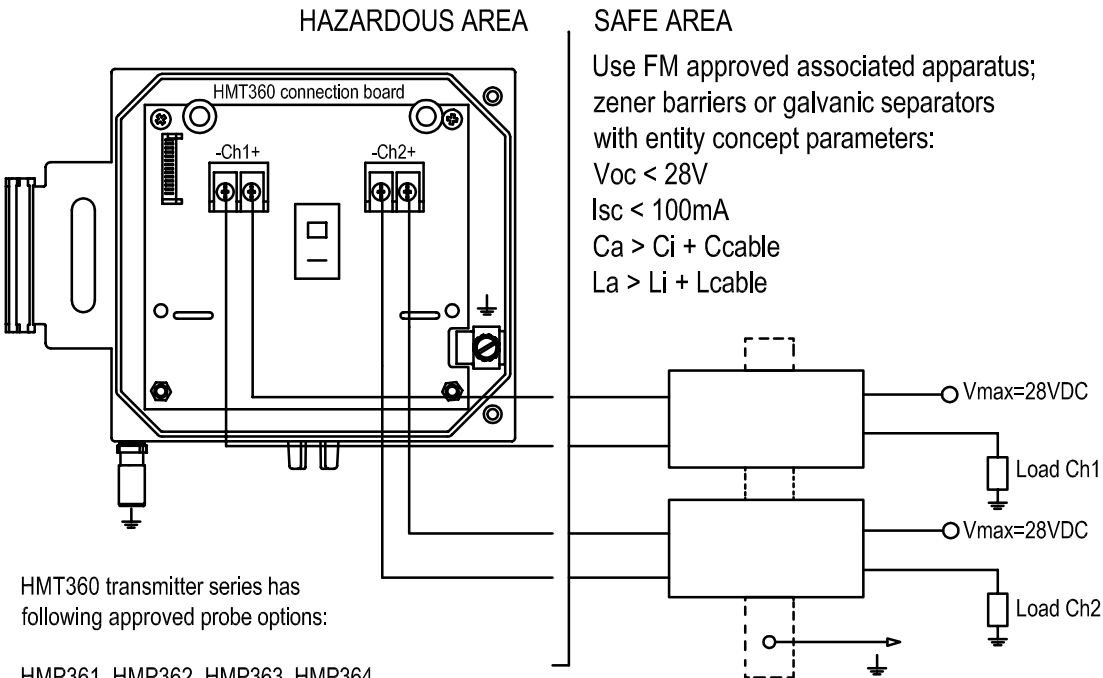


HMT360 transmitter series has following approved probe options:

HMP361, HMP362, HMP363, HMP364, HMP365, HMP367 & HMP368

HMT360-series transmitters are approved for use in Classes I, II and III, Division 1, Groups A - G and Division 2, Groups A - D, F and G.

Safety factors for HMT360-series transmitters are: Vmax=28V, Imax=100mA, Ci=1nF, Li=0, Pi=0.7W

- NOTE:
- Barrier installation must be completed in accordance with ANSI/ISA RP 12.6 and the National Electrical Code.
 - Intrinsically safe barrier ground must be less than 1 ohm.
 - Maximum safe area voltage is 250V.

General tolerance		ISO 2768-m		Design		 VAISALA					
Material		Weight									
Finish 		Supplier code				Title Assembly Instruction HMP360 and HMT360 VIN/HM					
		DOCUMENT CREATION DATA									
		YYYY-MM-DD INITIALS									
		Creator		01-07-18 ARH							
FIRST ANGLE PROJECTION 		Review		01-11-19 ARH		Size		Code		Rev	
		Approved		05-04-11 RHA		DRW211603 B					
		Archive ID		ACAD							
DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE SPECIFIED											
		Sheet of									

NOTE: This information is CONFIDENTIAL and PROPRIETARY to VAISALA. It is furnished with understanding that the information will not be copied or disclosed without the written consent of VAISALA. These materials are subject to the exemption 5 U.S.C. Section 552 (b) (4) which provides that trade secrets and commercial or financial information shall not be disclosed to third parties.



Certificate of Compliance

Certificate: 1300863

Master Contract: 213862

Project: 1813104

Date Issued: 2006/07/24


Issued to: Vaisala Oyj

P.O. Box 26
Helsinki, 00421
Finland
Attention: Mr. Riku Hakala


The products listed below are eligible to bear the CSA Mark shown



Issued by:


Dorin Stochitoiu, P.Eng

Authorized by: Patricia Pasemko, Operations
Manager



PRODUCTS

CLASS 2258 03 - PROCESS CONTROL EQUIPMENT - Intrinsically Safe and Non -
Incendive Systems - For Hazardous Locations

Class I, Div.1 and Div.2, Groups A, B, C and D; Class II, Div.1 and Div.2, Groups G and Coal Dust; Class III

HMT 360 series, humidity and temperature transmitters, rated 28V, 4-20 mA, and provides intrinsically safe outputs to HMP36* series probe when connected as per installation drawing DRW213478, Maximum ambient temperature 60°C, Temperature Code T4.


APPLICABLE REQUIREMENTS

CSA Std C22.2 No. 142-M1987 - Process Control Equipment

Ltr	Qty	Change	Reason/ ECO no	Design	Date Review	Date Appr
C		Probe types and barrier/isolator info updated	ECO212844	KKe	2006-06-20 RHA	2006-06-20 HJJ

Wiring diagram for intrinsically safe operation of the HMT360-series humidity and temperature transmitter.

HAZARDOUS AREA

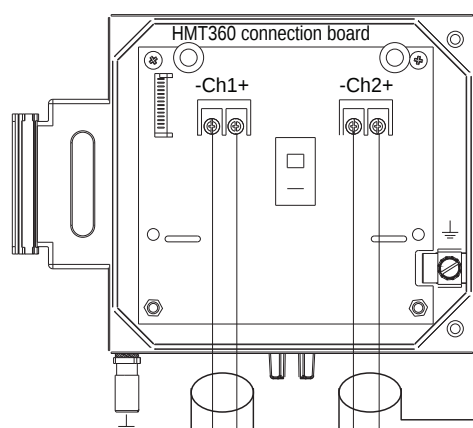


Vaisala offers following barrier and galvanic isolator types:

Manufacturer: Type: Vaisala code:

Barrier: R. Stahl 9001/51-280-091-141 210664
Isolator: R. Stahl 9160/13-11-11 212483

If other barrier or galvanic isolator types are used, Vaisala or CSA do not take responsibility for the selected barrier's or galvanic isolator's suitability!

Cable parameters shall be less than 60pF/ft (197pF/m) and 0.2μH/ft (0.67μH/m). The maximum cable length is 2000ft (600m).

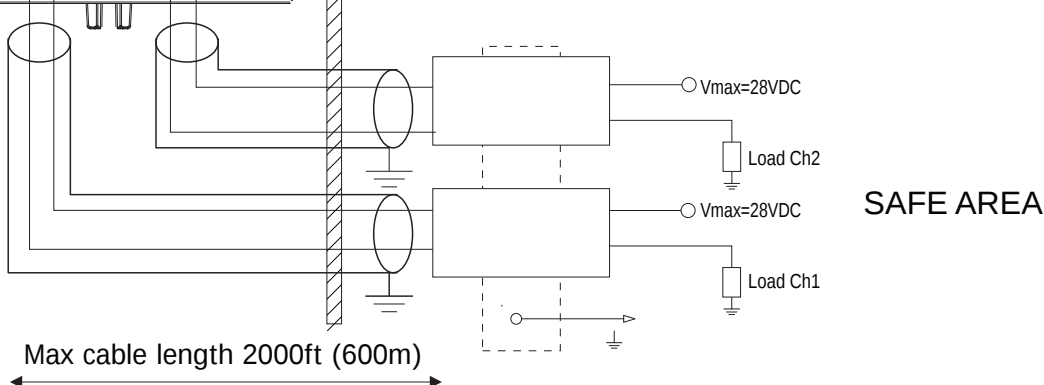

SAFE AREA

HMT360-series transmitters are approved for use in Division 1 and 2, Class I, Groups A, B, C, and D. Division 1, and 2, Class II, Group G and coal dust. Division 1, and 2, Class III.

NOTE:

- Each channel must be supplied through separate shielded cables.
- When using galvanic separators CH1- and CH2- must be short circuited with an external wire.
- When using transmitter in Class I, Division 2 the main switch shall not be operated or the unit shall not be disconnected unless power has been switched off, or area is known to be non hazardous.
- Use only conduit connection in Division 2.
- Substitution on components may impair intrinsic safety or suitability for Division 2.
- Only intrinsically safe installation is allowed in Class II and Class III environments.
- Intrinsically safe barrier ground must be less than 1 ohm.
- Maximum safe area voltage is 250V.

HMT360-series transmitters shall be used with following probes:

- Probe HMP361 with 127mm long pipe.
- Probe HMP362 with 2, 5 or 10 m length cable
- Probe HMP363 with 2, 5 or 10 m length cable
- Probe HMP364 with 2, 5 or 10 m length cable
- Probe HMP365 with 2, 5 or 10 m length cable
- Probe HMP367 with 2, 5 or 10 m length cable
- Probe HMP368 with 2, 5 or 10 m length cable

The material for associated cable is FEP (Tetrafluoropropylene) or for HMP363 also PUR (Polyurethane) available.

To avoid static discharge shall the cable cover with conductive material.

Drawn	KKe 2002-08-21	Arch id		Serial no		Sheet		Cooperator's doc no	
Review	IML 2002-10-06	Title		Vaisala Oyj Vanhanurmijärventie 21 Vantaa Finland					
Appr	KKe 2002-10-06								
Design									
Replaces	DRW213478B								
Replaced by		Installation Drawing						Dwg no	DRW213478
								Rev	C



防爆構造電気機械器具型式検定合格証

申請者	東京都新宿区神楽坂六丁目42番地 ヴァイサラ株式会社		
製造者	Vanha Nurmijärventie 21, FIN-01670 Vantaa, FINLAND Vaisala Oyj		
品名	湿・温度変換器		
型式の名称	HMT360 7D22HKD2B7BX1A1A (同一型式は別表のとおり)		
防爆構造の種類	本質安全防爆構造 (ia)		
対象ガス又は蒸気の 爆発等級及び発火度	IICT4		
定格	チャンネル1回路 許容電圧 28V 許容電流 100mA 許容電力 700mW 内部インダクタンス 無視できる値 内部キャパシタンス 1nF チャンネル2回路 許容電圧 28V 許容電流 100mA 許容電力 700mW 内部インダクタンス 無視できる値 内部キャパシタンス 1nF 周囲温度 60℃		
使用条件			
型式検定合格番号	第 TC17897 号		
有効期間	平成19年 4月 4日 から 平成22年 4月 3日まで		
	平成 年 月 日 から 平成 年 月 日まで		
	平成 年 月 日 から 平成 年 月 日まで		
	平成 年 月 日 から 平成 年 月 日まで		

機械等検定規則による型式検定に合格したことを証明する。

平成19年 4月 4日

型式検定実施者 社団法人 産業安全技術協会





防爆合格证

CONFORMITY CERTIFICATE OF EXPLOSION-PROOF

证 号
Certificate No. CE092145

产品名称
Name of Product

温湿度变送器

型号及规格
Type of Product

HMT360

防爆标志
Marking

Exia II CT4

技术文件
Technical Documents

/

图 号
Drawing No.

/

备 注
Note (s)

- 1 此产品必须与安装在安全区的关联设备连接, 关联设备参数见使用说明书。
- 2 制造商: 维萨拉责任有限公司。

经对上述产品图样及技术文件的审查和样品的检验, 其符合以下中国现行标准:

By verifying the drawings and technical documents and checking samples, the product complies with the following standards currently valid in P. R. China:

GB3836.1-2000

GB3836.4-2000

发 给:
Issued to:

维萨拉(北京)气象测量技术有限公司

本证失效日期:
Date of Expire:

2014-10-20

发 证 日 期:
Date of Issue:

2009-10-20

中心印章
Center seal



中心主任
Director

徐刚

石油和化学工业电气产品防爆质量监督检验中心
Supervision & Test Center of Ex-products of China Petroleum & Chemical Industry

本中心由以下组织认可:
PCEC has been approved by



注: 本证仅对与送检样品一致的产品有效。

Note: This certificate is only valid for the products that are in accord with sample(s) tested and verified.

中心地址: 中国天津市丁字沽三号路85号

Center Add: No 85 No.3 Road DingZiGu Tianjin China Post code: 300131

E-mail: cec@pcec.com.cn

邮政编码: 300131

Tel/ Fax: 022-26651066/26689116

<http://www.pcec.com.cn>

电话/传真: 022-26651066 / 26689116



СЕРТИФИКАТ СООТВЕТСТВИЯ

№ РОСС FI.ГБ05.В03489

Срок действия с 15.06.2011

по 15.06.2014

№ 0558771

ОРГАН ПО СЕРТИФИКАЦИИ РОСС RU.0001.11ГБ05

НАНИО "ЦЕНТР ПО СЕРТИФИКАЦИИ ВЗРЫВОЗАЩИЩЕННОГО
И РУДНИЧНОГО ЭЛЕКТРООБОРУДОВАНИЯ",

115230, г. Москва, Электролитный проезд, д. 1, корп. 4, комната № 9, НАНИО "ЦСВЭ",
тел./факс: +7 (495) 554-2494, 554-1238, 554-1257, 554-0150, 554-5042, 557-8244, 558-8353, 558-8141, 971-6830.

www.ccve.ru

ПРОДУКЦИЯ

Измерители влажности и температуры НМТ360 с датчиками НМР36*
и маркировкой взрывозащиты согласно приложению
Серийный выпуск

код ОК 005 (ОКП):

42 1551

СООТВЕТСТВУЕТ ТРЕБОВАНИЯМ НОРМАТИВНЫХ ДОКУМЕНТОВ

ГОСТ Р 52350.0-2005 (МЭК 60079-0:2004);

ГОСТ Р 52350.11-2005 (МЭК 60079-11:2006)

код ТН ВЭД России:

9025 80 910 0

ИЗГОТОВИТЕЛЬ

Vaisala Oyj,

Vanha Nurmiyrventie 21, 01670 Vantaa, Финляндия

СЕРТИФИКАТ ВЫДАН

Vaisala Oyj,

Vanha Nurmiyrventie 21, 01670 Vantaa, Финляндия

Телефон: +358 9 89491; факс: +358 9 8949 2485

НА ОСНОВании

Протокола испытаний № 109.2011-И от 29.04.2011 ИЛ ЦСВЭ

(рег. № РОСС RU.0001.21ГБ04);

Акта о результатах анализа состояния производства сертифицируемой продукции

№ 22-ПП/11 от 22.03.2011 ОС ЦСВЭ (рег. № РОСС RU.0001.11ГБ05).

ДОПОЛНИТЕЛЬНАЯ ИНФОРМАЦИЯ

Схема сертификации 3а

Сертификат действителен с приложением на 2-х листах

Инспекционный контроль – 2012 г., 2013 г.



Руководитель органа

В.Б. Солнцев
подпись

А.С. Залогин

инициалы, фамилия

Эксперт

В.Б. Солнцев

инициалы, фамилия

Сертификат имеет юридическую силу на всей территории Российской Федерации

**СИСТЕМА СЕРТИФИКАЦИИ Ех-ОБОРУДОВАНИЯ
СИСТЕМА СЕРТИФИКАЦИИ ГОСТ Р
ФЕДЕРАЛЬНОЕ АГЕНСТВО ПО ТЕХНИЧЕСКОМУ РЕГУЛИРОВАНИЮ И МЕТРОЛОГИИ**



**НЕКОММЕРЧЕСКАЯ АВТОНОМНАЯ НАУЧНО-ИССЛЕДОВАТЕЛЬСКАЯ ОРГАНИЗАЦИЯ
«ЦЕНТР ПО СЕРТИФИКАЦИИ ВЗРЫВОЗАЩИЩЕННОГО
И РУДНИЧНОГО ЭЛЕКТРООБОРУДОВАНИЯ»
РОСС RU.0001.11ГБ05**

115230, г. Москва, Электролитный проезд, д. 1, корп. 4, комната № 9, НАНИО «ЦСВЭ»
Почтовый адрес: 109377, г. Москва, а/я 22, НАНИО «ЦСВЭ» тел. /факс: +7 (495) 554-2494, 554-1238, 554-1257, 554-0150, 554-5042, 557-8244, 558-8353, 558-8141, 971-6830.

www.ccve.ru

**ПРИЛОЖЕНИЕ
К СЕРТИФИКАТУ № РОСС FI. ГБ05.В03489**

Составлено в соответствии с п. 7.10.1 «Правил сертификации электрооборудования для взрывоопасных сред»
ПБ 03-538-03, зарегистрированных Министерством юстиции РФ 23.04.03 г., регистрационный № 4440

1. НАЗНАЧЕНИЕ И ОБЛАСТЬ ПРИМЕНЕНИЯ

Измерители влажности и температуры НМТ360 с датчиками НМР36* (далее – измерители) предназначены для измерения влажности и температуры природного газа.

Область применения - взрывоопасные зоны классов 1 и 2 помещений и наружных установок согласно маркировке взрывозащиты, ГОСТ Р 52350.14-2006 (МЭК 60079-14:2002), гл. 7.3 ПУЭ и другим нормативным документам, регламентирующим применение электрооборудования во взрывоопасных зонах.

2. ОСНОВНЫЕ ТЕХНИЧЕСКИЕ ДАННЫЕ

2.1. Маркировка взрывозащиты:

- преобразователь НМТ360	1 Ex ia IIC T4 X
- датчики НМР361/2/3/4/5/8	0 Ex ia IIC T4 X
- компактное исполнение	1 Ex ia IIC T4 X

2.2. Диапазон температур окружающей среды, °С от минус 40 до +60

2.3. Степень защиты от внешних воздействий по ГОСТ 14254-96 IP54

2.4. Длина штатного соединительного кабеля датчика, м 2/5/10

2.5. Входные и выходные искробезопасные параметры измерителей:

Тип преобразователя	Входные искробезопасные параметры				
	U _i , В	I _i , мА	P _i , Вт	L _i , мкГн	C _i , нФ
НМТ360 с датчиками НМР361/2/3/4/5/8	28	100	0,7	0	1

2.6. Выходной сигнал измерителей:

- выходной сигнал, мА 4-20

**3. ОПИСАНИЕ КОНСТРУКЦИИ ИЗДЕЛИЙ И СРЕДСТВ ОБЕСПЕЧЕНИЯ
ВЗРЫВОЗАЩИЩЕННОСТИ**

Измерители состоят из датчика, выполненного в цилиндрическом корпусе из спеченной нержавеющей стали и электронного преобразователя в прямоугольном корпусе из алюминиевого сплава, с содержанием магния < 7,5%. Измерители имеют два исполнения: компактное, при котором датчик и электронный преобразователь составляют единую конструкцию, и раздельное, при котором датчик, подключен через специальный кабельный ввод к корпусу электронного преобразователя. На передней панели корпуса электронного преобразователя выполнен дисплей с кнопками управления. Внутри корпуса размещены печатные платы с компонентами



Руководитель органа

Эксперт

Подпись

подпись

А.С. Залогин
ФИО

В.Б. Солнцев
ФИО

**СИСТЕМА СЕРТИФИКАЦИИ Ех-ОБОРУДОВАНИЯ
СИСТЕМА СЕРТИФИКАЦИИ ГОСТ Р
ФЕДЕРАЛЬНОЕ АГЕНСТВО ПО ТЕХНИЧЕСКОМУ РЕГУЛИРОВАНИЮ И МЕТРОЛОГИИ**

Приложение к сертификату соответствия № РОСС FI. ГБ05.В03489

Лист 2
Листов 2

электроники, разъемы для внутренних подключений. Имеются клеммы для подключения внутренней и внешней шин заземления.

Взрывозащищенность измерителей обеспечивается видом взрывозащиты "искробезопасная электрическая цепь" уровня "ia" по ГОСТ Р 52350.11-2005 (МЭК 60079-11:2006) и выполнением их конструкции в соответствии с требованиями ГОСТ Р 52350.0-2005 (МЭК 60079-0:2004).

4. МАРКИРОВКА

Маркировка, наносимая на измерители должна включать следующие данные:

- товарный знак или наименование предприятия-изготовителя;
- тип изделия;
- заводской номер и год выпуска;
- наименование или знак центра по сертификации и номер сертификата;
- входные искробезопасные параметры
- маркировку взрывозащиты;
- диапазон температур окружающей среды;

и другие данные, которые изготовитель должен отразить в маркировке, если это требуется технической документацией.

5. СПЕЦИАЛЬНЫЕ УСЛОВИЯ ПРИМЕНЕНИЯ

Знак Х, стоящий после маркировки взрывозащиты, означает, что при эксплуатации измерителей необходимо соблюдать следующие специальные условия:

5.1. Питание измерителей должно осуществляться через барьеры искрозащиты, имеющие сертификат соответствия Системы сертификации ГОСТ Р и разрешение на применение Ростехнадзора.

5.2. Индуктивность и емкость искробезопасных цепей измерителей, с учетом параметров присоединительных кабелей, не должны превышать максимальных значений, указанных на барьере искрозащиты со стороны взрывоопасной зоны.

5.3. При эксплуатации измерителей принять меры, исключающие накопление электростатического заряда на кабеле датчика и на дисплейном окошке

6. ПЕРЕЧЕНЬ ДОКУМЕНТАЦИИ, СОГЛАСОВАННОЙ С ЦЕНТРОМ ПО СЕРТИФИКАЦИИ

Номер чертежа	Подписан	Согласован
DRW213478	20.06.2006	22.03.2011
DRW211603	04.05.2006	22.03.2011

Внесение изменений в согласованные чертежи и конструкцию изделий возможно только по согласованию с НАНАО «ЦСВЭ»



Руководитель органа

Эксперт


Подпись

подпись

А.С. Залогин
ФИО

В.Б. Солнцев
ФИО